# SZS CONSULTING GROUP

## **WOMEN'S BUILDING**

**ADA ASSESSMENT & SURVEY** 



Sacramento Office 770 L Street, Suite 950 Sacramento, CA 95814 Tel: 916.669.8750 Fax: 888.211.7441

Silicon Valley Office 2225 E. Bayshore Road, Suite 200

Palo Alto CA 94303 Tel: 866.694.7637 www.szs-consulting.com

January 8, 2015



Angelo Gomez Executive Director Office of Equity and Inclusion Oregon State University 330 Snell Hall Corvallis, OR 97331-2128

Re: ADA Accessibility Survey and Assessment - Women's Building

Dear Angelo,

We are pleased to submit this report for the Women's Building. This report is part of our project to provide a Campus Accessibility Survey and Assessment for Oregon State University. It is our hope that this report will assist OSU in improving access to people with disabilities to campus facilities.

SZS has been pleased to be a part of this effort to evaluate campus buildings using federal and state statutes and regulations, as well as universal design principles in order to create performance standards that will guide design, construction and maintenance on campus.

We look forward to discussing our findings with your team.

Regards,

Syroun Z. Sanossian, Principal SZS Consulting Group LLC

Syn 2. 8m.

#### **TABLE OF CONTENTS**

1.	EXECUTIV	E SUMMARY OF FINDINGS	p. 1	
	a.	Pedestrian Facilities and Exterior Spaces Analyzed	p. 2	
	b.	Building Entrances	p. 3	
2.	INTERIOR	SPACES		
		Basement	p. 3	
		First Floor	p. 5	
		Second Floor	p. 6	
3.	BARRIEF	R DATA RECORDS		
		Exterior Area Barriers	p. 7	
		Interior Area Barriers	p. 12	
		Cost Estimate	p. 435	;

#### 1. EXECUTIVE SUMMARY OF FINDINGS

The field investigation for the interior spaces began on February 24, 2014. The exterior site elements were assessed originally as part of the pedestrian facilities assessment in June-September 2011 and are included as an essential part of this report. Images of each physical element identified in this report were captured in HD digital photos while manual measurements were taken to establish as-built conditions to facilitate the process of cost estimating. Digital photographs are provided within the report for each barrier to access, to facilitate the review of the data collected. We have found that technical data can be difficult to interpret without a visual component; the photos provide a clear connection between the technical data and each barrier to access.

The Women's Building is a historic structure and many barriers to access were identified in the building. That is quite typical, as barriers to access exist in virtually every building, whether new or existing.

No "perfect" building exists in the real world.

This ADA Assessment and Survey report is intended to not only identify barriers to access, but to provide solutions. The basis for this ADA Assessment and Survey process is the underlying desire on the part of OSU to improve access by relying on higher standards than the minimum requirements in state and federal building codes. SZS intends to provide the information in this report in a clear and easy to understand format. The information in this report is compiled for use by designated OSU staff and other interested persons, so the content is designed to be understood by professionals and laymen alike.

The findings presented are both narrative and technical in nature; barriers to access identified during the field investigation process are documented in two ways;

Narrative Analysis: The analysis of findings is contained in an executive summary in a
narrative form that not only describes each type of barrier identified but also provides a
discussion that analyses the functionality of physical elements. We also provide the
reasoning and research behind the identification of barriers that conflict with universal
design principles. This analysis may be accompanied by digital photographs or
diagrams, where applicable.

NOTE: Understanding building function and usage is essential when interpreting the findings held in this report. The narrative is intended to facilitate this process.

2. <u>Barrier Data Records:</u> Individual barriers to access are entered into the SZS database so that technical information on the barriers can be provided as barrier data records. These barrier data records include digital photographs of each barrier identified, code references that determine the barrier to access, as-built measurements, barrier severity ratings, budgetary cost estimates, recommended solutions for barrier removal and a priority for barrier removal. The information is formatted with two barriers on each report page.

In order to consolidate the report data, some of the more typical barriers found in multiple locations have been grouped within the barrier data records with a description of the locations in which they were found.

#### A. Pedestrian Facilities and Exterior Spaces Analyzed

This report provides information on campus pedestrian facilities that serve the Women's Building. Many physical elements are part of the comprehensive whole that creates a pedestrian facility. The fundamental elements evaluated as to whether they provide accessible pedestrian facilities include the following:

- Sidew alks
- Walkw ays
- Ramps
- Curb Ramps
- **Blended Transitions**
- Signalized Intersections
- Stairw ays (94% of people with disabilities are not mobility impaired)
- Benches and other Seating Elements
- Picnic Facilities

The descriptions provided for physical elements in this report are intended to clearly describe the differences between each physical element, such as when a pedestrian route is a sidewalk, rather than a walkway. The descriptions are intended to explain how the elements interact to form a cohesive pedestrian facility. Other more specific information described within this section intends to provide guidance on determinations made in this report.

The key to providing accessible pedestrian facilities is in recognizing that different people with disabilities have different needs. Setting policies that speak to the entire group is essential, rather than focusing one particular subset of the overall group. Universal design principles govern here - physical elements should be usable to everyone that visits campus without having to resort to any adaptation or specialized design.

In summary, an accessible route exists within a building, property boundary or interior space and is separate from the PROW. Pedestrian walkways are similar to sidewalks as paved surfaces improved for use by pedestrians but walkways are not located along or adjacent to the curb line, gutter or roadway and walkways are generally not considered part of the PROW. The pedestrian facility is the combination of the PROW and the accessible route, which functions as a whole to provide pedestrian access to facility entrances.

As a public building governed by the ADA Standards, the Women's Building should have at least one accessible entrance. The accessible entrance is located on the basement level on the north side of the building that was recently constructed which leads to the elevator that can be used to reach all upper floors.

The Women's Building has an accessible route provided within the site from accessible parking spaces and accessible passenger loading zones; public streets and sidewalks; and public transportation stops to the accessible building or facility entrance they serve 1 as compared to the 2010 ADA Standard for Accessible Design. Details on barriers identified in that route are provided within the ADA Assessment and Survey of the pedestrian facilities provided as a separate report, as well as in the following records. Please see the barrier data records for details.

#### B. Building Entrances

The building is located along a major pedestrian way within campus. No parking is provided on-site, but on-street accessible parking is located south of the building along SW Memorial Place. Pedestrian entrances are provided at each side of the building, although the entrances along the west side were blocked by construction at the time of the field investigation. The north entrance was identified with an accessible ramp that was recently constructed. Although the ramp was an improvement from the existing entrance, the handrail posts created a trip hazard along the outer edges of the ramp along the surface intended to provide a smooth transition for wheelchair wheel guides. ISA directional signs were posted in the view panels of the doors at the stairway entrances at the east side of the building, although it is not large enough to be viewed at a distance. Pedestrians walking along SW 26th Street to reach the building may be forced to retrace their steps when attempting to find the accessible entrance. It is recommended that an ISA directional sign be posted at the sidewalk junction where the walkway turns to the main entrance to inform people traveling to the building that the accessible entrance is around the corner, so that they are not forced to retrace their steps. The entry door provided at the accessible entrance ramp on the north side of the building is equipped with an automatic door opening device.

#### INTERIOR SPACES

#### **BASEMENT**

The Women's Building is a three-story building including a basement. The building is a historic structure that has retained many of the original doors, stairways flooring and other elements used regularly although some areas have been remodeled. The basement houses research laboratories, offices for graduate students, classrooms and a swimming pool with men's, women's and staff locker rooms. Barriers identified in the basement were commonly identified throughout the building in common use areas and include entrance doors to classrooms and offices that lacked accessible signage, door hardware, door closer operating force/sweep period where door closers were installed and lacked view panels not accessible to short people or wheelchair users.

In many instances, the entry doors lacked accessible maneuvering clearance as either a result of the original design or due to the location of furniture or other items that encroached into the space needed by wheelchair users to maneuver. The lack of accessible maneuvering clearance may necessitate the installation of automatic door opening devices at entrance doors to classrooms and

<sup>&</sup>lt;sup>1</sup> 2010 ADA Standards for Accessible Design, Section 206.2.1 Site Arrival Points

laboratories in many locations. Other than at the multi-accommodation restrooms, most signage in the building provided visual information but lacked tactile information (Braille and raised letters) needed by the visually impaired.

Central corridors were identified non-accessible drinking fountains and the floor in the entry path from the accessible ramp was identified with a drain that caused an abrupt change in level in the middle of the circulation path. None of the drinking fountains in the basement or on other floors were located within an alcove, and could create a protruding hazard if not provided with detectable warnings. Evacuation signs were provided but the signs lacked tactile information.


As a performance standard, it is recommended that lobby identification signage be provided on each floor in each central corridor that indicates the floor plan, the location of the person viewing

the sign and the location of accessible features such as restrooms, elevator and drinking fountains in proximity to the location of the person reading the sign. Although the accessible features provided in the building are located in the central corridor, people with low vision may benefit from the information provided w ithin the recommended identification sign.

The Biometrics Lab 015 appears to occupy an altered space where the floor was raised. Short ramps constructed between the door threshold and raised floor at each entry door are



steep (24%) and entry into the lab is not accessible (see photo at right). This lab was also identified with non-accessible tables, desks and counters, lockers and the adjacent office space with equipment appeared to be used for exercise research. Counters and desks in that lab were also not accessible. Findings in other work spaces and offices were similar on this floor. A sloped corridor is located on the north side of the building which is used as a common circulation path between floors. The slope is not accessible and ISA directional signs should be posted indicating





Some stairways on this floor were identified as historic with non-accessible handrails and they lacked tactile signage includina level identification signage for the visually impaired. No contrasting color was identified at the stairway treads which can be important to those with low vision. As а performance standard, it is highly recommended to provide contrasting color at stairway treads to improve visibility for all users.

An enclosed exit stairway near the pool was also identified with a heavy entry door and a lack of accessible signage. The elevator was not identified with signage indicating that the basement was the discharge level. Other barriers to access identified at the elevator include a lack of accessible door jamb signs (no raised star for discharge level and height accessible), hall call buttons that were not at an accessible height and that did not illuminate for those with visual impairments, no audible signals and an emergency communication system that required voice communication that may not be possible for speech impaired visitors.

Many staff use only areas were identified in the building. These spaces include IT rooms, janitorial rooms, private faculty offices and associated spaces. Signage at the door/doorway to these spaces was included in this report as it is located along the public circulation route of travel, but these interior spaces were not investigated as part of this assessment process. In general, institutions and organizations make staff-use-only areas accessible as needed through the reasonable accommodation iterative process between the employer and employee.

Graduate student offices in the building were identified with non-accessible entry door operating force, door hardware, view panels accessible to short people and wheelchair users and nonaccessible maneuvering clearance blocked by file cabinets, furniture or stored items. Signage was also not accessible and doorstops attached to the bottom 10" of doors at the push side could create trap conditions for wheelchair users. Light switches, outlets and other controls were also not at an accessible height. Also, many of the offices lacked maneuvering clearance needed by wheelchair users at entry doors and within the interior spaces of the offices. Controls such as light switches, electrical outlets and shelves were also not accessible in the offices. Desks used by student assistants lacked accessible maneuvering clearance, work surface height or accessible knee clearance.

#### FIRST FLOOR

Barriers identified in the first floor were commonly identified throughout the building in common use areas and include entrance doors to offices that lacked accessible signage, door hardware, door closer operating force/sweep period where door closers were installed and lacked view panels not accessible to short people or wheelchair users and a lack of visual signal appliances (strobes)

connected to the fire alarm system. In many instances, the entry doors lacked accessible maneuvering clearance as either a result of the original design or due to the location of furniture or other items that encroached into the space needed by wheelchair users to maneuver. The lack of accessible maneuvering clearance may necessitate the installation of automatic door opening devices at entrance doors to classrooms and labs in many locations.



The swimming pool spectator seating balcony was located on the first floor. No accessible entry doors or seating was

provided in this area. Gymnasium 112 was also identified with bleacher seating that lacked accessible seating locations integrated into the typical seating and accessible handrails. Two drinking fountains in the gym were non-accessible. The College of Public Health and Human Science Department were located on the first floor. Offices in the college were identified with barriers described above including a service counter that lacked an accessible section for short people or those who use wheelchairs.

The modern and ballet dance studio was identified with barriers common to other classroom settings in this building but this space also had a performance stage that lacked an accessible ramp or wheelchair lift, as well as accessible handrails (see photo at right). The social dance studio was also identified with similar barriers but did not provide a stage area. Lockers provided in the social dance studio lacked accessible controls and space needed at the lockers as maneuvering clearance was blocked by stored items.

The only men's restroom in the building is located on the first floor. The facility was identified in original historic condition which rendered the entry vestibule, entry door and lavatory, urinal and toilet non-accessible. Other than at the men's restroom, most signage on this floor provided visual information but lacked tactile information (Braille and raised letters) needed by the visually

impaired. The copy room next to the toilet room was also identified with a non-accessible entry door, service counter and a lack of maneuvering space that would allow a wheelchair to enter the room, use the equipment and mailboxes and still be able to turn and exit the room. The women's restroom on the first floor was also historic in nature and lacked accessible fixtures. A recently installed pedestal based lavatory is not accessible due to the pedestal base that blocks wheelchair access and both toilet stalls are standard sized stalls not usable by people using wheelchairs or mobility assist devices. Shelves at the entry area protruding into the circulation route could create a protruding hazard.

An accessible low drinking fountain was located in the central corridor but the fountain created a protruding hazard as it was not located within an alcove. Faculty office spaces and conference rooms used for student meetings lacked accessible entry door hardware, operating force where closers were installed, accessible signage, view panels usable by short people and the spaces lacked maneuvering clearance within the space to allow wheelchair users to participate in meetings. The clear floor space needed to enable use of whiteboards and chalkboards was blocked by furniture or stored items in some locations and the spaces generally lacked accessible light switches and outlets, accessible desks, computer workstations, coat racks and strobe devices. Where sinks were provided, access for wheelchair users and short people was not available. Light switches, and fire pulls throughout the building are located above accessible reach ranges and electrical panels or other elements protruded into the circulation path in corridors throughout the building. Fire pull devices were also identified at non-accessible mounting height and with operating controls that were not fist-operable. Benches in corridors, classrooms and dance studios were not identified with accessible seat height or depth.

#### SECOND FLOOR

The second floor was found to have the same barriers in the exit stairways, elevator and classroom 205 as identified above in similar spaces. Classroom 205 and the Skylight Activity Room were identified with non-accessible balcony doors leading to a functional balcony space. No restrooms were identified on the second floor. The Dean's Conference Room 210 was identified with non-accessible entry doors, light switches and outlets, a non-accessible podium and conference tables (11 tables combined in center of room). There was also no portable assistive listening system identified in the room and no strobe device was identified. The Dean's Activity Room was also identified with similar barriers but a kitchenette in this space was also found have non-accessible counters, a sink and lacked maneuvering clearance necessary to allow a wheelchair to enter, turn around and exit the room.

A single drinking fountain unit was identified in the second floor lobby that could serve people with bending and stooping injuries, but those of short stature and wheelchair users would not be able to make use of a high fountain bubbler. This drinking fountain was also not located in an alcove or provided with wing walls, which created a particularly serious protruding hazard directly around a corner from the central stairway (see photo at left). Also, no ISA sign was provided to direct people to the low (wheelchair accessible) fountain provided on floor 1.

The central corridor was also identified with barriers similar to those noted above for common use areas although a fixed bench was provided on the second floor central corridor, which was identified with non-accessible seat height or depth. Other barriers were identified in the corridor included non-accessible electrical switches and outlets, fire extinguisher cabinets, fire pulls, a lack of strobes where horns connected to the fire alarm system were provided. The following barrier data records provide more detailed information on the barriers described above.





Field Date:	7/14/2011 Report Date 7/14/2011 Barrier #: 2271A
Bldg Name:	Women's Building Exterio Reference Dwg: 1 of 6
Location:	Exterior - East Stairway Entry
X Coordinate:	7477670.44 Y Coordinate: 340255.559
Barrier Area:	Signage
Barrier Type:	ISA - Non-Accessible Entry
Code References:	2010 ADAS 216.6
Performance Sta	andard: No Quantity: EACH As-built : 0
Barrier Description:	Sign directing people to accessible entrance needed where all doors are not accessible
Findings:	Accessible sign not provided within walkway indicating location of accessible ramp/entry
Rec. Solution:	Provide ISA directional sign with arrow directing people to accessible entrance
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
	ISA signage in location within walkway that can help ensure that pedestrians are not forced to their steps
Field Date:	7/14/2011 Report Date 7/14/2011 Barrier #: 2271B
Bldg Name:	Women's Building Exterio Reference Dwg: 1 of 6
Location:	Exterior - East Stairway Entry
X Coordinate:	7477670.44 Y Coordinate: 340255.559
Barrier Area:	Stairways
Barrier Type:	Contrasting Color - ADA
Code References:	2010 ADAS Advisory 504.4
Performance Sta	andard: Yes Quantity: LF or TR As-built: 0
Barrier Description:	No contrasting color on each tread of exterior stairway
	The contrasting color on each tread of exterior stall way
Findings:	No contrasting color provided
Findings: Rec. Solution:	
_	No contrasting color provided  Consider providing contrasting color on each tread
Rec. Solution:	No contrasting color provided  Consider providing contrasting color on each tread  Recommended Cost Est \$0.00 Facility Function: Public Status: Open



Field Date:	7/14/2011 Report Date 7/14/2011 Barrier #: 2271C
Bldg Name:	Women's Building Exterio Reference Dwg: 1 of 6
Location:	Exterior - East Stairway Entry
X Coordinate:	7477670.44 Y Coordinate: 340255.559
Barrier Area:	Stairways
Barrier Type:	Handrail - Both Sides
Code References:	2010 ADAS 505.10.2
Performance Sta	andard: No Quantity: LF As-built: 0
Barrier Description:	No handrail provided at both sides of stairway
Findings:	No handrail provided at both sides
Rec. Solution:	Provide accessible handrails at both sides of stairway
Barrier Severity:	2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes:	
Field Date:	7/14/2011 Report Date 7/14/2011 Barrier #: 2271D
Bldg Name:	Women's Building Exterio Reference Dwg: 1 of 6
Location:	Exterior - East Stairway Entry
X Coordinate:	7477670.44 Y Coordinate: 340255.559
Barrier Area:	Stairways
Barrier Type:	Handrail Extension - Bottom
Code References:	2010 ADAS 505.10.3
Performance Sta	andard: No Quantity: LF As-built : 0
Barrier Description:	Bottom handrail extension not sloped for length of one tread
Findings:	Bottom handrail extension not sloped for length of one tread
Rec. Solution:	Provide accessible handrails at both sides of stairway
Barrier Severity:	2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	12 Hecommended 3000 Joseph Marine, 17 doller 3000 Joseph
implementation	Priority: 1 Implementation Phase: Implementation Date:




Field Date:	7/14/2011 Report Date 7/14/2011 Barrier #: 2271E
Bldg Name:	Women's Building Exterio Reference Dwg: 1 of 6
Location:	Exterior - East Stairway Entry
X Coordinate:	7477670.44 Y Coordinate: 340255.559
Barrier Area:	Stairways
Barrier Type:	Handrail - Intermediate
Code References:	Performance Standard
Performance Sta	ndard: Yes Quantity: LF As-built: 0
Barrier Description:	Stairway more than 88" in width lacks at least one intermediate handrail for each 88" of requried width
Findings:	No intermediate handrail provided where stairway is more than 88" wide
Rec. Solution:	Provide one intermediate handrail per 88" stairway clear width
Barrier Severity:	2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes:	
Field Date:	7/14/2011 Report Date 7/14/2011 Barrier #: 2272
Bldg Name:	Women's Building Exterio Reference Dwg: 1 of 6
Location:	Exterior - East Stairway Entry
X Coordinate:	7477640.511 Y Coordinate: 340251.566
Barrier Area:	Doors or Gates
Barrier Type:	Abrupt Change in Level
Code References:	2010 ADAS 303.3
Performance Sta	ndard: No Quantity: LF As-built : 0
Barrier Description:	Change in level greater than 1/2" leading to door
Findings:	3" lip
Rec. Solution:	Grind or repair to remove trip hazard
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation Priority: 1 Implementation Phase: Implementation Date:	
Notes:	



Field Date:	7/14/2011 Report Date 7/14/2011 Barrier #: 2274A
Bldg Name:	Women's Building Exterio Reference Dwg: 1 of 6
Location:	Exterior - South Entry
X Coordinate:	7477620.589 Y Coordinate: 340137.521
Barrier Area:	Signage
Barrier Type:	ISA - Non-Accessible Entry
Code References:	2010 ADAS 216.6
Performance Sta	ndard: No Quantity: EACH As-built : 0
Barrier Description:	Sign directing people to accessible entrance needed where all doors are not accessible
Findings:	Accessible sign not provided within walkway indicating location of accessible ramp/entry
Rec. Solution:	Provide ISA directional sign with arrow directing people to accessible entrance
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
	ISA signage in location within walkway along SW @6th Street that can help ensure that ians are not forced to retrace their steps
Field Date:	7/14/2011 Report Date 7/14/2011 Barrier #: 2274B
Bldg Name:	Women's Building Exterio Reference Dwg: 1 of 6
Location:	Exterior - South Entry
X Coordinate:	7477620.589 Y Coordinate: 340137.521
Barrier Area:	Doors or Gates
Barrier Type:	Door/Gate Landing - Existing (3.1% to 4.0%)
Code References:	2010 ADAS 404.2.4.4
Performance Sta	indard: No Quantity: SF As-built : 0
Barrier Description:	Door or gate lacks landing on both sides of door
Findings:	2.7%
Rec. Solution:	Demolish and reconstruct level landing
Barrier Severity:	3 Hindrance Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Disprise Landon contaction Disprise Landon Conta
	Priority: 1 Implementation Phase: Implementation Date:



Field Date:	7/14/2011 Report Date 7/14/2011 Barrier #: 2267
Bldg Name:	Women's Building Exterio Reference Dwg: 1 of 6
Location:	Exterior - North Accessible Ramp Entry
X Coordinate:	7477628.095 Y Coordinate: 340408.167
Barrier Area:	Ramps
Barrier Type:	Edge Protection - Wheel Guides
Code References:	2010 ADAS 405.9
Performance Sta	andard: No Quantity: LF As-built : 0
Barrier Description:	No wheel guides where the ramp surface is not bounded by a wall
Findings:	Footing at handrail posts creates an abrupt change in level along wheelguide
Rec. Solution:	Alter wheel guide to provide smooth uninterrupted surface along ramp edge
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes:	
Field Date:	7/14/2011 Report Date 7/14/2011 Barrier #:
Bldg Name:	Women's Building Reference Dwg:
Location:	
X Coordinate:	Y Coordinate:
Barrier Area:	
Barrier Type:	
Code References:	
Performance Sta	ndard: Quantity: As-built :
Barrier Description:	
Findings:	
Rec. Solution:	
Barrier Severity:	Cost Est Facility Function: Status:
Implementation	Priority: Implementation Phase: Implementation Date:
Notes: Barrier r	record intentionally left blank to facilitate printing

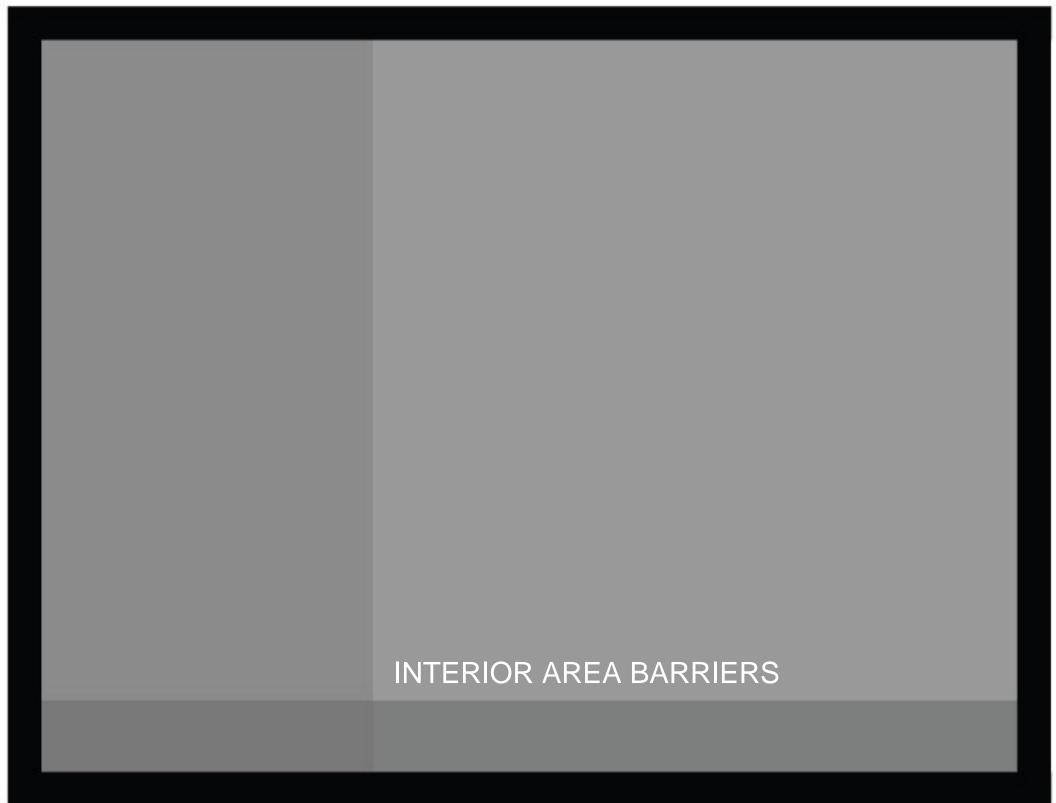



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 1A
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Accessible Entrance North
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Automatic Doors - Timing
Code References:	2010 ADAS 404.3
Performance Sta	ndard: No Quantity: JOB As-built : 1
Barrier Description:	Door does not remain open for at least 6 seconds
Findings:	Door closes after 5 seconds
Rec. Solution:	Repair actuation device
Barrier Severity:	1 Necessary Cost Est \$1,250.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes:	
Field Date	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 1B
Bldg Name:	2/24/2014   Report Date  2/27/2014   Barrier #:  1B
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Bldg Name: Location:	Women's Building Reference Dwg: 2 of 6  Basement - Accessible Entrance North
Bldg Name: Location: X Coordinate:	Women's Building Reference Dwg: 2 of 6  Basement - Accessible Entrance North  N/A Y Coordinate: N/A
Bldg Name: Location: X Coordinate: Barrier Area:	Women's Building Reference Dwg: 2 of 6  Basement - Accessible Entrance North  N/A Y Coordinate: N/A  Doors or Gates
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code	Women's Building Reference Dwg: 2 of 6  Basement - Accessible Entrance North  N/A Y Coordinate: N/A  Doors or Gates  Recessed Door - Pull Side  2010 ADAS 404.2.4.3
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Women's Building Reference Dwg: 2 of 6  Basement - Accessible Entrance North  N/A Y Coordinate: N/A  Doors or Gates  Recessed Door - Pull Side  2010 ADAS 404.2.4.3
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Women's Building Reference Dwg: 2 of 6  Basement - Accessible Entrance North  N/A Y Coordinate: N/A  Doors or Gates  Recessed Door - Pull Side  2010 ADAS 404.2.4.3  andard: No Quantity: EACH As-built: 0
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance State Barrier Description:	Women's Building Reference Dwg: 2 of 6  Basement - Accessible Entrance North  N/A Y Coordinate: N/A  Doors or Gates  Recessed Door - Pull Side  2010 ADAS 404.2.4.3  Indard: No Quantity: EACH As-built: 0  Door recessed by more than 8" lacks at least 18" clearance at pull side of door
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Women's Building  Reference Dwg: 2 of 6  Basement - Accessible Entrance North  N/A  Y Coordinate: N/A  Doors or Gates  Recessed Door - Pull Side  2010 ADAS 404.2.4.3  andard: No Quantity: EACH As-built: 0  Door recessed by more than 8" lacks at least 18" clearance at pull side of door  3" strike edge clearance at a recess of 21-1/3"  Automatic door opening device provided. No remediation recommended
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Women's Building  Reference Dwg: 2 of 6  Basement - Accessible Entrance North  N/A  Y Coordinate: N/A  Doors or Gates  Recessed Door - Pull Side  2010 ADAS 404.2.4.3  Indard: No Quantity: EACH As-built: 0  Door recessed by more than 8" lacks at least 18" clearance at pull side of door  3" strike edge clearance at a recess of 21-1/3"  Automatic door opening device provided. No remediation recommended  4 Low Severity Cost Est \$0.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 1C
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Accessible Entrance North
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Doormat (\$250/2014 15:39)
Code References:	2010 ADAS 302.2 & Advisory 302.2
Performance Sta	andard: No Quantity: EACH As-built : 2
Barrier Description:	Doormat not anchored to floor (possible trip hazard)
Findings:	Doormats not secured
Rec. Solution:	Secure exiting doormats or replace
Barrier Severity:	1 Necessary Cost Est \$1,000.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 1D
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Accessible Entrance North
Location: X Coordinate:	Basement - Accessible Entrance North   N/A   Y Coordinate:   N/A
X Coordinate:	N/A Y Coordinate: N/A  Signage  Tactile Exit Signs - Door
X Coordinate: Barrier Area:	N/A Y Coordinate: N/A Signage
X Coordinate: Barrier Area: Barrier Type: Code	N/A Y Coordinate: N/A Signage Tactile Exit Signs - Door 2010 ADAS 216.4.1
X Coordinate: Barrier Area: Barrier Type: Code References:	N/A Y Coordinate: N/A Signage Tactile Exit Signs - Door 2010 ADAS 216.4.1
X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	N/A  Signage  Tactile Exit Signs - Door  2010 ADAS 216.4.1  andard: No Quantity: EACH As-built: 1
X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	N/A  Signage  Tactile Exit Signs - Door  2010 ADAS 216.4.1  andard: No Quantity: EACH As-built: 1  Ground floor doors that exit to exterior lacks tactile exit sign
X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	N/A  Signage  Tactile Exit Signs - Door  2010 ADAS 216.4.1  Indard: No Quantity: EACH As-built: 1  Ground floor doors that exit to exterior lacks tactile exit sign  Exit door with low level illuminated sign lacks tactile exit sign  Provide sign stating "EXIT" at exit side of door
X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	N/A  Signage  Tactile Exit Signs - Door  2010 ADAS 216.4.1  andard: No Quantity: EACH As-built: 1  Ground floor doors that exit to exterior lacks tactile exit sign  Exit door with low level illuminated sign lacks tactile exit sign  Provide sign stating "EXIT" at exit side of door  1 Necessary Cost Est \$250.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 2A
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Corridor H005
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Electrical Switches - Height
Code References:	2010 ADAS 308.2.1
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Light switch control box top edge not at max. 48" high
Findings:	54" high
Rec. Solution:	Relocate switch box top edge to max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 2B
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Corridor H005
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Corridors
Barrier Type:	Protruding Object
Code References:	2010 ADAS 307
Performance Sta	andard: No Quantity: EACH As-built : 2
Performance Sta Barrier Description:	Protruding object in in circulation path protrudes more than 4" between 27" and 80" high
Barrier	
Barrier Description:	Protruding object in in circulation path protrudes more than 4" between 27" and 80" high
Barrier Description: Findings:	Protruding object in in circulation path protrudes more than 4" between 27" and 80" high  Radiator and electrical panel protrude 5" - 10-1/4" at 28" - 40" high  Remove objects or provide detectable warning (wing walls)
Barrier Description: Findings: Rec. Solution:	Protruding object in in circulation path protrudes more than 4" between 27" and 80" high  Radiator and electrical panel protrude 5" - 10-1/4" at 28" - 40" high  Remove objects or provide detectable warning (wing walls)  1 Necessary Cost Est \$1,100.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 2C
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Corridor H005
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Corridors
Barrier Type:	Abrupt Change in Level
Code References:	2010 ADAS 303.3 02/24/2014 15:58
Performance Sta	andard: No Quantity: LF As-built : 2
Barrier Description:	Change in level greater than 1/2" leading in circulation path
Findings:	Drainage grate in center of hallway creates a hazard in accessible route
Rec. Solution:	Repair to remove trip hazard
Barrier Severity:	1 Necessary Cost Est \$500.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 2D
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Corridor H005
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Corridors
Barrier Type:	Sign - Lobby Info Sign
Code References:	Performance Standard
Performance Sta	andard: Yes Quantity: EACH As-built : 2
Barrier Description:	No lobby informational sign with location of accessible elements
Findings:	Accessible signs not provided
Rec. Solution:	Provide lobby informational signs
Barrier Severity:	1 Necessary Cost Est \$500.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 2E
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Corridor H005
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Corridors
Barrier Type:	Sign - Permanent Room/Space
Code References:	2010 ADAS 703.1
Performance Sta	ndard: No Quantity: EACH As-built: 3
Barrier Description:	No sign with raised characters and Braille at permanent room or space with visual sign
Findings:	No tactile info on signs with visual information
Rec. Solution:	Provide signs at latch side of entry door, where possible
Barrier Severity:	1 Necessary Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes: Rooms (	019, 022, 024
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 2F
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Corridor H005
X Coordinate:	N/A Y Coordinate: N/A 22
Barrier Area:	Signage
Barrier Type:	Location - Wall Space Lacking
Code References:	2010 ADAS 703.4.2
Performance Sta	ndard: No Quantity: EACH As-built: 1
Barrier Description:	No wall space provided at latch side of door for signge mounting
Findings:	Sign on hinge side of door
Rec. Solution:	Provide accessible sign and relocate sign to latch side of door
Barrier Severity:	1 Necessary Cost Est \$250.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
	2 Also, Braille on sign not located directly below tactile characters, sign containing Braille/tactile tered on 18" x 18" space beyond arc of door swing, and contracted (Grade 2) Braille not used on



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 2G
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Corridor H005
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Corridors
Barrier Type:	Horn/Strobe Device
Code References:	2010 ADAS 702.1
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	No horn or strobe in corridor where fire alarm exists in building
Findings:	No device provided
Rec. Solution:	Provide horn/strobe in common use area
Barrier Severity:	1 Necessary Cost Est \$5,500.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 3A
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Break Room 020
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	Permanent Room/Space - Tactile Characters
Code References:	2010 ADAS 216.2
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	At interior or exterior location, no tactile characters at sign identifying permanent rooms and spaces
Findings:	No tactile signage provided at door within public route
Rec. Solution:	Provide accessible sign at both entry doors
Barrier Severity:	1 Necessary Cost Est \$250.00 Facility Function: Public Status: Open
Implementation	
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 3B
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Break Room 020
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Door Closer - Interior Automatic Door
Code References:	2010 ADAS 404.2.9
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Door opening force exceeds 5 lbf
Findings:	14 lbf
Rec. Solution:	Provide automatic door opening device at min. 1 entry door and ISA directional sign at other
Barrier Severity:	1 Necessary Cost Est \$5,000.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 3C
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Break Room 020
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Dana Classa Curan Pariad
	Door Closer - Sweep Period
Code References:	2010 ADAS 404.2.8.1
Code	2010 ADAS 404.2.8.1
Code References:	2010 ADAS 404.2.8.1
Code References: Performance Sta Barrier	2010 ADAS 404.2.8.1 andard: No Quantity: EACH As-built: 0
Code References: Performance Sta Barrier Description: Findings:	2010 ADAS 404.2.8.1  andard: No Quantity: EACH As-built: 0  Door closer lacks min. 5 second sweep period
Code References: Performance Sta Barrier Description:	2010 ADAS 404.2.8.1  andard: No Quantity: EACH As-built: 0  Door closer lacks min. 5 second sweep period  3 second sweep  Provide automatic door opening device at min. 1 entry door and ISA directional sign at other
Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	2010 ADAS 404.2.8.1  andard: No Quantity: EACH As-built: 0  Door closer lacks min. 5 second sweep period  3 second sweep  Provide automatic door opening device at min. 1 entry door and ISA directional sign at other  2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open



Location: B	Vomen's Building Reference Dwg: 2 of 6
<u>-</u>	Tomen's Banang
X Coordinate: N	Basement - Break Room 020
_	I/A Y Coordinate: N/A
Barrier Area: D	Doors or Gates
Barrier Type: H	lardware - Operation
Code References:	010 ADAS 404.2.7
Performance Stand	dard: No Quantity: EACH As-built : 1
Barrier Description:	lardware not operable with a closed fist
Findings:	lardware not operable with a closed fist
Rec. Solution: P	rovide new hardware
Barrier Severity:	1 Necessary Cost Est \$300.00 Facility Function: Public Status: Open
Implementation Pr	riority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date: 2,	/24/2014 Report Date 2/27/2014 Barrier #: 3E
	/24/2014 Report Date 2/27/2014 Barrier #: 3E  Vomen's Building Reference Dwg: 2 of 6
Bldg Name: W	
Bldg Name: W	Vomen's Building Reference Dwg: 2 of 6
Bldg Name: W Location: B X Coordinate: N	Vomen's Building Reference Dwg: 2 of 6 assement - Break Room 020
Bldg Name: W Location: B X Coordinate: N Barrier Area: D	Vomen's Building Reference Dwg: 2 of 6  Basement - Break Room 020  I/A Y Coordinate: N/A  Poors or Gates  Vision Lights - Existing
Bldg Name: W Location: B X Coordinate: N Barrier Area: D Barrier Type: V	Vomen's Building Reference Dwg: 2 of 6  Basement - Break Room 020  I/A Y Coordinate: N/A  Doors or Gates
Bldg Name: W Location: B X Coordinate: N Barrier Area: D Barrier Type: V Code 2	Vomen's Building Reference Dwg: 2 of 6  Passement - Break Room 020  I/A Y Coordinate: N/A  Poors or Gates  Vision Lights - Existing  1010 ADAS 404.2.11
Bldg Name: W Location: B X Coordinate: N Barrier Area: D Barrier Type: V Code References: Performance Stand	Vomen's Building Reference Dwg: 2 of 6  Passement - Break Room 020  I/A Y Coordinate: N/A  Poors or Gates  Vision Lights - Existing  1010 ADAS 404.2.11
Bldg Name: W Location: B X Coordinate: N Barrier Area: D Barrier Type: V Code 20 References: Performance Stand Barrier V Description:	Vomen's Building Reference Dwg: 2 of 6  Passement - Break Room 020  I/A Y Coordinate: N/A  Poors or Gates  Vision Lights - Existing  O10 ADAS 404.2.11  Clard: No Quantity: EACH As-built: 1
Bldg Name: W Location: B X Coordinate: N Barrier Area: D Barrier Type: V Code References: Performance Stand Barrier Description: V Findings:	Nomen's Building  Reference Dwg: 2 of 6  Rasement - Break Room 020  I/A  Y Coordinate: N/A  Poors or Gates  Vision Lights - Existing  O10 ADAS 404.2.11  Clard: No Quantity: EACH As-built: 1  View panels in or adjacent to doors or gates not max. 43" above floor or ground
Bldg Name: W Location: B X Coordinate: N Barrier Area: D Barrier Type: V Code References: Performance Stand Barrier Description: V Findings: Rec. Solution: R	Nomen's Building  Reference Dwg: 2 of 6  Rasement - Break Room 020  R/A  Y Coordinate: N/A  Poors or Gates  Vision Lights - Existing  010 ADAS 404.2.11  Clard: No Quantity: EACH As-built: 1  View panels in or adjacent to doors or gates not max. 43" above floor or ground  View panel located higher than 43" above the floor
Bldg Name: W Location: B X Coordinate: N Barrier Area: D Barrier Type: V Code References: Performance Stand Barrier Description: V Findings: Rec. Solution: R	Nomen's Building Reference Dwg: 2 of 6  Rasement - Break Room 020  I/A Y Coordinate: N/A  Poors or Gates  Pision Lights - Existing  O10 ADAS 404.2.11  Idard: No Quantity: EACH As-built: 1  Piew panels in or adjacent to doors or gates not max. 43" above floor or ground  Piew panel located higher than 43" above the floor  Replace door/gate or vision panel  3 Hindrance Cost Est \$2,250.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 3F
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Break Room 020
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Door 10" Bottom Surface - Door Stop
Code References:	2010 ADAS 404.2.10
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Door stop interrupts min. 10" smooth bottom surface
Findings:	Door stop at bottom of door can create trapping condition
Rec. Solution:	Remove door stop or any other element within bottom 10" of door
Barrier Severity:	1 Necessary Cost Est \$75.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 3G
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Break Room 020
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Recessed Door - Push Side
Code	WEI 24 104 1
References:	2010 ADAS 404.2.4.3
References:	
References: Performance Sta Barrier	andard: No Quantity: EACH As-built : 0
References: Performance Sta Barrier Description:	andard: No Quantity: EACH As-built: 0  Door recessed by more than 8" lacks at least 12" clearance at push side of door
References: Performance Sta Barrier Description: Findings:	Door recessed by more than 8" lacks at least 12" clearance at push side of door  11-3/4" deep  Provide automatic door opening device at min. 1 entry door and ISA directional sign at other
References: Performance Sta Barrier Description: Findings: Rec. Solution:	Door recessed by more than 8" lacks at least 12" clearance at push side of door  11-3/4" deep  Provide automatic door opening device at min. 1 entry door and ISA directional sign at other  1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 3
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Break Room 020
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Electrical Switches - Height
Code References:	2010 ADAS 308.2.1
Performance Sta	andard: No Quantity: EACH As-built: 1
Barrier Description:	Light switch control box top edge not at max. 48" high
Findings:	51-1/3" high
Rec. Solution:	Relocate switch box top edge to max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 3J
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Break Room 020
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Electrical Outlets - Hi/Low Reach
Code References:	2010 ADAS 308.2.2
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Use of outlet involves low reach of less than 15" above floor or more than 48" high
Findings:	11-3/4" high
Rec. Solution:	Relocate outlet to area at min. 15" or max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 3K
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Break Room 020
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Counters and Tables
Barrier Type:	Counter - Surface Height
Code References:	2010 ADAS 902.3
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	No section at least 3 feet long between 28" and 34" provided at existing counter
Findings:	36" high counter at kitchenette
Rec. Solution:	Provide min. 3 ft long section of counter at max. 34" high
Barrier Severity:	3 Hindrance Cost Est \$875.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 3L
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Break Room 020
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Sink - Rim or Countertop
Code References:	2010 ADAS 606.3
Performance Sta	indard: No Quantity: LF As-built: 3
Barrier Description:	No accessible section of counter at max 34" high provided
Findings:	Sink rim 36" high
Rec. Solution:	Reposition existing sink or provide additional sink for use in area
Barrier Severity:	1 Necessary Cost Est \$1,110.00 Facility Function: Public Status: Open
Implementation	, , , , , , , , , , , , , , , , , , , ,



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 3M
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Break Room 020
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Sink - Depth
Code References:	Performance Standard
Performance Sta	ndard: Yes Quantity: EACH As-built : 1
Barrier Description:	Sink depth exceeds 6-1/2" deep
Findings:	11-1/4" deep
Rec. Solution:	Replace sink
Barrier Severity:	1 Necessary Cost Est \$450.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Papart Data 2/27/2014 Parrier #: 2N
i ieiu Date.	2/24/2014   Report Date  2/27/2014   Barrier #:  3N
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Bldg Name: Location:	Women's Building Reference Dwg: 2 of 6  Basement - Break Room 020
Bldg Name: Location: X Coordinate:	Women's Building Reference Dwg: 2 of 6  Basement - Break Room 020  N/A Y Coordinate: N/A  Classrooms  Sink - Knee Clearance
Bldg Name: Location: X Coordinate: Barrier Area:	Women's Building Reference Dwg: 2 of 6  Basement - Break Room 020  N/A Y Coordinate: N/A  Classrooms
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code	Women's Building Reference Dwg: 2 of 6  Basement - Break Room 020  N/A Y Coordinate: N/A  Classrooms  Sink - Knee Clearance  2010 ADAS 606.2 & 306
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Women's Building Reference Dwg: 2 of 6  Basement - Break Room 020  N/A Y Coordinate: N/A  Classrooms  Sink - Knee Clearance  2010 ADAS 606.2 & 306
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Women's Building Reference Dwg: 2 of 6  Basement - Break Room 020  N/A Y Coordinate: N/A  Classrooms  Sink - Knee Clearance  2010 ADAS 606.2 & 306  Indard: No Quantity: EACH As-built: 0
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Women's Building Reference Dwg: 2 of 6  Basement - Break Room 020  N/A Y Coordinate: N/A  Classrooms  Sink - Knee Clearance  2010 ADAS 606.2 & 306  Indard: No Quantity: EACH As-built: 0  Knee clearance of at least 27" high, 30" wide and 8" deep not provided underneath sink
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Women's Building  Reference Dwg: 2 of 6  Basement - Break Room 020  N/A  Y Coordinate: N/A  Classrooms  Sink - Knee Clearance  2010 ADAS 606.2 & 306  Indard: No Quantity: EACH As-built: 0  Knee clearance of at least 27" high, 30" wide and 8" deep not provided underneath sink  No knee clearance  Replace cabinet and remount sink
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Women's Building Reference Dwg: 2 of 6  Basement - Break Room 020  N/A Y Coordinate: N/A  Classrooms  Sink - Knee Clearance  2010 ADAS 606.2 & 306  Indard: No Quantity: EACH As-built: 0  Knee clearance of at least 27" high, 30" wide and 8" deep not provided underneath sink  No knee clearance  Replace cabinet and remount sink  I Necessary Cost Est \$0.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 30
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Break Room 020
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Actuator or Control - Obstructed Reach
Code References:	2010 ADAS 305.3
Performance Sta	ndard: No Quantity: EACH As-built : 2
Barrier Description:	Control or mechanism not at max. 44" over an obstruction of max. 25"
Findings:	Paper towel dispenser and electrical outlets 29" deep over an obstruction 36" high
Rec. Solution:	Relocate controls or mechanisms to max. 44" high
Barrier Severity:	3 Hindrance Cost Est \$1,500.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: Paper to	owel dispenser and electrical outlets behind sink
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 3P
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Break Room 020
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Workstation - Knee Clearance
Code References:	2010 ADAS 902
Performance Sta	indard: No Quantity: EACH As-built : 1
Barrier Description:	Knee clearance of at least 27" high, 30" wide and 8" deep not provided
Findings:	26-5/8" high at fixed workstation
Rec. Solution:	Reposition workstation to provide knee clearance
Barrier Severity:	1 Necessary Cost Est \$875.00 Facility Function: Public Status: Open
Implementation	
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 3Q
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Break Room 020
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Shelves or Cabinets
Code References:	2010 ADAS 603.4
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Shelf or cabinet not mounted between 40" and 48" above floor or ground
Findings:	Shelf or cabinets not accessible
Rec. Solution:	Provide additional shelf at accessible height or provide assistance
Barrier Severity:	2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: Above 4	8"
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 3R
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Break Room 020
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Alarm - Horn/Strobe
Code References:	2010 ADAS 702.1
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Where a fire alarm is installed, no horn/strobe provided
Findings:	No device provided
Rec. Solution:	Provide horn/stobe
Barrier Severity:	1 Necessary Cost Est \$5,500.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 4A
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Grad Student Office 021/021A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	Permanent Room/Space - Tactile Characters
Code References:	2010 ADAS 216.2
Performance Sta	ndard: No Quantity: EACH As-built: 1
Barrier Description:	No tactile characters at sign identifying permanent rooms and spaces with visual signs
Findings:	No tactile signage provided at door within public route
Rec. Solution:	Provide accessible sign
Barrier Severity:	1 Necessary Cost Est \$250.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes: Room 0	21A
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 4B
Field Date: Bldg Name:	2/24/2014 Report Date 2/27/2014 Barrier #: 4B Women's Building Reference Dwg: 2 of 6
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Bldg Name: Location:	Women's Building Reference Dwg: 2 of 6  Basement - Grad Student Office 021/021A
Bldg Name: Location: X Coordinate:	Women's Building Reference Dwg: 2 of 6  Basement - Grad Student Office 021/021A  N/A Y Coordinate: N/A  Doors or Gates  Front App/push 12" SEC
Bldg Name: Location: X Coordinate: Barrier Area:	Women's Building Reference Dwg: 2 of 6  Basement - Grad Student Office 021/021A  N/A Y Coordinate: N/A  Doors or Gates
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code	Women's Building Reference Dwg: 2 of 6  Basement - Grad Student Office 021/021A  N/A Y Coordinate: N/A  Doors or Gates  Front App/push 12" SEC  2010 ADAS Figure 404.2.4.1
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Women's Building Reference Dwg: 2 of 6  Basement - Grad Student Office 021/021A  N/A Y Coordinate: N/A  Doors or Gates  Front App/push 12" SEC  2010 ADAS Figure 404.2.4.1
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Women's Building Reference Dwg: 2 of 6  Basement - Grad Student Office 021/021A  N/A Y Coordinate: N/A  Doors or Gates  Front App/push 12" SEC  2010 ADAS Figure 404.2.4.1  ndard: No Quantity: ADMINI As-built: 1
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Women's Building Reference Dwg: 2 of 6  Basement - Grad Student Office 021/021A  N/A Y Coordinate: N/A  Doors or Gates  Front App/push 12" SEC  2010 ADAS Figure 404.2.4.1  ndard: No Quantity: ADMINI As-built: 1  Door/Gate at push side with min. 48" lacks min. 12" strike edge clearance with latch/closer
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Women's Building Reference Dwg: 2 of 6  Basement - Grad Student Office 021/021A  N/A Y Coordinate: N/A  Doors or Gates  Front App/push 12" SEC  2010 ADAS Figure 404.2.4.1  ndard: No Quantity: ADMINI As-built: 1  Door/Gate at push side with min. 48" lacks min. 12" strike edge clearance with latch/closer  Trash can and refrigerator block strike edge clearance
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Women's Building  Reference Dwg: 2 of 6  Basement - Grad Student Office 021/021A  N/A Y Coordinate: N/A  Doors or Gates  Front App/push 12" SEC  2010 ADAS Figure 404.2.4.1  ndard: No Quantity: ADMINI As-built: 1  Door/Gate at push side with min. 48" lacks min. 12" strike edge clearance with latch/closer  Trash can and refrigerator block strike edge clearance  Remove stored item  1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 4C
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Grad Student Office 021/021A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Chalkboard/Whiteboard - Area of Use
Code References:	Performance Standard & 2010 ADAS 904.3.3
Performance Sta	ndard: Yes Quantity: EACH As-built: 1
Barrier Description:	Bottom edge of writing surface not max. 38" high
Findings:	Lower edge of writing surface 69" high from floor
Rec. Solution:	Remount whiteboard/chalkboard or provide alternate for use by short people
Barrier Severity:	3 Hindrance Cost Est \$1,200.00 Facility Function: Public Status: Open
Implementation	· —
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 4D
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Grad Student Office 021/021A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Electrical Switches - Height
Code References:	2010 ADAS 308.2.1
Performance Sta	ndard: No Quantity: EACH As-built: 1
Barrier Description:	Light switch control box top edge not at max. 48" high
Findings:	51" high
Rec. Solution:	Relocate switch box top edge to max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 4E
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Grad Student Office 021/021A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Shelves or Cabinets
Code References:	2010 ADAS 603.4
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Shelf or cabinet not mounted between 40" and 48" above floor or ground
Findings:	Shelf or cabinet not accessible
Rec. Solution:	Provide additional shelf at accessible height or provide assistance
Barrier Severity:	2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: Above 4	18"
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 4F
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Grad Student Office 021/021A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Alarms
Barrier Type:	Horn/Strobe
Code References:	2010 ADAS 702.1
Performance Sta	andard: No Quantity: EACH As-built : 2
Barrier Description:	No horn/strobes in common use areas
Findings:	No device provided
Rec. Solution:	
	Provide strobes in common use area
Barrier Severity:	
	1 Necessary Cost Est \$11,000.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 5A
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Corridor H002 / H003 / H004
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	Visual Information Provided (Exhibitions)
Code References:	ADA Title II Technical Assistance Manual 3.2000 Denial of participation
Performance Sta	ndard: No Quantity: JOB As-built : 1
Barrier Description:	Visual sign providing information for program, service or activity not accessible
Findings:	Accessible sign not provided
Rec. Solution:	Provide information in alternate format to provide access to people with vision impairments
Barrier Severity:	1 Necessary Cost Est \$5,000.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 5B
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Corridor H002 / H003 / H004
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Corridors
Barrier Type:	Sign - Lobby Info Sign
Code References:	Performance Standard
Performance Sta	ndard: Yes Quantity: EACH As-built : 1
Barrier Description:	No lobby informational sign with location of accessible elements
Findings:	Accessible sign not provided
Rec. Solution:	Provide lobby informational sign
Barrier Severity:	1 Necessary Cost Est \$250.00 Facility Function: Public Status: Open
Implementation	
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 5C
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Corridor H002 / H003 / H004
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Corridors
Barrier Type:	Electrical Switches - Max. 48" High
Code References:	2010 ADAS 308.2.1
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Light switch control box top edge not at max. 48" high
Findings:	49" high
Rec. Solution:	Relocate switch box top edge to max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 5D
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Corridor H002 / H003 / H004
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Corridors
Barrier Type:	Horn/Strobe Device
Code References:	2010 ADAS 702.1
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	No horn or strobe in corridor where fire alarm exists in building
Findings:	No device provided
Rec. Solution:	
nec. Joidtion.	Provide horn/strobe in common use area
Barrier Severity:	
	1 Necessary Cost Est \$5,500.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 5E
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Corridor H002 / H003 / H004
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Corridors
Barrier Type:	Sign - Tactile Exit Sign at Door
Code References:	2010 ADAS 216.4.1
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Ground floor doors that exit directly to the exterior lacks tactile exit sign
Findings:	Accessible sign not provided
Rec. Solution:	Provide new sign stating "EXIT" at exiting side of vestibule door
Barrier Severity:	1 Necessary Cost Est \$250.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 5F
	2/24/2014   Report Date   2/27/2014   Barrier #:   5F   Women's Building   Reference Dwg:   2 of 6
Bldg Name:	
Bldg Name: Location:	Women's Building Reference Dwg: 2 of 6
Bldg Name: Location: X Coordinate:	Women's Building Reference Dwg: 2 of 6  Basement - Corridor H002 / H003 / H004
Field Date: Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type:	Women's Building Reference Dwg: 2 of 6  Basement - Corridor H002 / H003 / H004  N/A Y Coordinate: N/A  Doors or Gates  Door 10" Bottom Surface - Door Stop
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code	Women's Building Reference Dwg: 2 of 6  Basement - Corridor H002 / H003 / H004  N/A Y Coordinate: N/A  Doors or Gates
Bldg Name: Location: X Coordinate: Barrier Area:	Women's Building Reference Dwg: 2 of 6  Basement - Corridor H002 / H003 / H004  N/A Y Coordinate: N/A  Doors or Gates  Door 10" Bottom Surface - Door Stop  2010 ADAS 404.2.10
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Women's Building Reference Dwg: 2 of 6  Basement - Corridor H002 / H003 / H004  N/A Y Coordinate: N/A  Doors or Gates  Door 10" Bottom Surface - Door Stop  2010 ADAS 404.2.10
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Women's Building Reference Dwg: 2 of 6  Basement - Corridor H002 / H003 / H004  N/A Y Coordinate: N/A  Doors or Gates  Door 10" Bottom Surface - Door Stop  2010 ADAS 404.2.10  ndard: No Quantity: EACH As-built: 1
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance State Barrier Description:	Women's Building Reference Dwg: 2 of 6  Basement - Corridor H002 / H003 / H004  N/A Y Coordinate: N/A  Doors or Gates  Door 10" Bottom Surface - Door Stop  2010 ADAS 404.2.10  ndard: No Quantity: EACH As-built: 1  Door stop interrupts min.10" smooth bottom surface
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Women's Building Reference Dwg: 2 of 6  Basement - Corridor H002 / H003 / H004  N/A Y Coordinate: N/A  Doors or Gates  Door 10" Bottom Surface - Door Stop  2010 ADAS 404.2.10  mdard: No Quantity: EACH As-built: 1  Door stop interrupts min.10" smooth bottom surface  Door stop at bottom of door can create trapping condition  Remove door stop or any other element within bottom 10" of door
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Women's Building  Reference Dwg: 2 of 6  Basement - Corridor H002 / H003 / H004  N/A Y Coordinate: N/A  Doors or Gates  Door 10" Bottom Surface - Door Stop  2010 ADAS 404.2.10  ndard: No Quantity: EACH As-built: 1  Door stop interrupts min.10" smooth bottom surface  Door stop at bottom of door can create trapping condition  Remove door stop or any other element within bottom 10" of door  1 Necessary Cost Est \$75.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 6A
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Vestibule V001
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Protruding Object
Code References:	2010 ADAS 307
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Protruding object in in circulation path protrudes more than 4" between 27" and 80" high
Findings:	Pipe and radiator protrude 5" at 23-1/2" high
Rec. Solution:	Remove object or provide detectable warning (wing walls)
Barrier Severity:	1 Necessary Cost Est \$550.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
	nd radiator protrude on either side of the door. Automatic door opening device negates need de min. 12" strike edge clearance.
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 6B
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Vestibule V001
	pasement - vestibule voor
X Coordinate:	N/A Y Coordinate: N/A
X Coordinate: Barrier Area:	
	N/A Y Coordinate: N/A  Doors or Gates  Automatic Doors - Reopening
Barrier Area:	N/A Y Coordinate: N/A  Doors or Gates
Barrier Area: Barrier Type: Code	N/A Y Coordinate: N/A  Doors or Gates  Automatic Doors - Reopening  Performance Standard & 2010 ADAS 404.2.9
Barrier Area: Barrier Type: Code References:	N/A Y Coordinate: N/A  Doors or Gates  Automatic Doors - Reopening  Performance Standard & 2010 ADAS 404.2.9
Barrier Area: Barrier Type: Code References: Performance Sta	N/A  Y Coordinate: N/A  Doors or Gates  Automatic Doors - Reopening  Performance Standard & 2010 ADAS 404.2.9  Indard: Yes Quantity: JOB As-built: 1
Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	N/A  Poors or Gates  Automatic Doors - Reopening  Performance Standard & 2010 ADAS 404.2.9  Indard: Yes Quantity: JOB As-built: 1  Automatic doors do not remain open for at least 6 seconds
Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	N/A    Doors or Gates
Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	N/A   Y Coordinate: N/A   Doors or Gates   Automatic Doors - Reopening   Performance Standard & 2010 ADAS 404.2.9   Indard: Yes   Quantity: JOB   As-built : 1   Automatic doors do not remain open for at least 6 seconds   Stays open for 5 seconds



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 6C
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Vestibule V001
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Corridors
Barrier Type:	Door Mat
Code References:	2010 ADAS 302.2 & Advisory 302.2
Performance Sta	andard: No Quantity: EACH As-built : 3
Barrier Description:	Recessed doormat not anchored to floor (possible trip hazard)
Findings:	Doormats not secured
Rec. Solution:	Replace doormats
Barrier Severity:	1 Necessary Cost Est \$1,500.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: One at t	the door and 2 leading into corridor H002 / H003 / H004
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 6D
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	
	Basement - Vestibule V001
X Coordinate:	Basement - Vestibule V001
X Coordinate: Barrier Area:	
	N/A Y Coordinate: N/A  Corridors  Sign - Tactile Exit Sign at Door
Barrier Area:	N/A Y Coordinate: N/A Corridors
Barrier Area: Barrier Type: Code	N/A Y Coordinate: N/A  Corridors  Sign - Tactile Exit Sign at Door  2010 ADAS 216.4.1
Barrier Area: Barrier Type: Code References:	N/A Y Coordinate: N/A  Corridors  Sign - Tactile Exit Sign at Door  2010 ADAS 216.4.1
Barrier Area: Barrier Type: Code References: Performance Sta Barrier	N/A  Y Coordinate: N/A  Corridors  Sign - Tactile Exit Sign at Door  2010 ADAS 216.4.1  Indard: No Quantity: EACH As-built: 1
Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	N/A  Y Coordinate: N/A  Corridors  Sign - Tactile Exit Sign at Door  2010 ADAS 216.4.1  Indard: No Quantity: EACH As-built: 1  Ground floor doors that exit directly to the exterior lacks tactile exit sign
Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	N/A  Corridors  Sign - Tactile Exit Sign at Door  2010 ADAS 216.4.1  Indard: No Quantity: EACH As-built: 1  Ground floor doors that exit directly to the exterior lacks tactile exit sign  Accessible sign not provided  Provide new sign stating "EXIT" at exiting side of door
Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	N/A  Corridors  Sign - Tactile Exit Sign at Door  2010 ADAS 216.4.1  Indard: No Quantity: EACH As-built: 1  Ground floor doors that exit directly to the exterior lacks tactile exit sign  Accessible sign not provided  Provide new sign stating "EXIT" at exiting side of door  1 Necessary Cost Est \$250.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 6E
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Vestibule V001
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Actuator or Control - Height
Code References:	2010 ADAS 305.3
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Control or mechanism not at max. 48" high for side reach
Findings:	Sanitizer dispenser 50" high
Rec. Solution:	Relocate control or mechanism to max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 6F
Field Date: Bldg Name:	2/24/2014 Report Date 2/27/2014 Barrier #: 6F Women's Building Reference Dwg: 2 of 6
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Bldg Name: Location:	Women's Building Reference Dwg: 2 of 6  Basement - Vestibule V001
Bldg Name: Location: X Coordinate:	Women's Building Reference Dwg: 2 of 6  Basement - Vestibule V001  N/A Y Coordinate: N/A  Corridors  Horn/Strobe Device
Bldg Name: Location: X Coordinate: Barrier Area:	Women's Building Reference Dwg: 2 of 6  Basement - Vestibule V001  N/A Y Coordinate: N/A  Corridors
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code	Women's Building Reference Dwg: 2 of 6  Basement - Vestibule V001  N/A Y Coordinate: N/A  Corridors  Horn/Strobe Device  2010 ADAS 702.1
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Women's Building Reference Dwg: 2 of 6  Basement - Vestibule V001  N/A Y Coordinate: N/A  Corridors  Horn/Strobe Device  2010 ADAS 702.1
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Women's Building Reference Dwg: 2 of 6  Basement - Vestibule V001  N/A Y Coordinate: N/A  Corridors  Horn/Strobe Device  2010 ADAS 702.1  Indard: No Quantity: EACH As-built: 1
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Women's Building Reference Dwg: 2 of 6  Basement - Vestibule V001  N/A Y Coordinate: N/A  Corridors  Horn/Strobe Device  2010 ADAS 702.1  Indard: No Quantity: EACH As-built: 1  No horn or strobe in corridor where fire alarm exists in building
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Women's Building  Reference Dwg: 2 of 6  Basement - Vestibule V001  N/A  Y Coordinate: N/A  Corridors  Horn/Strobe Device  2010 ADAS 702.1  No horn or strobe in corridor where fire alarm exists in building  No device provided  Provide horn/strobe in common use area
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Women's Building  Reference Dwg: 2 of 6  Basement - Vestibule V001  N/A Y Coordinate: N/A  Corridors  Horn/Strobe Device  2010 ADAS 702.1  No horn or strobe in corridor where fire alarm exists in building  No device provided  Provide horn/strobe in common use area  1 Necessary Cost Est \$5,500.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 7A
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Biometrics Lab 015
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	Permanent Room/Space - Tactile Characters
Code References:	2010 ADAS 216.2
Performance Sta	indard: No Quantity: EACH As-built : 1
Barrier Description:	At interior or exterior location, no tactile characters at sign identifying permanent rooms and spaces
Findings:	No tactile signage provided at door within public route
Rec. Solution:	Provide accessible sign
Barrier Severity:	1 Necessary Cost Est \$250.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 7B
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Biometrics Lab 015
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Hardware - Operation
Code References:	2010 ADAS 404.2.7
Performance Sta	indard: No Quantity: EACH As-built : 3
Barrier Description:	Hardware not operable with a closed fist
Findings:	Hardware not operable with a closed fist
Rec. Solution:	Provide new hardware
Barrier Severity:	1 Necessary Cost Est \$900.00 Facility Function: Public Status: Open
Implementation	Truccessary Cost Est 15500.00 radiity randioni   Table



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 7C
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Biometrics Lab 015
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Vision Lights - Existing
Code References:	2010 ADAS 404.2.11
Performance Sta	andard: No Quantity: EACH As-built : 3
Barrier Description:	View panels in or adjacent to doors or gates not max. 43" above floor or ground
Findings:	View panels located higher than 43" above the floor
Rec. Solution:	Replace doors/gates or vision panels
Barrier Severity:	3 Hindrance Cost Est \$6,750.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 7D
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Biometrics Lab 015
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Door 10" Bottom Surface - Door Hardware
Code References:	2010 ADAS 404.2.10
Performance Sta	indard: No Quantity: EACH As-built : 2
Barrier Description:	Door stop interrupts min.10" smooth bottom surface
Findings:	Door hardware extends into bottom 10" of door
Rec. Solution:	Remove door stop or any other element within bottom 10" of door
Danis Carranitor	inclinate door stop or any other element within bottom to or door
Barrier Severity:	
Implementation	1 Necessary Cost Est \$1,500.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 7E
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Biometrics Lab 015
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Landing - Existing (≥ 5.0%)
Code References:	2010 ADAS 404.2.4.4
Performance Sta	ndard: No Quantity: SF As-built : 40
Barrier Description:	Door or gate lacks landing on both sides of door
Findings:	24% slope at door landing where raised floor was installed
Rec. Solution:	Demolish and reconstruct level landing at min. one entrance
Barrier Severity:	1 Necessary Cost Est \$5,000.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 7F
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Biometrics Lab 015
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Electrical Switches - High Unobstructed
Code References:	2010 ADAS 308.2.1
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Light switch control box top edge not at max. 48" high
Findings:	50-1/2" high
Rec. Solution:	Relocate switch box top edge to max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 7G
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Biometrics Lab 015
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Electrical Outlets
Code References:	2010 ADAS 308.2.2
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Use of outlet involves low reach of less than 15" above floor or not max. 48" high
Findings:	12" high
Rec. Solution:	Relocate outlet to area with max. 15 low reach or max.48" high reach
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 7H
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Biometrics Lab 015
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Corridors
Barrier Type:	Lockers - Control
Code References:	2010 ADAS 803.5
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Locker mechanism not operable with fist or involves turning and grasping
Findings:	Control mechanism not fist operable
Rec. Solution:	Provide min. 1 accessible locker or 5% overall
Barrier Severity:	2 Recommended Cost Est \$450.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: 4 locker	s provided



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 7I
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Biometrics Lab 015
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Corridors
Barrier Type:	Lockers - Maneuvering Cl
Code References:	2010 ADAS 803.2
Performance Sta	ndard: No Quantity: EACH As-built : 0
Barrier Description:	No 60" maneuvering clearance provided at lockers
Findings:	60" maneuvering clearance not provided at any of the lockers
Rec. Solution:	Provide accessible bench at accessble locker
Barrier Severity:	2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 7J
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Biometrics Lab 015
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Projector Screen Pull
Code References:	2010 ADAS 305.3
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Screen pull not at max. 48" high for side reach
Findings:	Projector screen pull above 48" high
Rec. Solution:	Relocate to max. 48" high or provide extension
Barrier Severity:	3 Hindrance Cost Est \$75.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 7K
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Biometrics Lab 015
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Actuator or Control - Height
Code References:	2010 ADAS 305.3
Performance Sta	ndard: No Quantity: EACH As-built : 2
Barrier Description:	Control or mechanism not at max. 48" high for side reach
Findings:	Thermostat and white board calendar 57"-60" high
Rec. Solution:	Relocate controls or mechanisms to max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$1,500.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 7L
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Biometrics Lab 015
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Counters and Tables
Barrier Type:	Table - Ratio
Code References:	2010 ADAS 902
Performance Sta	ndard: No Quantity: EACH As-built : 2
Barrier Description:	At least 1 table or 5% of all tables are not accessible
Findings:	Min. 1 accessible table not provided
Rec. Solution:	Provide min. 1 accessible table of each type
Barrier Severity:	3 Hindrance Cost Est \$900.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: 2 electro	onic tables and 2 treatment table



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 7M
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Biometrics Lab 015
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Counters and Tables
Barrier Type:	Table - Knee Clearance
Code References:	2010 ADAS 305.3
Performance Sta	andard: No Quantity: EACH As-built : 0
Barrier Description:	Knee clearance not min. 27" high, 19" deep or 30" wide
Findings:	24-3/4" knee clearance
Rec. Solution:	Provide min. 1 accessible table
Barrier Severity:	3 Hindrance Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: Electron	nics table 24-1/2" knee clearance
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 7N
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Biometrics Lab 015
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Counters and Tables
Barrier Type:	Table - Knee Clearance
Code References:	2010 ADAS 305.3
Performance Sta	andard: No Quantity: EACH As-built : 0
Barrier Description:	Knee clearance not min. 27" high, 19" deep or 30" wide
Findings:	24-1/2" knee clearance
Rec. Solution:	Move stored objects
Barrier Severity:	3 Hindrance Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: Treatme	ent table



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 70
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Biometrics Lab 015
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Desk - Ratio
Code References:	2010 ADAS 902
Performance Sta	indard: No Quantity: EACH As-built : 1
Barrier Description:	At least 1 desk or 5% of all desks not accessible
Findings:	Min. 1 accessible desk not provided
Rec. Solution:	Provide min. 1 accessible desk
Barrier Severity:	3 Hindrance Cost Est \$875.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: 10 desk	s with fold up tables
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 7P
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Biometrics Lab 015
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Clear Floor Space
Barrier Type:	Abrupt Change in Level
Code References:	2010 ADAS 303.3
Performance Sta	andard: No Quantity: SF As-built : 60
Barrier Description:	Change in level greater than 1/2" in clear floor space
Findings:	3-1/2" step in circulation route
Rec. Solution:	Remodel to provide accessible route
Barrier Severity:	1 Necessary Cost Est \$34,500.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 7Q
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Biometrics Lab 015
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Protruding Object - Wall-mounted
Code References:	2010 ADAS 307.2
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Wall mounted object protrudes more than 4" from wall
Findings:	Hanging blue curtains may create a protruding hazard for the visually impaired
Rec. Solution:	Remove object or provide detectable warning for the visually impaired
Barrier Severity:	1 Necessary Cost Est \$550.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 7R
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Biometrics Lab 015
X Coordinate:	N/A Y Coordinate: N/A
	× ×
Barrier Area:	Classrooms
Barrier Area: Barrier Type:	
	Classrooms
Barrier Type: Code	Classrooms Alarm - Horn/Strobe 2010 ADAS 702.1
Barrier Type: Code References:	Classrooms Alarm - Horn/Strobe 2010 ADAS 702.1
Barrier Type: Code References: Performance Sta Barrier	Classrooms Alarm - Horn/Strobe  2010 ADAS 702.1  ndard: No Quantity: EACH As-built: 1
Barrier Type: Code References: Performance Sta Barrier Description:	Classrooms Alarm - Horn/Strobe  2010 ADAS 702.1  ndard: No Quantity: EACH As-built: 1  Where a fire alarm is installed, no horn/strobe provided
Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Classrooms Alarm - Horn/Strobe  2010 ADAS 702.1  ndard: No Quantity: EACH As-built: 1  Where a fire alarm is installed, no horn/strobe provided  No device provided
Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Classrooms Alarm - Horn/Strobe  2010 ADAS 702.1  mdard: No Quantity: EACH As-built: 1  Where a fire alarm is installed, no horn/strobe provided  No device provided  Provide horn/strobe in common use area  1 Necessary Cost Est \$5,500.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 8A
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Stock Room 015A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	Permanent Room/Space - Tactile Characters
Code References:	2010 ADAS 216.2
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	At interior or exterior location, no tactile characters at sign identifying permanent rooms and spaces
Findings:	No tactile signage provided at door within public route
Rec. Solution:	Provide accessible sign
Barrier Severity:	1 Necessary Cost Est \$250.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 8B
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Stock Room 015A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Hardware - Operation
Code References:	2010 ADAS 404.2.7
Performance Sta	indard: No Quantity: EACH As-built : 1
Barrier Description:	Hardware not operable with a closed fist
Findings:	Hardware not operable with a closed fist
Rec. Solution:	Provide new hardware
Barrier Severity:	1 Necessary Cost Est \$300.00 Facility Function: Public Status: Open
Implementation	
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 8C
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Stock Room 015A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Front App/pull 18" SEC - Relocate Door
Code References:	2010 ADAS Figure 404.2.4.1
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Door/Gate at pull side with min. 60" lacks min. 18" strike edge clearance at pull side
Findings:	7-1/2" strike edge clearance on entry side and 5" strike edge clearance on exit side
Rec. Solution:	Remodel to provide maneuvering clearance
Barrier Severity:	1 Necessary Cost Est \$2,250.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 8D
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Stock Room 015A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Clear Floor Space
Barrier Type:	Passageway - Min. 36" (Stored Item)
Code References:	2010 ADAS 403.5.1
Performance Sta	indard: No Quantity: JOB As-built : 1
Barrier Description:	Circulation route not min. 36" wide between elements
Findings:	Entry passageway reduced below 36" at entry
Rec. Solution:	Removed stored items
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 8E
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Stock Room 015A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Laboratory Facilities
Barrier Type:	Electrical Switches - Height
Code References:	2010 ADAS 308.2.1
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Light switch control box top edge not at max. 48" high
Findings:	52" high
Rec. Solution:	Relocate switch box top edge to max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 8F
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Stock Room 015A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Laboratory Facilities
Barrier Type:	Actuator or Control - Obstructed Reach
Code References:	2010 ADAS 305.3
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Control or mechanism not at max. 44" over an obstruction of max. 25"
Findings:	Thermostat located over an obstruction of 36-1/4" high
Rec. Solution:	Relocate control or mechanism to max. 44" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 8G
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Stock Room 015A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Corridors
Barrier Type:	Passageway - Min. 36"
Code References:	2010 ADAS 403.5.1
Performance Sta	indard: No Quantity: LF As-built : 100
Barrier Description:	Circulation route through corridor not min. 36"
Findings:	Circulation route not min. 36"
Rec. Solution:	Move stored items or remodel space to provide access
Barrier Severity:	1 Necessary Cost Est \$12,500.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 8H
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Stock Room 015A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Counters and Tables
Barrier Type:	Counter - Surface Height
Code References:	2010 ADAS 902.3
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	No section at least 3 feet long between 28" and 34" provided at existing counter
Findings:	36-1/4" high
Rec. Solution:	Provide min. 3 ft long section of counter at max. 34" high
Rec. Solution: Barrier Severity:	
	3 Hindrance Cost Est \$875.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 8I
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Stock Room 015A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Sink - 30" x 48" Clearance
Code References:	2010 ADAS 305
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Sink lacks 30" x 48" clear floor space
Findings:	Clear space not provided to approach sink
Rec. Solution:	Replace sink and remodel area
Barrier Severity:	2 Recommended Cost Est \$1,200.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 8J
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Stock Room 015A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Sink - Rim or Countertop
Code References:	2010 ADAS 606.3
Performance Sta	andard: No Quantity: LF As-built : 3
Barrier Description:	Sink rim or surface not max. 34" high
Findings:	36-1/4" high
Rec. Solution:	Reposition existing sink or provide additional sink for use in area
Rec. Solution: Barrier Severity:	
	1 Necessary Cost Est \$1,110.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 8K
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Stock Room 015A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Sink - Depth
Code References:	Performance Standard
Performance Sta	ndard: Yes Quantity: EACH As-built : 0
Barrier Description:	Sink depth exceeds 6-1/2" deep
Findings:	7-1/2" deep
Rec. Solution:	Replace sink
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 8L
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Stock Room 015A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	
71	Sink - Knee Clearance
Code References:	Sink - Knee Clearance 2010 ADAS 606.2 & 306
Code	2010 ADAS 606.2 & 306
Code References:	2010 ADAS 606.2 & 306
Code References: Performance Sta Barrier	2010 ADAS 606.2 & 306 andard: No Quantity: EACH As-built : 0
Code References: Performance Sta Barrier Description:	2010 ADAS 606.2 & 306  Indard: No Quantity: EACH As-built: 0  Knee clearance of at least 27" high, 19" deep and 30" wide not provided
Code References: Performance Sta Barrier Description: Findings:	2010 ADAS 606.2 & 306  Indard: No Quantity: EACH As-built: 0  Knee clearance of at least 27" high, 19" deep and 30" wide not provided  No knee clearance  Replace cabinet and remount sink
Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	2010 ADAS 606.2 & 306  Indard: No Quantity: EACH As-built: 0  Knee clearance of at least 27" high, 19" deep and 30" wide not provided  No knee clearance  Replace cabinet and remount sink  1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 8M
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Stock Room 015A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Laboratory Facilities
Barrier Type:	Shelves or Cabinet
Code References:	2010 ADAS 603.4
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Shelf or cabinet not mounted between 40" and 48" above floor or ground
Findings:	Shelf or cabinet not accessible
Rec. Solution:	Provide additional shelf/cabinet at accessible height or provide assistance
Barrier Severity:	2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: Multiple	e shelves above 48" high
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 8N
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Stock Room 015A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Laboratory Facilities
Barrier Type:	Alarm - Horn/Strobe
Code References:	2010 ADAS 702.1
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Where a fire alarm is installed, no horn/strobe provided
Findings:	No device provided
Rec. Solution:	Provide horn/strobe in common use area
Barrier Severity:	1 Necessary Cost Est \$5,500.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 9A
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Grad Student Office 015B
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	Permanent Room/Space - Tactile Characters
Code References:	2010 ADAS 216.2
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	At interior or exterior location, no tactile characters at sign identifying permanent rooms and spaces
Findings:	No tactile signage provided at door within public route
Rec. Solution:	Provide accessible sign
Barrier Severity:	1 Necessary Cost Est \$250.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 9B
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Grad Student Office 015B
X Coordinate:	N/A Y Coordinate: N/A
	11971
Barrier Area:	Doors or Gates
Barrier Area: Barrier Type:	
	Doors or Gates
Barrier Type: Code	Doors or Gates Hardware - Operation 2010 ADAS 404.2.7
Barrier Type: Code References:	Doors or Gates Hardware - Operation 2010 ADAS 404.2.7
Barrier Type: Code References: Performance Sta Barrier	Doors or Gates Hardware - Operation  2010 ADAS 404.2.7  Indard: No Quantity: EACH As-built: 1
Barrier Type: Code References: Performance Sta Barrier Description:	Doors or Gates Hardware - Operation  2010 ADAS 404.2.7  Indard: No Quantity: EACH As-built: 1  Hardware not operable with a closed fist
Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Doors or Gates Hardware - Operation 2010 ADAS 404.2.7  Indard: No Quantity: EACH As-built: 1  Hardware not operable with a closed fist  Hardware not operable with a closed fist  Provide new hardware
Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Doors or Gates Hardware - Operation  2010 ADAS 404.2.7  Indard: No Quantity: EACH As-built: 1  Hardware not operable with a closed fist  Hardware not operable with a closed fist  Provide new hardware  1 Necessary Cost Est \$300.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 9C
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Grad Student Office 015B
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Front App/push 12" SEC
Code References:	2010 ADAS Figure 404.2.4.1
Performance Sta	ndard: No Quantity: ADMINI As-built : 2
Barrier Description:	Door/Gate at push side with min. 48" lacks min. 12" strike edge clearance with latch/closer
Findings:	Bookcases block stike edge clearance at entry and exit side
Rec. Solution:	Remove stored items
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 9D
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Grad Student Office 015B
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Laboratory Facilities
Barrier Type:	Electrical Switches - Height
Code References:	2010 ADAS 308.2.1
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Light switch control box top edge not at max. 48" high
Findings:	50-1/2" high
Rec. Solution:	Relocate switch box top edge to max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	
Notes: Blocked	, I



Field Date:	2/24/2044 Poport Data 2/27/2044 Parrier #: 05
	2/24/2014 Report Date 2/27/2014 Barrier #: 9E
Bldg Name:	Women's Building   Reference Dwg:   2 of 6
Location:	Basement - Grad Student Office 015B
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Counters and Tables
Barrier Type:	Table - Knee Clearance
Code References:	2010 ADAS 305.3
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Knee clearance not min. 27" high, 19" deep or 30" wide
Findings:	24-1/2" knee clearance
Rec. Solution:	Provide min. 1 accessible treatment table
Barrier Severity:	3 Hindrance Cost Est \$450.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 9F
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	
	Basement - Grad Student Office 015B
X Coordinate:	Basement - Grad Student Office 015B  N/A  Y Coordinate: N/A
X Coordinate: Barrier Area:	
	N/A Y Coordinate: N/A  Laboratory Facilities  Workstation - Knee Clearance
Barrier Area:	N/A Y Coordinate: N/A  Laboratory Facilities
Barrier Area: Barrier Type: Code	N/A Y Coordinate: N/A  Laboratory Facilities  Workstation - Knee Clearance  2010 ADAS 902
Barrier Area: Barrier Type: Code References:	N/A Y Coordinate: N/A  Laboratory Facilities  Workstation - Knee Clearance  2010 ADAS 902
Barrier Area: Barrier Type: Code References: Performance Sta Barrier	N/A  V Coordinate: N/A  Laboratory Facilities  Workstation - Knee Clearance  2010 ADAS 902  andard: No Quantity: EACH As-built: 1
Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	N/A  Laboratory Facilities  Workstation - Knee Clearance  2010 ADAS 902  Andard: No Quantity: EACH As-built: 1  Knee clearance of at least 27" high, 30" wide and 8" deep not provided underneath workstation
Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	N/A  Laboratory Facilities  Workstation - Knee Clearance  2010 ADAS 902  Andard: No Quantity: EACH As-built: 1  Knee clearance of at least 27" high, 30" wide and 8" deep not provided underneath workstation  26-1/4" high and 13" deep knee clearance  Reposition workstation to provide knee clearance
Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	N/A  Laboratory Facilities  Workstation - Knee Clearance  2010 ADAS 902  Andard: No Quantity: EACH As-built: 1  Knee clearance of at least 27" high, 30" wide and 8" deep not provided underneath workstation  26-1/4" high and 13" deep knee clearance  Reposition workstation to provide knee clearance  1 Necessary Cost Est \$875.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 9G
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Grad Student Office 015B
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Clear Floor Space
Barrier Type:	Passageway - Min. 36" (Stored Item)
Code References:	2010 ADAS 403.5.1
Performance Sta	ndard: No Quantity: JOB As-built : 1
Barrier Description:	Circulation route not min. 36" wide between elements
Findings:	Passageway to biodex blocked by stored items
Rec. Solution:	Removed stored items
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 9H
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Grad Student Office 015B
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Laboratory Facilities
Barrier Type:	Alarm - Horn/Strobe
Code References:	2010 ADAS 702.1
Performance Sta	ndard: No Quantity: EACH As-built: 1
Barrier Description:	Where a fire alarm is installed, no horn/strobe provided
Findings:	No device provided
Rec. Solution:	Provide horn/strobe in common use area
Barrier Severity:	1 Necessary Cost Est \$5,500.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 10A
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Disabilities Research Lab 008
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	Permanent Room/Space - Tactile Characters
Code References:	2010 ADAS 216.2
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	At interior or exterior location, no tactile characters at sign identifying permanent rooms and spaces
Findings:	No tactile signage provided at door within public route
Rec. Solution:	Provide accessible sign
Barrier Severity:	1 Necessary Cost Est \$250.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes: The enti	ry door is used to access conference room within space
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 10B
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Disabilities Research Lab 008
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Door Closer - Interior
Code References:	2010 ADAS 404.2.9
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Door opening force exceeds 5 lbf
Findings:	10 lbf
Rec. Solution:	Provide automatic door opening device
Barrier Severity:	1 Necessary Cost Est \$5,000.00 Facility Function: Public Status: Open
Implementation	
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 10C
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Disabilities Research Lab 008
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Door Closer - Sweep Period
Code References:	2010 ADAS 404.2.8.1
Performance Sta	ndard: No Quantity: EACH As-built : 0
Barrier Description:	Door closer lacks min. 5 second sweep period
Findings:	3 second sweep
Rec. Solution:	Provide automatic door opening device
Barrier Severity:	2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 10D
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Disabilities Research Lab 008
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Door 10" Bottom Surface - Door Stop
Code References:	2010 ADAS 404.2.10
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Door stop interrupts min.10" smooth bottom surface
Findings:	Door stop at bottom of door can create trapping condition
Rec. Solution:	Remove door stop or any other element within bottom 10" of door
Barrier Severity:	1 Necessary Cost Est \$75.00 Facility Function: Public Status: Open
Implementation	I Necessary Cost Est 1575.00 Tacility Function. [Public Status. [Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 10E
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Disabilities Research Lab 008
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Clear Width
Code References:	2010 ADAS 404.2.3
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Door, sliding/folding door or gate clear width is not min. 32"
Findings:	30" clear width
Rec. Solution:	Replace door or gate and frame
Barrier Severity:	1 Necessary Cost Est \$2,250.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 10F
Field Date: Bldg Name:	2/24/2014   Report Date   2/27/2014   Barrier #:   10F
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Bldg Name: Location:	Women's Building Reference Dwg: 2 of 6  Basement - Disabilities Research Lab 008
Bldg Name: Location: X Coordinate:	Women's Building Reference Dwg: 2 of 6  Basement - Disabilities Research Lab 008  N/A Y Coordinate: N/A  Signage  Tactile Exit Signs - Door
Bldg Name: Location: X Coordinate: Barrier Area:	Women's Building Reference Dwg: 2 of 6  Basement - Disabilities Research Lab 008  N/A Y Coordinate: N/A  Signage
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code	Women's Building Reference Dwg: 2 of 6  Basement - Disabilities Research Lab 008  N/A Y Coordinate: N/A  Signage  Tactile Exit Signs - Door  2010 ADAS 216.4.1
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Women's Building Reference Dwg: 2 of 6  Basement - Disabilities Research Lab 008  N/A Y Coordinate: N/A  Signage  Tactile Exit Signs - Door  2010 ADAS 216.4.1
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Women's Building Reference Dwg: 2 of 6  Basement - Disabilities Research Lab 008  N/A Y Coordinate: N/A  Signage  Tactile Exit Signs - Door  2010 ADAS 216.4.1  ndard: No Quantity: EACH As-built: 1
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Women's Building  Reference Dwg: 2 of 6  Basement - Disabilities Research Lab 008  N/A  Y Coordinate: N/A  Signage  Tactile Exit Signs - Door  2010 ADAS 216.4.1  mdard: No Quantity: EACH As-built: 1  Ground floor doors that exit to exterior lacks tactile exit sign
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Women's Building Reference Dwg: 2 of 6  Basement - Disabilities Research Lab 008  N/A Y Coordinate: N/A  Signage  Tactile Exit Signs - Door  2010 ADAS 216.4.1  Indard: No Quantity: EACH As-built: 1  Ground floor doors that exit to exterior lacks tactile exit sign  Exit door with low level illuminated sign lacks tactile exit sign
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Women's Building  Reference Dwg: 2 of 6  Basement - Disabilities Research Lab 008  N/A Y Coordinate: N/A  Signage  Tactile Exit Signs - Door  2010 ADAS 216.4.1  Indard: No Quantity: EACH As-built: 1  Ground floor doors that exit to exterior lacks tactile exit sign  Exit door with low level illuminated sign lacks tactile exit sign  Provide sign stating "EXIT" at exit side of door  1 Necessary Cost Est \$250.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 10G
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Disabilities Research Lab 008
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Electrical Switches - Height
Code References:	2010 ADAS 308.2.1
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Light switch control box top edge not at max. 48" high
Findings:	48-1/2" high
Rec. Solution:	Relocate switch box top edge to max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 11A
Field Date: Bldg Name:	2/24/2014   Report Date   2/27/2014   Barrier #:   11A
Bldg Name:	Women's Building Reference Dwg: 2 of 6  Basement - Grad Student Office 008E  N/A Y Coordinate: N/A
Bldg Name: Location:	Women's Building Reference Dwg: 2 of 6  Basement - Grad Student Office 008E
Bldg Name: Location: X Coordinate:	Women's Building Reference Dwg: 2 of 6  Basement - Grad Student Office 008E  N/A Y Coordinate: N/A  Signage  Permanent Room/Space - Tactile Characters
Bldg Name: Location: X Coordinate: Barrier Area:	Women's Building Reference Dwg: 2 of 6  Basement - Grad Student Office 008E  N/A Y Coordinate: N/A  Signage
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code	Women's Building Reference Dwg: 2 of 6  Basement - Grad Student Office 008E  N/A Y Coordinate: N/A  Signage  Permanent Room/Space - Tactile Characters  2010 ADAS 216.2
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Women's Building Reference Dwg: 2 of 6  Basement - Grad Student Office 008E  N/A Y Coordinate: N/A  Signage  Permanent Room/Space - Tactile Characters  2010 ADAS 216.2
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Women's Building Reference Dwg: 2 of 6  Basement - Grad Student Office 008E  N/A Y Coordinate: N/A  Signage  Permanent Room/Space - Tactile Characters  2010 ADAS 216.2  At interior or exterior location, no tactile characters at sign identifying permanent rooms and
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance State Barrier Description:	Women's Building Reference Dwg: 2 of 6  Basement - Grad Student Office 008E  N/A Y Coordinate: N/A  Signage  Permanent Room/Space - Tactile Characters  2010 ADAS 216.2  At interior or exterior location, no tactile characters at sign identifying permanent rooms and spaces
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Women's Building  Reference Dwg: 2 of 6  Basement - Grad Student Office 008E  N/A  Y Coordinate: N/A  Signage  Permanent Room/Space - Tactile Characters  2010 ADAS 216.2  At interior or exterior location, no tactile characters at sign identifying permanent rooms and spaces  No tactile signage provided at door within public route  Provide accessible sign
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Women's Building  Reference Dwg: 2 of 6  Basement - Grad Student Office 008E  N/A Y Coordinate: N/A  Signage  Permanent Room/Space - Tactile Characters  2010 ADAS 216.2  At interior or exterior location, no tactile characters at sign identifying permanent rooms and spaces  No tactile signage provided at door within public route  Provide accessible sign  I Necessary Cost Est \$250.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 11B
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Grad Student Office 008E
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Front App/pull 18" SEC - Blocked
Code References:	2010 ADAS Figure 404.2.4.1
Performance Sta	andard: No Quantity: ADMINI As-built: 1
Barrier Description:	Door/Gate at pull side with min. 60" lacks min. 18" strike edge clearance at pull side
Findings:	Desk blocks strike edge clearance
Rec. Solution:	Move desk
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: No door	r closer
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 11C
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Grad Student Office 008E
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Counters and Tables
Barrier Type:	Table - Knee Clearance
Code References:	2010 ADAS 305.3
Performance Sta	andard: No Quantity: EACH As-built: 0
Barrier Description:	Knee clearance not min. 27" high, 19" deep or 30" wide
Findings:	26-1/2" high and 30" wide knee clearance
Rec. Solution:	Provide min. 1 accessible table
Barrier Severity:	3 Hindrance Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	
Notes: 4 cente	r table



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 11D
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Grad Student Office 008E
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Workstation - Knee Clearance
Code References:	2010 ADAS 902
Performance Sta	ndard: No Quantity: EACH As-built : 0
Barrier Description:	Knee clearance of at least 27" high, 30" wide and 8" deep not provided
Findings:	24-7/8" high and 25" wide knee clearance
Rec. Solution:	Provide min. one accessible workstation
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: Three w	orkstations. None are accessible.
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 11F
Bldg Name:	Women's Building Reference Dwg: 2 of 6
	Weiner Ballang
Location:	Basement - Grad Student Office 008E
Location: X Coordinate:	
	Basement - Grad Student Office 008E
X Coordinate:	Basement - Grad Student Office 008E  N/A  Y Coordinate: N/A
X Coordinate: Barrier Area:	Basement - Grad Student Office 008E  N/A  Y Coordinate: N/A  Classrooms
X Coordinate: Barrier Area: Barrier Type: Code	Basement - Grad Student Office 008E  N/A  Y Coordinate: N/A  Classrooms  Sink - 30" x 48" Clearance  2010 ADAS 305
X Coordinate: Barrier Area: Barrier Type: Code References:	Basement - Grad Student Office 008E  N/A  Y Coordinate: N/A  Classrooms  Sink - 30" x 48" Clearance  2010 ADAS 305
X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Basement - Grad Student Office 008E  N/A  Y Coordinate: N/A  Classrooms  Sink - 30" x 48" Clearance  2010 ADAS 305  Indard: No  Quantity: EACH  As-built: 1
X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Basement - Grad Student Office 008E  N/A  Y Coordinate: N/A  Classrooms  Sink - 30" x 48" Clearance  2010 ADAS 305  andard: No  Quantity: EACH  As-built:  Sink lacks 30" x 48" clear floor space
X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Basement - Grad Student Office 008E  N/A  Y Coordinate: N/A  Classrooms  Sink - 30" x 48" Clearance  2010 ADAS 305  Indard: No Quantity: EACH As-built: 1  Sink lacks 30" x 48" clear floor space  Clear space not provided to approach sink  Replace sink and remodel area
X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Basement - Grad Student Office 008E  N/A  Y Coordinate: N/A  Classrooms  Sink - 30" x 48" Clearance  2010 ADAS 305  Indard: No Quantity: EACH As-built: 1  Sink lacks 30" x 48" clear floor space  Clear space not provided to approach sink  Replace sink and remodel area  2 Recommended Cost Est \$1,200.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 11G
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Grad Student Office 008E
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Sink - Rim or Countertop
Code References:	2010 ADAS 606.3
Performance Sta	indard: No Quantity: LF As-built: 0
Barrier Description:	No accessible section of counter at max 34" high provided
Findings:	35" high
Rec. Solution:	Reposition existing sink or provide additional sink for use in area
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 11H
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Grad Student Office 008E
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Sink - Min. 15" Clearance to Wall
Code References:	2010 ADAS 606
Performance Sta	indard: No Quantity: EACH As-built : 0
Barrier Description:	Sink plumbing line not at least 15" on center from adjacent wall
Findings:	Clear space not provided to approach sink
Rec. Solution:	Move sink when remodeling
Barrier Severity:	2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: 15-1/2"	, <u> -</u>



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 111
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Grad Student Office 008E
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Sink - Knee Clearance
Code References:	2010 ADAS 606.2 & 306
Performance Sta	andard: No Quantity: EACH As-built : 0
Barrier Description:	Knee clearance of at least 27" high, 19" deep and 30" wide not provided
Findings:	9-1/2" deep knee clearance
Rec. Solution:	Replace cabinet and remount sink
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: Drain pi	ipe orientation also blocks knee clearance.
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 11J
Bldg Name:	Women's Building Reference Dwg: 2 of 6
	Women's banding
Location:	Basement - Grad Student Office 008E
Location: X Coordinate:	
	Basement - Grad Student Office 008E
X Coordinate:	Basement - Grad Student Office 008E  N/A  Y Coordinate: N/A
X Coordinate: Barrier Area:	Basement - Grad Student Office 008E  N/A  Y Coordinate: N/A  Classrooms
X Coordinate: Barrier Area: Barrier Type: Code	Basement - Grad Student Office 008E  N/A  Y Coordinate: N/A  Classrooms  Sink - Exposed Pipes  2010 ADAS 606.5
X Coordinate: Barrier Area: Barrier Type: Code References:	Basement - Grad Student Office 008E  N/A  Y Coordinate: N/A  Classrooms  Sink - Exposed Pipes  2010 ADAS 606.5
X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Basement - Grad Student Office 008E  N/A  Y Coordinate: N/A  Classrooms  Sink - Exposed Pipes  2010 ADAS 606.5  andard: No Quantity: EACH As-built: 1
X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Basement - Grad Student Office 008E  N/A  Y Coordinate: N/A  Classrooms  Sink - Exposed Pipes  2010 ADAS 606.5  andard: No  Quantity: EACH  As-built:  Exposed hot water/drain pipes not insulated or configured so as to protect against contact
X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Basement - Grad Student Office 008E  N/A  Y Coordinate: N/A  Classrooms  Sink - Exposed Pipes  2010 ADAS 606.5  andard: No Quantity: EACH As-built: 1  Exposed hot water/drain pipes not insulated or configured so as to protect against contact  No insulation provided  Provide insulation at drain pipes
X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Basement - Grad Student Office 008E  N/A  Y Coordinate: N/A  Classrooms  Sink - Exposed Pipes  2010 ADAS 606.5  andard: No Quantity: EACH As-built: 1  Exposed hot water/drain pipes not insulated or configured so as to protect against contact  No insulation provided  Provide insulation at drain pipes  2 Recommended Cost Est \$120.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 11K
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Grad Student Office 008E
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Actuator/Control - Forward Reach Obstructed (10"-25")
Code References:	2010 ADAS 305.3
Performance Sta	andard: No Quantity: EACH As-built : 2
Barrier Description:	Control or mechanism over an 10" to 25" obstruction max. 34" high located above 44"
Findings:	Paper towel dispenser and soap dispenser located over an obstruction 35"high
Rec. Solution:	Relocate controls or mechanisms to max. 44" high
Barrier Severity:	3 Hindrance Cost Est \$1,500.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 11L
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Grad Student Office 008E
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Alarms
Barrier Type:	Horn/Strobe
Code References:	2010 ADAS 702.1
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	No horn/strobes in classroom
Findings:	No device provided
Rec. Solution:	
Nec. Joidtion.	Provide strobes in common use area
Barrier Severity:	
	1 Necessary Cost Est \$5,500.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 12A
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Open Lab 008B
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	Permanent Room/Space - Tactile Characters
Code References:	2010 ADAS 216.2
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	At interior or exterior location, no tactile characters at sign identifying permanent rooms and spaces
Findings:	No tactile signage provided at door within public route
Rec. Solution:	Provide accessible sign
Barrier Severity:	1 Necessary Cost Est \$250.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 12B
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Open Lab 008B
X Coordinate:	N/A Y Coordinate: N/A
	M3
Barrier Area:	Classrooms
Barrier Area: Barrier Type:	Classrooms Door Vision Lights
	Door Vision Lights
Barrier Type: Code	Door Vision Lights 2010 ADAS 404.2.11
Barrier Type: Code References:	Door Vision Lights 2010 ADAS 404.2.11
Barrier Type: Code References: Performance Sta Barrier	Door Vision Lights 2010 ADAS 404.2.11  andard: No Quantity: EACH As-built: 1
Barrier Type: Code References: Performance Sta Barrier Description:	Door Vision Lights  2010 ADAS 404.2.11  Indard: No Quantity: EACH As-built: 1  View panels in or adjacent to doors or gates not max. 43" above floor or ground
Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Door Vision Lights  2010 ADAS 404.2.11  Indard: No Quantity: EACH As-built: 1  View panels in or adjacent to doors or gates not max. 43" above floor or ground  Bottom edge of view panel in door or adjacent to door is not max. 43" high  Replace door/gate or vision panel
Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Door Vision Lights  2010 ADAS 404.2.11  Indard: No Quantity: EACH As-built: 1  View panels in or adjacent to doors or gates not max. 43" above floor or ground  Bottom edge of view panel in door or adjacent to door is not max. 43" high  Replace door/gate or vision panel  3 Hindrance Cost Est \$2,250.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 12C
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Open Lab 008B
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Door Clearance - Min. 18" at Pull Side
Code References:	2010 ADAS Figure 404.2.4.1
Performance Sta	ndard: No Quantity: EACH As-built : 0
Barrier Description:	Door lacks min. 18" strike edge clearance at pull side
Findings:	Desk blocks strike edge clearance
Rec. Solution:	Move stored items to provide access
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: No door	· closer
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 12D
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Open Lab 008B
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Electrical Switches - Max. 48" High
Code References:	2010 ADAS 308.2.1
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Light switch control box top edge not at max. 48" high
Findings:	48-1/2" high
Rec. Solution:	Relocate switch box top edge to max. 48" high
Rec. Solution: Barrier Severity:	
	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 12E
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Open Lab 008B
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Actuator or Control - Height
Code References:	2010 ADAS 305.3
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Control or mechanism not at max. 48" high for side reach
Findings:	Printer controls 60" high
Rec. Solution:	Relocate controls or mechanisms to max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: 2 printe	rs
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 12F
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Open Lab 008B
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Desk - Ratio
Code References:	2010 ADAS 902
Performance Sta	ndard: No Quantity: EACH As-built: 1
Barrier Description:	At least 1 desk or 5% of all desks not accessible
Findings:	Min. 1 accessible desk not provided
Rec. Solution:	Provide min. 1 accessible desk
Barrier Severity:	3 Hindrance Cost Est \$875.00 Facility Function: Public Status: Open
Implementation	
Notes: 4 desks.	None are accessible.



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 12G
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Open Lab 008B
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Desk - Knee Clearance
Code References:	2010 ADAS 902
Performance Sta	andard: No Quantity: EACH As-built : 0
Barrier Description:	Knee clearance of at least 27" high, 30" wide and 8" deep not provided underneath desk
Findings:	26-3/4" knee clearance
Rec. Solution:	Provide min. one accessible desk
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: 4 desks,	none accessible.
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 12H
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Open Lab 008B
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Shelves or Cabinets
Code References:	2010 ADAS 603.4
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Shelf or cabinet not mounted between 40" and 48" above floor or ground
Findings:	Shelf or cabinet not accessible
Rec. Solution:	Provide additional shelf at accessible height or provide assistance
Barrier Severity:	2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open
	, i. doi:
Implementation	Priority: 2 Implementation Phase: Implementation Date:



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 12I
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Open Lab 008B
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Alarms
Barrier Type:	Horn/Strobe
Code References:	2010 ADAS 702.1
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	No horn/strobes in classroom
Findings:	No device provided
Rec. Solution:	Provide strobes in common use area
Barrier Severity:	1 Necessary Cost Est \$5,500.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 13A
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Bldg Name: Location:	
_	Women's Building Reference Dwg: 2 of 6
Location:	Women's Building Reference Dwg: 2 of 6  Basement - Sloped Corridor H012
Location: X Coordinate:	Women's Building Reference Dwg: 2 of 6  Basement - Sloped Corridor H012  N/A Y Coordinate: N/A  Corridors  Electrical Switches - Max. 48" High
Location: X Coordinate: Barrier Area:	Women's Building Reference Dwg: 2 of 6  Basement - Sloped Corridor H012  N/A Y Coordinate: N/A  Corridors
Location: X Coordinate: Barrier Area: Barrier Type: Code	Women's Building Reference Dwg: 2 of 6  Basement - Sloped Corridor H012  N/A Y Coordinate: N/A  Corridors  Electrical Switches - Max. 48" High  2010 ADAS 308.2.1
Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Women's Building Reference Dwg: 2 of 6  Basement - Sloped Corridor H012  N/A Y Coordinate: N/A  Corridors  Electrical Switches - Max. 48" High  2010 ADAS 308.2.1
Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Women's Building Reference Dwg: 2 of 6  Basement - Sloped Corridor H012  N/A Y Coordinate: N/A  Corridors  Electrical Switches - Max. 48" High  2010 ADAS 308.2.1  Indard: No Quantity: EACH As-built: 1
Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Women's Building Reference Dwg: 2 of 6  Basement - Sloped Corridor H012  N/A Y Coordinate: N/A  Corridors  Electrical Switches - Max. 48" High  2010 ADAS 308.2.1  Indard: No Quantity: EACH As-built: 1  Light switch control box top edge not at max. 48" high
Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Women's Building Reference Dwg: 2 of 6  Basement - Sloped Corridor H012  N/A Y Coordinate: N/A  Corridors  Electrical Switches - Max. 48" High  2010 ADAS 308.2.1  Indard: No Quantity: EACH As-built: 1  Light switch control box top edge not at max. 48" high  Relocate switch box top edge to max. 48" high
Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Women's Building Reference Dwg: 2 of 6  Basement - Sloped Corridor H012  N/A Y Coordinate: N/A  Corridors  Electrical Switches - Max. 48" High  2010 ADAS 308.2.1  Indard: No Quantity: EACH As-built: 1  Light switch control box top edge not at max. 48" high  49-1/2" high  Relocate switch box top edge to max. 48" high  Relocate switch box top edge to max. 48" high  Relocate switch box top edge to max. 48" high  Relocate switch box top edge to max. 48" high  Relocate switch box top edge to max. 48" high



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 13B
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Sloped Corridor H012
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Ramps
Barrier Type:	Running Slope - Existing (>9.5% or more)
Code References:	2010 ADAS 405.3
Performance Sta	ndard: No Quantity: LF As-built : 1
Barrier Description:	Running slope exceeds 8.33% (>9.5% or more)
Findings:	15% running slope
Rec. Solution:	Provide ISA directional sign with location of and route to elevator
Barrier Severity:	1 Necessary Cost Est \$200.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 13C
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Sloped Corridor H012
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	
	Ramps
Barrier Type:	Ramps   Handrail
Barrier Type: Code References:	
Code	Handrail 2010 ADAS 505.2
Code References:	Handrail 2010 ADAS 505.2
Code References: Performance Sta Barrier	Handrail 2010 ADAS 505.2  Indard: No Quantity: LF As-built: 0
Code References: Performance Sta Barrier Description: Findings:	Handrail 2010 ADAS 505.2  Indard: No Quantity: LF As-built: 0  No handrail provided at both sides
Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Handrail 2010 ADAS 505.2  Indard: No Quantity: LF As-built: 0  No handrail provided at both sides  Ramp lacks handrail at both sides  Provide ISA directional sign with location of and route to elevator
Code References: Performance Sta Barrier Description: Findings: Rec. Solution: Barrier Severity:	Handrail  2010 ADAS 505.2  Indard: No Quantity: LF As-built: 0  No handrail provided at both sides  Ramp lacks handrail at both sides  Provide ISA directional sign with location of and route to elevator  1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Code References: Performance Sta Barrier Description: Findings: Rec. Solution: Barrier Severity: Implementation	Handrail  2010 ADAS 505.2  Indard: No Quantity: LF As-built: 0  No handrail provided at both sides  Ramp lacks handrail at both sides  Provide ISA directional sign with location of and route to elevator  1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 13D
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Sloped Corridor H012
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Clear Floor Space
Barrier Type:	Protruding Object
Code References:	2010 ADAS 307
Performance Sta	indard: No Quantity: EACH As-built : 1
Barrier Description:	Protruding object in circulation path protrudes more than 4" between 27" and 80" high
Findings:	Pipe protrudes 6" at 79" high
Rec. Solution:	Remove object or provide detectable warning for the visually impaired
Barrier Severity:	1 Necessary Cost Est \$550.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 13E
Field Date: Bldg Name:	2/24/2014   Report Date   2/27/2014   Barrier #:   13E
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Bldg Name: Location:	Women's Building Reference Dwg: 2 of 6  Basement - Sloped Corridor H012
Bldg Name: Location: X Coordinate:	Women's Building Reference Dwg: 2 of 6  Basement - Sloped Corridor H012  N/A Y Coordinate: N/A
Bldg Name: Location: X Coordinate: Barrier Area:	Women's Building Reference Dwg: 2 of 6  Basement - Sloped Corridor H012  N/A Y Coordinate: N/A  Corridors
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code	Women's Building Reference Dwg: 2 of 6  Basement - Sloped Corridor H012  N/A Y Coordinate: N/A  Corridors  Horn/Strobe Device  2010 ADAS 702.1
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Women's Building Reference Dwg: 2 of 6  Basement - Sloped Corridor H012  N/A Y Coordinate: N/A  Corridors  Horn/Strobe Device  2010 ADAS 702.1
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Women's Building Reference Dwg: 2 of 6  Basement - Sloped Corridor H012  N/A Y Coordinate: N/A  Corridors  Horn/Strobe Device  2010 ADAS 702.1  Indard: No Quantity: EACH As-built: 1
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Women's Building Reference Dwg: 2 of 6  Basement - Sloped Corridor H012  N/A Y Coordinate: N/A  Corridors  Horn/Strobe Device  2010 ADAS 702.1  Indard: No Quantity: EACH As-built: 1  No horn or strobe in corridor where fire alarm exists in building
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Women's Building  Reference Dwg: 2 of 6  Basement - Sloped Corridor H012  N/A  Y Coordinate: N/A  Corridors  Horn/Strobe Device  2010 ADAS 702.1  No horn or strobe in corridor where fire alarm exists in building  No device provided  Provide horn/strobe in common use area
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Women's Building Reference Dwg: 2 of 6  Basement - Sloped Corridor H012  N/A Y Coordinate: N/A  Corridors  Horn/Strobe Device  2010 ADAS 702.1  No horn or strobe in corridor where fire alarm exists in building  No device provided  Provide horn/strobe in common use area  1 Necessary Cost Est \$5,500.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 14A
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Bone Research Lab 011
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	Permanent Room/Space - Tactile Characters
Code References:	2010 ADAS 216.2
Performance Sta	andard: No Quantity: EACH As-built : 2
Barrier Description:	At interior or exterior location, no tactile characters at sign identifying permanent rooms and spaces
Findings:	No tactile signage provided at door within public route
Rec. Solution:	Provide accessible sign
Barrier Severity:	1 Necessary Cost Est \$500.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes: 2 entry	doors to lab
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 14B
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Bone Research Lab 011
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Door Hardware - Operation
Code References:	2010 ADAS 404.2.7
Performance Sta	andard: No Quantity: EACH As-built: 0
	andard: No Quantity: EACH As-built: 0
Barrier Description:	Operating controls involve tight grasping, pinching or twisting
Description:	Operating controls involve tight grasping, pinching or twisting
Description: Findings:	Operating controls involve tight grasping, pinching or twisting  Hardware not operable with a closed fist  Provide automatic door opening device at min. 1 entry door and ISA directional sign at other
Description: Findings: Rec. Solution:	Operating controls involve tight grasping, pinching or twisting  Hardware not operable with a closed fist  Provide automatic door opening device at min. 1 entry door and ISA directional sign at other  1 Necessary  Cost Est \$0.00  Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 14C
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Bone Research Lab 011
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Recessed Door - Push Side
Code References:	2010 ADAS 404.2.4.3
Performance Sta	ndard: No Quantity: EACH As-built : 0
Barrier Description:	Door recessed by more than 8" lacks at least 12" clearance at push side of door
Findings:	Door recessed more than 8" with 2-3/4" strike edge clearance
Rec. Solution:	Provide automatic door opening device at min. 1 entry door and ISA directional sign at other
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 14D
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Bone Research Lab 011
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Door Closer - Interior
Code References:	2010 ADAS 404.2.9
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Door opening force exceeds 5 lbf
Findings:	10 lbf
Rec. Solution:	Provide automatic door opening device at min. 1 entry door and ISA directional sign at other
Barrier Severity:	
Implementation	
Notes: 2 entry	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 14E
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Bone Research Lab 011
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Door 10" Bottom Surface - Door Stop
Code References:	2010 ADAS 404.2.10
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Door stop interrupts min. 10" smooth bottom surface
Findings:	Door stop at bottom of door can create trapping condition
Rec. Solution:	Remove door stop or any other element within bottom 10" of door
Barrier Severity:	1 Necessary Cost Est \$75.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: 2 entry	doors to lab
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 14F
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Bone Research Lab 011
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Electrical Switches - Max. 48" High
Code References:	2010 ADAS 308.2.1
Performance Sta	indard: No Quantity: EACH As-built: 1
Barrier Description:	Light switch control box top edge not at max. 48" high
Findings:	49-1/2" high
Rec. Solution:	Relocate switch box top edge to max. 48" high
Barrier Severity:	
Implementation	
Notes: Two swi	itches 4 desks one is accessible



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 14G
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Bone Research Lab 011
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Coat Hook - Height
Code References:	2010 ADAS 603.4
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Clothing hooks not max. 48" high AFF
Findings:	66" - 77" high
Rec. Solution:	Provide additional hook in new location
Barrier Severity:	2 Recommended Cost Est \$125.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: Two coa	it racks, both too high
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 14H
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Bone Research Lab 011
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Actuator or Control - Height
Code References:	2010 ADAS 305.3
Performance Sta	ndard: No Quantity: EACH As-built : 0
Barrier Description:	Control or mechanism not at max. 48" high for side reach
Findings:	Fan control 48-1/2" high and not fist operable
Rec. Solution:	Replace control or mechanism at max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 14I
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Bone Research Lab 011
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	Visual Information Provided (Exhibitions)
Code References:	ADA Title II Technical Assistance Manual 3.2000 Denial of participation
Performance Sta	ndard: No Quantity: JOB As-built : 1
Barrier Description:	Visual sign providing information for program, service or activity not accessible
Findings:	Accessible sign not provided
Rec. Solution:	Provide information in alternate format to provide access to people with vision impairments
Barrier Severity:	1 Necessary Cost Est \$5,000.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes: Multiple	e informational posters in room
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 14J
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Bone Research Lab 011
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Protruding Object - Wall-mounted
Code References:	2010 ADAS 307.2
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Wall mounted object protrudes more than 4" from wall
Findings:	Radiator protrudes 5" above 27" high
Rec. Solution:	Remove object or provide detectable warning for the visually impaired
Barrier Severity:	1 Necessary Cost Est \$550.00 Facility Function: Public Status: Open
Implementation	
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 14K
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Bone Research Lab 011
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Clear Floor Space
Barrier Type:	Carpet/Rug
Code References:	2010 ADAS 302.2
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Carpet/rug not anchored to floor (possible trip hazard)
Findings:	Rubber mats may create tripping hazards
Rec. Solution:	Secure existing mats
Barrier Severity:	1 Necessary Cost Est \$500.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 14L
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Bone Research Lab 011
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Alarm - Horn/Strobe
Code References:	2010 ADAS 702.1
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Where a fire alarm is installed, no horn/strobe provided
Findings:	No device provided
Rec. Solution:	Provide horn/strobe in common use area
Barrier Severity:	1 Necessary Cost Est \$5,500.00 Facility Function: Public Status: Open
Implementation	
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 15A
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Non-Class Lab 011A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	Permanent Room/Space - Tactile Characters
Code References:	2010 ADAS 216.2
Performance Sta	ndard: No Quantity: EACH As-built : 2
Barrier Description:	At interior or exterior location, no tactile characters at sign identifying permanent rooms and spaces
Findings:	No tactile signage provided at door within public route
Rec. Solution:	Provide accessible sign
Barrier Severity:	1 Necessary Cost Est \$500.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes: 2 entry	doors
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 15B
Dida Nasa.	
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Women's Building Reference Dwg: 2 of 6  Basement - Non-Class Lab 011A
Location:	Basement - Non-Class Lab 011A
Location: X Coordinate:	Basement - Non-Class Lab 011A  N/A  Y Coordinate: N/A
Location: X Coordinate: Barrier Area:	Basement - Non-Class Lab 011A  N/A Y Coordinate: N/A  Classrooms
Location: X Coordinate: Barrier Area: Barrier Type: Code	Basement - Non-Class Lab 011A  N/A  Y Coordinate: N/A  Classrooms  Door 10" Bottom Surface - Door Stop  2010 ADAS 404.2.10
Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Basement - Non-Class Lab 011A  N/A  Y Coordinate: N/A  Classrooms  Door 10" Bottom Surface - Door Stop  2010 ADAS 404.2.10
Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Basement - Non-Class Lab 011A  N/A  Y Coordinate: N/A  Classrooms  Door 10" Bottom Surface - Door Stop  2010 ADAS 404.2.10  Indard: No Quantity: EACH As-built: 2
Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Basement - Non-Class Lab 011A  N/A  Y Coordinate: N/A  Classrooms  Door 10" Bottom Surface - Door Stop  2010 ADAS 404.2.10  andard: No Quantity: EACH As-built: 2  Door stop interrupts min. 10" smooth bottom surface
Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Basement - Non-Class Lab 011A  N/A  Y Coordinate: N/A  Classrooms  Door 10" Bottom Surface - Door Stop  2010 ADAS 404.2.10  andard: No Quantity: EACH As-built: 2  Door stop interrupts min. 10" smooth bottom surface  Door stop at bottom of door can create trapping condition  Remove door stop or any other element within bottom 10" of door
Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Basement - Non-Class Lab 011A  N/A  Y Coordinate: N/A  Classrooms  Door 10" Bottom Surface - Door Stop  2010 ADAS 404.2.10  Indard: No Quantity: EACH As-built: 2  Door stop interrupts min. 10" smooth bottom surface  Door stop at bottom of door can create trapping condition  Remove door stop or any other element within bottom 10" of door  1 Necessary Cost Est \$150.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 15C
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Non-Class Lab 011A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Electrical Switches - Max. 48" High
Code References:	2010 ADAS 308.2.1
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Light switch control box top edge not at max. 48" high
Findings:	50-1/2" high
Rec. Solution:	Relocate switch box top edge to max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 15D
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Non-Class Lab 011A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	
	Controls and Mechanisms
Barrier Type:	Actuator/Control - Side Reach High Unobstructed
Barrier Type: Code References:	
Code	Actuator/Control - Side Reach High Unobstructed  2010 ADAS 305.3
Code References:	Actuator/Control - Side Reach High Unobstructed  2010 ADAS 305.3
Code References: Performance Sta Barrier	Actuator/Control - Side Reach High Unobstructed  2010 ADAS 305.3  andard: No Quantity: EACH As-built: 1
Code References: Performance Sta Barrier Description:	Actuator/Control - Side Reach High Unobstructed  2010 ADAS 305.3  andard: No Quantity: EACH As-built: 1  Control or mechanism not at min. 15" or max. 48" high
Code References: Performance Sta Barrier Description: Findings:	Actuator/Control - Side Reach High Unobstructed  2010 ADAS 305.3  andard: No Quantity: EACH As-built: 1  Control or mechanism not at min. 15" or max. 48" high  Dial control 48-1/2" high and not fist operable  Replace control or mechanism at min. 15" or max. 48" high
Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Actuator/Control - Side Reach High Unobstructed  2010 ADAS 305.3  andard: No Quantity: EACH As-built: 1  Control or mechanism not at min. 15" or max. 48" high  Dial control 48-1/2" high and not fist operable  Replace control or mechanism at min. 15" or max. 48" high  3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 15E
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Non-Class Lab 011A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Workstation - Knee Clearance
Code References:	2010 ADAS 902
Performance Sta	indard: No Quantity: EACH As-built : 1
Barrier Description:	Knee clearance of at least 27" high, 30" wide and 8" deep not provided
Findings:	26-3/4" high and 20" wide knee clearance
Rec. Solution:	Replace workstation to provide access
Barrier Severity:	1 Necessary Cost Est \$875.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 15F
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Non-Class Lab 011A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Actuator or Control - Height
Code References:	2010 ADAS 305.3
Performance Sta	indard: No Quantity: EACH As-built : 2
Barrier Description:	Control or mechanism not at max. 48" high for side reach
Findings:	Telephone and printer 51" - 66-1/2" high
Rec. Solution:	Relocate controls or mechanisms to max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$1,500.00 Facility Function: Public Status: Open
Implementation	
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 15G
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Non-Class Lab 011A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Counters and Tables
Barrier Type:	Table - Knee Clearance
Code References:	2010 ADAS 305.3
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Knee clearance not min. 27" high, 19" deep or 30" wide
Findings:	24" knee clearance
Rec. Solution:	Provide min. 1 accessible table
Barrier Severity:	3 Hindrance Cost Est \$450.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 15H
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Non-Class Lab 011A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Laboratory Facilities
Barrier Type:	Counter - Surface
Code References:	2010 ADAS 902
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Counter or workstation surface height exceeds 34" high
Findings:	36-1/2" high
Rec. Solution:	Replace table or provide alternative accessible and integrated counter
Barrier Severity:	3 Hindrance Cost Est \$875.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 15I
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Non-Class Lab 011A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Counters and Tables
Barrier Type:	Counter - Knee Clearance
Code References:	2010 ADAS 305.3
Performance Sta	ndard: No Quantity: EACH As-built : 0
Barrier Description:	Knee clearance not min. 27" high, 19" deep or 30" wide
Findings:	No knee clearance
Rec. Solution:	Replace counter. Flip-up counters, adjacent tables and similar devices not permitted
Barrier Severity:	3 Hindrance Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 15J
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Non-Class Lab 011A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Laboratory Facilities
Barrier Type:	Sink - Rim or Countertop
Code References:	2010 ADAS 606.3
Performance Sta	ndard: No Quantity: LF As-built : 3
Barrier Description:	No accessible section of counter at max 34" high provided
Findings:	36-1/2" high
Rec. Solution:	Reposition existing sink or provide additional sink for use in area
Barrier Severity:	
	1 Necessary Cost Est \$1,110.00 Facility Function: Public Status: Open
Implementation	· — · — · — · — — ·



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 15K
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Non-Class Lab 011A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Laboratory Facilities
Barrier Type:	Sink - Depth  Derformance Standard
Code References:	Performance Standard
Performance Sta	andard: Yes Quantity: EACH As-built : 0
Barrier Description:	Sink depth exceeds 6-1/2" deep
Findings:	9-1/2" deep
Rec. Solution:	Replace sink
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 15L
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Non-Class Lab 011A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Laboratory Facilities
Barrier Type:	Sink - Knee Clearance
Code References:	2010 ADAS 606.2 & 306
Performance Sta	andard: No Quantity: EACH As-built : 0
Barrier Description:	Knee clearance of at least 27" high, 30" wide and 8" deep not provided
Findings:	No knee clearance
Rec. Solution:	Replace cabinet and remount sink
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Tacinty ranction. Fubile Status. Topen
implementation	Priority: 2 Implementation Phase: Implementation Date:



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 15M
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Non-Class Lab 011A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Clear Floor Space
Barrier Type:	Clear Floor Space - 60" Turning Circle
Code References:	2010 ADAS 304.3.1
Performance Sta	andard: No Quantity: SF As-built: 120
Barrier Description:	Clear floor space of min. 60" in diameter not provided where 360 degree turn is made
Findings:	47-1/2" turning space
Rec. Solution:	Remodel area to provide min. 60" turning space
Barrier Severity:	2 Recommended Cost Est \$21,000.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: Distance	e from counter to temporary wall
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 15N
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Non-Class Lab 011A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Laboratory Facilities
Barrier Type:	Alarm - Horn/Strobe
Code References:	2010 ADAS 702.1
Performance Sta	indard: No Quantity: EACH As-built : 1
Barrier Description:	Where a fire alarm is installed, no horn/strobe provided
Findings:	No device provided
Rec. Solution:	Provide horn/strobe in common use area
Barrier Severity:	1 Necessary Cost Est \$5,500.00 Facility Function: Public Status: Open
Implementation	
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 16A
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Conference Room 013A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	Permanent Room/Space - Tactile Characters
Code References:	2010 ADAS 216.2
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	At interior or exterior location, no tactile characters at sign identifying permanent rooms and spaces
Findings:	No tactile signage provided at door within public route
Rec. Solution:	Provide accessible sign
Barrier Severity:	1 Necessary Cost Est \$250.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 16B
Field Date: Bldg Name:	2/24/2014   Report Date   2/27/2014   Barrier #: 16B   Women's Building   Reference Dwg: 2 of 6
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Bldg Name: Location:	Women's Building Reference Dwg: 2 of 6  Basement - Conference Room 013A
Bldg Name: Location: X Coordinate:	Women's Building Reference Dwg: 2 of 6  Basement - Conference Room 013A  N/A Y Coordinate: N/A  Doors or Gates  Sliding Door Closer - Interior
Bldg Name: Location: X Coordinate: Barrier Area:	Women's Building Reference Dwg: 2 of 6  Basement - Conference Room 013A  N/A Y Coordinate: N/A  Doors or Gates
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code	Women's Building Reference Dwg: 2 of 6  Basement - Conference Room 013A  N/A Y Coordinate: N/A  Doors or Gates  Sliding Door Closer - Interior  2010 ADAS 404.2.9
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Women's Building Reference Dwg: 2 of 6  Basement - Conference Room 013A  N/A Y Coordinate: N/A  Doors or Gates  Sliding Door Closer - Interior  2010 ADAS 404.2.9
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Women's Building Reference Dwg: 2 of 6  Basement - Conference Room 013A  N/A Y Coordinate: N/A  Doors or Gates  Sliding Door Closer - Interior  2010 ADAS 404.2.9  andard: No Quantity: EACH As-built: 1
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance State Barrier Description:	Women's Building Reference Dwg: 2 of 6  Basement - Conference Room 013A  N/A Y Coordinate: N/A  Doors or Gates  Sliding Door Closer - Interior  2010 ADAS 404.2.9  andard: No Quantity: EACH As-built: 1  Door opening force exceeds 5 lbf
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Women's Building  Reference Dwg: 2 of 6  Basement - Conference Room 013A  N/A  Y Coordinate: N/A  Doors or Gates  Sliding Door Closer - Interior  2010 ADAS 404.2.9  andard: No Quantity: EACH As-built: 1  Door opening force exceeds 5 lbf  15 -25 lbf  Provide ISA directional signage indicating location of alternative accessible entry
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Women's Building Reference Dwg: 2 of 6  Basement - Conference Room 013A  N/A Y Coordinate: N/A  Doors or Gates  Sliding Door Closer - Interior  2010 ADAS 404.2.9  andard: No Quantity: EACH As-built: 1  Door opening force exceeds 5 lbf  15 -25 lbf  Provide ISA directional signage indicating location of alternative accessible entry  1 Necessary Cost Est \$250.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 16C
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Conference Room 013A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Hardware - Operation
Code References:	2010 ADAS 404.2.7
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Hardware not operable with a closed fist
Findings:	Hardware not operable with a closed fist
Rec. Solution:	Provide new hardware
Barrier Severity:	1 Necessary Cost Est \$300.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 16D
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Conference Room 013A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Electrical Switches - Max. 48" High
Code References:	2010 ADAS 308.2.1
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Light switch control box top edge not at max. 48" high
Findings:	48-1/2" high
Rec. Solution:	Relocate switch box top edge to max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	
Notes: Light sw	ritchs and fan dials



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 16E
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Conference Room 013A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Actuator or Control - Operation
Code References:	2010 ADAS 305.3
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Control or mechanism not usable with a closed fist
Findings:	Fan controls not fist operable
Rec. Solution:	Replace operating control
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 16F
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Conference Room 013A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Projector Screen Pull
Code References:	2010 ADAS 305.3
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Screen pull not at max. 48" high for side reach
Findings:	Projector screen pull 75" high
Rec. Solution:	Relocate to max. 48" high or provide extension
Barrier Severity:	3 Hindrance Cost Est \$75.00 Facility Function: Public Status: Open
Implementation	
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 16G O
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Conference Room 013A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Counters and Tables
Barrier Type:	Table - Knee Clearance
Code References:	2010 ADAS 305.3
Performance Sta	andard: No Quantity: EACH As-built : 0
Barrier Description:	Knee clearance not min. 27" high, 19" deep or 30" wide
Findings:	26-1/2" knee clearance
Rec. Solution:	Provide min. 1 accessible table
Barrier Severity:	3 Hindrance Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: 3 rows (	of tables in room with same knee clearance
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 16I
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Conference Room 013A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Workstation - Surface Max. 34"
Code References:	2010 ADAS 902
Performance Sta	andard: No Quantity: EACH As-built : 0
Barrier Description:	Workstation surface height exceeds 34" high
Findings:	45-1/2" surface height
Rec. Solution:	Replace workstation or provide alternative accessible workstation
Barrier Severity:	3 Hindrance Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	
	Priority: 2 Implementation Phase: Implementation Date:



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 16J
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Conference Room 013A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Workstation - Knee Clearance
Code References:	2010 ADAS 902
Performance Sta	ndard: No Quantity: EACH As-built : 0
Barrier Description:	Knee clearance of at least 27" high, 30" wide and 8" deep not provided
Findings:	No knee clearance
Rec. Solution:	Reposition workstation to provide knee clearance
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: 2 non-ad	ccessible PC computers and 1 printer
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 16K
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Conference Room 013A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Actuator/Control - Side Reach Obstructed (10"-24")
Code References:	2010 ADAS 305.3
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Control or mechanism over an 10" to 24" obstruction max. 34" high located above 46"
Findings:	Computer controls and printer over an obstruction 45-1/2""high
Rec. Solution:	Relocate controls or mechanisms
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	
	Priority: 2 Implementation Phase: Implementation Date:



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 16L
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Conference Room 013A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Clear Floor Space
Barrier Type:	Passageway - Min. 36" (Stored Item)
Code References:	2010 ADAS 403.5.1
Performance Sta	andard: No Quantity: JOB As-built : 1
Barrier Description:	Circulation route not min. 36" wide between elements
Findings:	35" wide circulation route between tables
Rec. Solution:	Move tables to provide accessible circulation route
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 16M
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Conference Room 013A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Alarms
Barrier Type:	Horn/Strobe
Code References:	2010 ADAS 702.1
nererences.	
Performance Sta	andard: No Quantity: EACH As-built : 1
	ndard: No Quantity: EACH As-built : 1  No horn/strobes in classroom
Performance Sta Barrier	
Performance Sta Barrier Description:	No horn/strobes in classroom
Performance Sta Barrier Description: Findings:	No horn/strobes in classroom  No device provided  Provide strobes in common use area
Performance Sta Barrier Description: Findings: Rec. Solution:	No horn/strobes in classroom  No device provided  Provide strobes in common use area  1 Necessary Cost Est \$5,500.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 17A
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Grad Student Office 013
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	Permanent Room/Space - Tactile Characters
Code References:	2010 ADAS 216.2
Performance Sta	ndard: No Quantity: EACH As-built : 2
Barrier Description:	At interior or exterior location, no tactile characters at sign identifying permanent rooms and spaces
Findings:	No tactile signage provided at doors within public route
Rec. Solution:	Provide accessible signs
Barrier Severity:	1 Necessary Cost Est \$500.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes: Two ent	ry doors
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 17B
Field Date: Bldg Name:	2/24/2014   Report Date   2/27/2014   Barrier #:   17B
Bldg Name:	Women's Building Reference Dwg: 2 of 6  Basement - Grad Student Office 013  N/A V Coordinate: N/A
Bldg Name: Location:	Women's Building Reference Dwg: 2 of 6  Basement - Grad Student Office 013
Bldg Name: Location: X Coordinate:	Women's Building Reference Dwg: 2 of 6  Basement - Grad Student Office 013  N/A Y Coordinate: N/A  Doors or Gates  Door Closer - Interior
Bldg Name: Location: X Coordinate: Barrier Area:	Women's Building Reference Dwg: 2 of 6  Basement - Grad Student Office 013  N/A Y Coordinate: N/A  Doors or Gates
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code	Women's Building Reference Dwg: 2 of 6  Basement - Grad Student Office 013  N/A Y Coordinate: N/A  Doors or Gates  Door Closer - Interior  2010 ADAS 404.2.9
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Women's Building Reference Dwg: 2 of 6  Basement - Grad Student Office 013  N/A Y Coordinate: N/A  Doors or Gates  Door Closer - Interior  2010 ADAS 404.2.9
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Women's Building Reference Dwg: 2 of 6  Basement - Grad Student Office 013  N/A Y Coordinate: N/A  Doors or Gates  Door Closer - Interior  2010 ADAS 404.2.9  Indard: No Quantity: EACH As-built: 1
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Women's Building   Reference Dwg:   2 of 6     Basement - Grad Student Office 013     N/A
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Women's Building  Reference Dwg: 2 of 6  Basement - Grad Student Office 013  N/A  Y Coordinate: N/A  Doors or Gates  Door Closer - Interior  2010 ADAS 404.2.9  Indard: No Quantity: EACH As-built: 1  Door opening force exceeds 5 lbf  Provide automatic door opening device at min. 1 entry door and ISA directional sign at other
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Women's Building  Reference Dwg: 2 of 6  Basement - Grad Student Office 013  N/A Y Coordinate: N/A  Doors or Gates  Door Closer - Interior  2010 ADAS 404.2.9  Indard: No Quantity: EACH As-built: 1  Door opening force exceeds 5 lbf  Provide automatic door opening device at min. 1 entry door and ISA directional sign at other  I Necessary Cost Est \$5,000.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 17C
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Grad Student Office 013
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Door Closer - Sweep Period
Code References:	2010 ADAS 404.2.8.1
Performance Sta	ndard: No Quantity: EACH As-built : 0
Barrier Description:	Door closer lacks min. 5 second sweep period
Findings:	4 second sweep
Rec. Solution:	Provide automatic door opening device at min. 1 entry door and ISA directional sign at other
Barrier Severity:	2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 17D
Field Date: Bldg Name:	2/24/2014   Report Date   2/27/2014   Barrier #:   17D     Women's Building   Reference Dwg:   2 of 6
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Bldg Name: Location:	Women's Building Reference Dwg: 2 of 6  Basement - Grad Student Office 013  N/A V Coordinate: N/A
Bldg Name: Location: X Coordinate:	Women's Building Reference Dwg: 2 of 6  Basement - Grad Student Office 013  N/A Y Coordinate: N/A  Doors or Gates  Hardware - Operation
Bldg Name: Location: X Coordinate: Barrier Area:	Women's Building Reference Dwg: 2 of 6  Basement - Grad Student Office 013  N/A Y Coordinate: N/A  Doors or Gates
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code	Women's Building Reference Dwg: 2 of 6  Basement - Grad Student Office 013  N/A Y Coordinate: N/A  Doors or Gates  Hardware - Operation  2010 ADAS 404.2.7
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Women's Building Reference Dwg: 2 of 6  Basement - Grad Student Office 013  N/A Y Coordinate: N/A  Doors or Gates  Hardware - Operation  2010 ADAS 404.2.7
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Women's Building Reference Dwg: 2 of 6  Basement - Grad Student Office 013  N/A Y Coordinate: N/A  Doors or Gates  Hardware - Operation  2010 ADAS 404.2.7  Indard: No Quantity: EACH As-built: 0
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Women's Building Reference Dwg: 2 of 6  Basement - Grad Student Office 013  N/A Y Coordinate: N/A  Doors or Gates  Hardware - Operation  2010 ADAS 404.2.7  Indard: No Quantity: EACH As-built: 0  Hardware not operable with a closed fist
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Women's Building Reference Dwg: 2 of 6  Basement - Grad Student Office 013  N/A Y Coordinate: N/A  Doors or Gates  Hardware - Operation  2010 ADAS 404.2.7  mdard: No Quantity: EACH As-built: 0  Hardware not operable with a closed fist  Hardware not operable with a closed fist  Provide automatic door opening device at min. 1 entry door and ISA directional sign at other
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Women's Building  Reference Dwg: 2 of 6  Basement - Grad Student Office 013  N/A Y Coordinate: N/A  Doors or Gates  Hardware - Operation  2010 ADAS 404.2.7  Indard: No Quantity: EACH As-built: 0  Hardware not operable with a closed fist  Hardware not operable with a closed fist  Provide automatic door opening device at min. 1 entry door and ISA directional sign at other  1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 17E
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Grad Student Office 013
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Door 10" Bottom Surface - Door Stop
Code References:	2010 ADAS 404.2.10
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Door stop interrupts min.10" smooth bottom surface
Findings:	Door stop at bottom of door can create trapping condition
Rec. Solution:	Remove door stop or any other element within bottom 10" of door
Barrier Severity:	1 Necessary Cost Est \$75.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
· · · · · · · · · · · · · · · · · · ·	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 17F
Field Date: Bldg Name:	2/24/2014Report Date2/27/2014Barrier #:17FWomen's BuildingReference Dwg:2 of 6
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Bldg Name: Location:	Women's Building Reference Dwg: 2 of 6  Basement - Grad Student Office 013
Bldg Name: Location: X Coordinate:	Women's Building  Reference Dwg: 2 of 6  Basement - Grad Student Office 013  N/A  Y Coordinate: N/A  Controls and Mechanisms  Electrical Switches - Height
Bldg Name: Location: X Coordinate: Barrier Area:	Women's Building Reference Dwg: 2 of 6  Basement - Grad Student Office 013  N/A Y Coordinate: N/A  Controls and Mechanisms
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code	Women's Building Reference Dwg: 2 of 6  Basement - Grad Student Office 013  N/A Y Coordinate: N/A  Controls and Mechanisms  Electrical Switches - Height  2010 ADAS 308.2.1
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Women's Building Reference Dwg: 2 of 6  Basement - Grad Student Office 013  N/A Y Coordinate: N/A  Controls and Mechanisms  Electrical Switches - Height  2010 ADAS 308.2.1
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Women's Building Reference Dwg: 2 of 6  Basement - Grad Student Office 013  N/A Y Coordinate: N/A  Controls and Mechanisms  Electrical Switches - Height  2010 ADAS 308.2.1  ndard: No Quantity: EACH As-built: 1
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Women's Building Reference Dwg: 2 of 6  Basement - Grad Student Office 013  N/A Y Coordinate: N/A  Controls and Mechanisms  Electrical Switches - Height  2010 ADAS 308.2.1  ndard: No Quantity: EACH As-built: 1  Light switch control box top edge not at max. 48" high
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Women's Building Reference Dwg: 2 of 6  Basement - Grad Student Office 013  N/A Y Coordinate: N/A  Controls and Mechanisms  Electrical Switches - Height  2010 ADAS 308.2.1  ndard: No Quantity: EACH As-built: 1  Light switch control box top edge not at max. 48" high
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Women's Building  Reference Dwg: 2 of 6  Basement - Grad Student Office 013  N/A Y Coordinate: N/A  Controls and Mechanisms  Electrical Switches - Height  2010 ADAS 308.2.1  Indard: No Quantity: EACH As-built: 1  Light switch control box top edge not at max. 48" high  50" high  Relocate switch box top edge to max. 48" high  3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 17G
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Grad Student Office 013
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Actuator or Control - Height
Code References:	2010 ADAS 305.3
Performance Sta	ndard: No Quantity: EACH As-built : 0
Barrier Description:	Control or mechanism not at max. 48" high for side reach
Findings:	Fan control 50" high and not fist operable
Rec. Solution:	Relocate control or mechanism to max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 17H
Field Date: Bldg Name:	2/24/2014   Report Date   2/27/2014   Barrier #:   17H
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Bldg Name: Location:	Women's Building Reference Dwg: 2 of 6  Basement - Grad Student Office 013  N/A  V Coordinate: N/A
Bldg Name: Location: X Coordinate:	Women's Building Reference Dwg: 2 of 6  Basement - Grad Student Office 013  N/A Y Coordinate: N/A  Controls and Mechanisms  Coat Hook - Height
Bldg Name: Location: X Coordinate: Barrier Area:	Women's Building Reference Dwg: 2 of 6  Basement - Grad Student Office 013  N/A Y Coordinate: N/A  Controls and Mechanisms
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code	Women's Building Reference Dwg: 2 of 6  Basement - Grad Student Office 013  N/A Y Coordinate: N/A  Controls and Mechanisms  Coat Hook - Height  2010 ADAS 603.4
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Women's Building Reference Dwg: 2 of 6  Basement - Grad Student Office 013  N/A Y Coordinate: N/A  Controls and Mechanisms  Coat Hook - Height  2010 ADAS 603.4
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Women's Building Reference Dwg: 2 of 6  Basement - Grad Student Office 013  N/A Y Coordinate: N/A  Controls and Mechanisms  Coat Hook - Height  2010 ADAS 603.4  Indard: No Quantity: EACH As-built: 1
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Women's Building Reference Dwg: 2 of 6  Basement - Grad Student Office 013  N/A Y Coordinate: N/A  Controls and Mechanisms  Coat Hook - Height  2010 ADAS 603.4  Indard: No Quantity: EACH As-built: 1  Clothing hooks not max. 48" high AFF
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Women's Building Reference Dwg: 2 of 6  Basement - Grad Student Office 013  N/A Y Coordinate: N/A  Controls and Mechanisms  Coat Hook - Height  2010 ADAS 603.4  Indard: No Quantity: EACH As-built: 1  Clothing hooks not max. 48" high AFF  59-1/2" high  Provide additional hook
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Women's Building Reference Dwg: 2 of 6  Basement - Grad Student Office 013  N/A Y Coordinate: N/A  Controls and Mechanisms  Coat Hook - Height  2010 ADAS 603.4  Indard: No Quantity: EACH As-built: 1  Clothing hooks not max. 48" high AFF  Fervide additional hook  2 Recommended Cost Est \$125.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 17I
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Grad Student Office 013
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Counters and Tables
Barrier Type:	Table - Knee Clearance
Code References:	2010 ADAS 305.3
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Knee clearance not min. 27" high, 19" deep or 30" wide
Findings:	26-1/2" knee clearance
Rec. Solution:	Provide min. 1 accessible work table
Barrier Severity:	3 Hindrance Cost Est \$450.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: Toe clea	arance is also blocked by stored items
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 17J
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Grad Student Office 013
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Electrical Outlets - Hi/Low Reach
Code References:	2010 ADAS 308.2.2
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Use of outlet involves low reach of less than 15" above floor or more than 48" high
Findings:	13-1/2" high
Rec. Solution:	Relocate outlet to area at min. 15" or max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 17K
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Grad Student Office 013
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Clear Floor Space
Barrier Type:	Passageway - Min. 36"
Code References:	2010 ADAS 403.5.1
Performance Sta	indard: No Quantity: LF As-built : 0
Barrier Description:	Circulation route not min. 36" wide between elements
Findings:	35-1/2" wide circulation route between wall and cubicles
Rec. Solution:	Rearrange cubicles to provide access
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: Betwee	n wall and cubicles
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 17L
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Grad Student Office 013
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Mailbox - High Reach Range
Code References:	2010 ADAS 308.2.2
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Mailboxes above 48" high
Findings:	48-1/2" to 50" high
Rec. Solution:	Relocate to provide opening at max. 48" high or provide assistance
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	
Notes:	Priority: 2 Implementation Phase: Implementation Date:



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 17M
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Grad Student Office 013
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Counters and Tables
Barrier Type:	Desk - Ratio
Code References:	2010 ADAS 902
Performance Sta	ndard: No Quantity: EACH As-built : 2
Barrier Description:	At least 1 desk or 5% of all desks are not accessible
Findings:	23 desks/study carrels provided. None are accessible
Rec. Solution:	Provide min. 2 accessible desk or workstation
Barrier Severity:	3 Hindrance Cost Est \$550.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 17N
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Grad Student Office 013
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Counters and Tables
Barrier Type:	Desk - Knee Clearance
Code References:	2010 ADAS 902.3
Performance Sta	ndard: No Quantity: EACH As-built : 0
Barrier Description:	Knee clearance not min. 27" high, 19" deep or 30" wide
Findings:	26-1/2" wide and 11-1/4" deep
Rec. Solution:	Provide min. 2 accessible desks or workstations
Barrier Severity:	3 Hindrance Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
	implementation rhase.



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 170
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Grad Student Office 013
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Shelves or Cabinets
Code References:	2010 ADAS 603.4
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Shelf or cabinet not mounted between 40" and 48" above floor or ground
Findings:	Shelf or cabinets not accessible
Rec. Solution:	Provide additional shelf at accessible height or provide assistance
Barrier Severity:	2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 17P
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Grad Student Office 013
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Actuator or Control - Height
Code References:	2010 ADAS 305.3
Performance Sta	ndard: No Quantity: EACH As-built : 2
Barrier Description:	Control or mechanism not at max. 48" high for side reach
Findings:	Lamps controls at 49" high
Rec. Solution:	Relocate controls or mechanisms to max. 48" high at accessible desks
Barrier Severity:	
Implementation	3 Hindrance Cost Est \$1,500.00 Facility Function: Public Status: Open
Implementation	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 17Q
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Grad Student Office 013
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Alarms
Barrier Type:	Horn/Strobe
Code References:	2010 ADAS 702.1
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	No horn/strobes in common use areas
Findings:	No device provided
Rec. Solution:	Provide strobes in common use area
Barrier Severity:	1 Necessary Cost Est \$5,500.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 18A
Field Date: Bldg Name:	2/24/2014   Report Date   2/27/2014   Barrier #:   18A
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Bldg Name: Location:	Women's Building Reference Dwg: 2 of 6  Basement - Waiting/Reception Area 012
Bldg Name: Location: X Coordinate:	Women's Building   Reference Dwg:   2 of 6     Basement - Waiting/Reception Area 012     N/A
Bldg Name: Location: X Coordinate: Barrier Area:	Women's Building Reference Dwg: 2 of 6  Basement - Waiting/Reception Area 012  N/A Y Coordinate: N/A  Signage
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code	Women's Building Reference Dwg: 2 of 6  Basement - Waiting/Reception Area 012  N/A Y Coordinate: N/A  Signage  Permanent Room/Space - Tactile Characters  2010 ADAS 216.2
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Women's Building Reference Dwg: 2 of 6  Basement - Waiting/Reception Area 012  N/A Y Coordinate: N/A  Signage  Permanent Room/Space - Tactile Characters  2010 ADAS 216.2
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Women's Building Reference Dwg: 2 of 6  Basement - Waiting/Reception Area 012  N/A Y Coordinate: N/A  Signage  Permanent Room/Space - Tactile Characters  2010 ADAS 216.2  At interior or exterior location, no tactile characters at sign identifying permanent rooms and
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Women's Building   Reference Dwg:   2 of 6     Basement - Waiting/Reception Area 012     N/A
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Women's Building Reference Dwg: 2 of 6  Basement - Waiting/Reception Area 012  N/A Y Coordinate: N/A  Signage  Permanent Room/Space - Tactile Characters  2010 ADAS 216.2  At interior or exterior location, no tactile characters at sign identifying permanent rooms and spaces  No tactile signage provided at doors within public route  Provide accessible signs
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Women's Building Reference Dwg: 2 of 6  Basement - Waiting/Reception Area 012  N/A Y Coordinate: N/A  Signage  Permanent Room/Space - Tactile Characters  2010 ADAS 216.2  At interior or exterior location, no tactile characters at sign identifying permanent rooms and spaces  No tactile signage provided at doors within public route  Provide accessible signs  1 Necessary Cost Est \$500.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 18B
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Waiting/Reception Area 012
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Hardware - Operation
Code References:	2010 ADAS 404.2.7
Performance Sta	indard: No Quantity: EACH As-built : 2
Barrier Description:	Hardware not operable with a closed fist
Findings:	Hardware not operable with a closed fist
Rec. Solution:	Provide new hardware
Barrier Severity:	1 Necessary Cost Est \$600.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 18C
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Bldg Name: Location:	Women's Building   Reference Dwg:   2 of 6
Location:	Basement - Waiting/Reception Area 012
Location: X Coordinate:	Basement - Waiting/Reception Area 012  N/A  Y Coordinate: N/A  Doors or Gates  Door 10" Bottom Surface - Kickplate
Location: X Coordinate: Barrier Area:	Basement - Waiting/Reception Area 012  N/A  Y Coordinate: N/A  Doors or Gates
Location: X Coordinate: Barrier Area: Barrier Type: Code	Basement - Waiting/Reception Area 012  N/A  Y Coordinate: N/A  Doors or Gates  Door 10" Bottom Surface - Kickplate  2010 ADAS 404.2.10
Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Basement - Waiting/Reception Area 012  N/A  Y Coordinate: N/A  Doors or Gates  Door 10" Bottom Surface - Kickplate  2010 ADAS 404.2.10
Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Basement - Waiting/Reception Area 012  N/A  Y Coordinate: N/A  Doors or Gates  Door 10" Bottom Surface - Kickplate  2010 ADAS 404.2.10  andard: No Quantity: EACH As-built: 1
Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Basement - Waiting/Reception Area 012  N/A  Y Coordinate: N/A  Doors or Gates  Door 10" Bottom Surface - Kickplate  2010 ADAS 404.2.10  andard: No Quantity: EACH As-built: 1  Door/Gate lacks min. 10" smooth uninterrupted bottom surface
Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Basement - Waiting/Reception Area 012  N/A  Y Coordinate: N/A  Doors or Gates  Door 10" Bottom Surface - Kickplate  2010 ADAS 404.2.10  andard: No Quantity: EACH As-built: 1  Door/Gate lacks min. 10" smooth uninterrupted bottom surface  Bottom of one door not smooth and uninterrupted  Remove door stop or any other element within bottom 10" of door
Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Basement - Waiting/Reception Area 012  N/A  Y Coordinate: N/A  Doors or Gates  Door 10" Bottom Surface - Kickplate  2010 ADAS 404.2.10  Indard: No Quantity: EACH As-built: 1  Door/Gate lacks min. 10" smooth uninterrupted bottom surface  Bottom of one door not smooth and uninterrupted  Remove door stop or any other element within bottom 10" of door  1 Necessary Cost Est \$225.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 18D
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Waiting/Reception Area 012
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Electrical Switches - Height
Code References:	2010 ADAS 308.2.1
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Light switch control box top edge not at max. 48" high
Findings:	50-1/2" high
Rec. Solution:	Relocate switch box top edge to max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 18E
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Waiting/Reception Area 012
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Clear Floor Space
Barrier Type:	Accessible Route - Stored Elements
Code References:	2010 ADAS 305.3
Performance Sta	andard: No Quantity: JOB As-built: 1
Barrier Description:	Clear floor space does not adjoin an accessible route or another space
Findings:	No clear floor space not provided in room
Rec. Solution:	Relocate items to provide accessible route
	Inclocate items to provide accessible route
Barrier Severity:	
Barrier Severity: Implementation	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 18F
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Waiting/Reception Area 012
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Alarms
Barrier Type:	Horn/Strobe
Code References:	2010 ADAS 702.1
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	No horn/strobes in common use areas
Findings:	No device provided
Rec. Solution:	Provide strobes in common use area
Barrier Severity:	1 Necessary Cost Est \$5,500.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 19A
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Activity Classroom 009
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Permanent Room/Space - Tactile Characters
Code References:	2010 ADAS 216.2
Performance Sta	andard: No Quantity: EACH As-built: 1
Barrier Description:	At interior or exterior location, no tactile characters at sign identifying permanent rooms and spaces
Findings:	No tactile signage provided at door within public route
Rec. Solution:	Provide accessible sign
Barrier Severity:	1 Necessary Cost Est \$250.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 19B
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Activity Classroom 009
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Hardware - Operation
Code References:	2010 ADAS 404.2.7
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Hardware not operable with a closed fist
Findings:	Hardware not operable with a closed fist
Rec. Solution:	Provide new hardware
Barrier Severity:	1 Necessary Cost Est \$300.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 19C
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Activity Classroom 009
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Door Clear Width - Min. 32"
Code References:	2010 ADAS 404.2.3
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Door clear width is not min. 32"
Findings:	27-1/2" clear width
Rec. Solution:	Replace door/gate and frame
Barrier Severity:	1 Necessary Cost Est \$2,250.00 Facility Function: Public Status: Open
Implementation	
	Priority: 2 Implementation Phase: Implementation Date:



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 19D
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Activity Classroom 009
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Threshold - Height exceeding 1/4" without bevel
Code References:	2010 ADAS 404.2.5
Performance Sta	ndard: No Quantity: EACH As-built : 2
Barrier Description:	Door/Gate threshold exceeds 1/4" in height withouth a bevel
Findings:	3/4" high lip with a slope of 7.5%
Rec. Solution:	Provide new door threshold at double doors
Barrier Severity:	1 Necessary Cost Est \$550.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 19E
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Activity Classroom 009
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Area: Barrier Type:	Electrical Switches - Max. 48" High
Barrier Type: Code	Electrical Switches - Max. 48" High 2010 ADAS 308.2.1
Barrier Type: Code References:	Electrical Switches - Max. 48" High 2010 ADAS 308.2.1
Barrier Type: Code References: Performance Sta Barrier	Electrical Switches - Max. 48" High  2010 ADAS 308.2.1  ndard: No Quantity: EACH As-built: 1
Barrier Type: Code References: Performance Sta Barrier Description:	Electrical Switches - Max. 48" High  2010 ADAS 308.2.1  ndard: No Quantity: EACH As-built: 1  Light switch control box top edge not at max. 48" high
Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Electrical Switches - Max. 48" High  2010 ADAS 308.2.1  ndard: No Quantity: EACH As-built: 1  Light switch control box top edge not at max. 48" high  49" high
Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Electrical Switches - Max. 48" High  2010 ADAS 308.2.1  ndard: No Quantity: EACH As-built: 1  Light switch control box top edge not at max. 48" high  49" high  Relocate switch box top edge to max. 48" high  3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 19F
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Activity Classroom 009
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Actuator or Control - Height
Code References:	2010 ADAS 305.3
Performance Sta	andard: No Quantity: EACH As-built : 2
Barrier Description:	Control or mechanism not at max. 48" high for side reach
Findings:	Soap dispenser 56" high and first aid kit 62" high
Rec. Solution:	Relocate control or mechanism to max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$1,500.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 19G
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Activity Classroom 009
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	First Aid Kit - Opening Mechanism
Code References:	2010 ADAS 305.3
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Opening mechanism on first aid kit not usable with a closed fist
Findings:	Mechanism not fist operable
Findings: Rec. Solution:	Mechanism not fist operable  Replace operating control
-	Replace operating control
Rec. Solution:	Replace operating control  1 Necessary Cost Est \$275.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 19H
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Activity Classroom 009
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Desk - Knee Clearance
Code References:	2010 ADAS 902
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Knee clearance of at least 27" high, 30" wide and 8" deep not provided
Findings:	24" knee clearance
Rec. Solution:	Reposition desk to provide knee clearance
Barrier Severity:	1 Necessary Cost Est \$450.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 19I
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Activity Classroom 009
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Actuator or Control - Height
Code References:	2010 ADAS 305.3
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Control or mechanism not at max. 48" high for side reach
Findings:	Pencil sharpener 55" high
Rec. Solution:	Relocate control or mechanism to max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 19J
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Activity Classroom 009
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Type:	Handrail - Both Sides
Code References:	2010 ADAS 505.10.2
Performance Sta	ndard: No Quantity: LF As-built: 16
Barrier Description:	No handrail provided at both sides of stairway
Findings:	No handrail provided at both sides within seating
Rec. Solution:	Provide handrails at both sides of stairway
Barrier Severity:	2 Recommended Cost Est \$3,600.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes: Bleache	r seating at entry
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 19K
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Activity Classroom 009
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Type:	Riser Height - Existing
Code References:	2010 ADAS 504.2
Performance Sta	indard: No Quantity: SF As-built: 0
Barrier Description:	Stair riser height is not between 4" and 7"
Findings:	10-1/2" stair riser height at upper stairs
Rec. Solution:	No remediation recommended. Stairway technically infeasible to alter
Barrier Severity:	4 Low Severity Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes: First ste	p is 10-1/2" high. All others between 4"-7"



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 19L
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Activity Classroom 009
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Assembly Areas
Barrier Type:	Wheelchair Clear Space
Code References:	2010 ADAS 802.1.2
Performance Sta	ndard: Quantity: SF As-built: 50
Barrier Description:	Area for wheelchair spaces lacks 36" wide space for a single seat
Findings:	50 bleacher seats estimated. No accessible seating provided
Rec. Solution:	Provide integrated accessible seating
Barrier Severity:	2 Recommended Cost Est \$13,750.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 19M
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Activity Classroom 009
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Passageway - Min. 36" (Stored Item)
Code References:	2010 ADAS 403.5.1
Performance Sta	ndard: No Quantity: JOB As-built : 20
Barrier Description:	Passageway is not min. 36" wide
Findings:	Circulation route not min. 36" at one of each type of equipment
Rec. Solution:	Rearrange equipment to provide access
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: 20 differ	rent types of equipment



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 19N
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Activity Classroom 009
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	Visual Information Provided (Exhibitions)
Code References:	ADA Title II Technical Assistance Manual 3.2000 Denial of participation
Performance Sta	ndard: No Quantity: JOB As-built : 1
Barrier Description:	Visual sign providing information for program, service or activity not accessible
Findings:	Accessible signs not provided
Rec. Solution:	Provide information in alternate format to provide access to people with vision impairments
Barrier Severity:	1 Necessary Cost Est \$5,000.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes: 29 - wor	rkoutstations numbered on walls around equipment throughout the room
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 190
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Activity Classroom 009
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Corridors
Barrier Type:	Bench - Seat Height
Code References:	2010 ADAS 903.5
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Bench seat 17" to 19" above ground
	benefit seat 17 to 15 above ground
Findings:	11-3/4" high and 11-1/4" deep
Findings: Rec. Solution:	
_	11-3/4" high and 11-1/4" deep  Provide min. one accessible bench
Rec. Solution:	11-3/4" high and 11-1/4" deep  Provide min. one accessible bench  3 Hindrance Cost Est \$1,100.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 19P
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Activity Classroom 009
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Alarm - Horn/Strobe
Code References:	2010 ADAS 702.1
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Where a fire alarm is installed, no horn/strobe provided
Findings:	No device provided
Rec. Solution:	Provide horn/strobe in common use area
Barrier Severity:	1 Necessary Cost Est \$5,500.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 20A
Field Date: Bldg Name:	2/24/2014 Report Date 2/27/2014 Barrier #: 20A  Women's Building Reference Dwg: 2 of 6
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Bldg Name: Location:	Women's Building Reference Dwg: 2 of 6  Basement - Women's Faculty Locker Room 007F
Bldg Name: Location: X Coordinate:	Women's Building Reference Dwg: 2 of 6  Basement - Women's Faculty Locker Room 007F  N/A Y Coordinate: N/A
Bldg Name: Location: X Coordinate: Barrier Area:	Women's Building Reference Dwg: 2 of 6  Basement - Women's Faculty Locker Room 007F  N/A Y Coordinate: N/A  Signage
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code	Women's Building Reference Dwg: 2 of 6  Basement - Women's Faculty Locker Room 007F  N/A Y Coordinate: N/A  Signage  Permanent Room/Space - Tactile Characters  2010 ADAS 216.2
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Women's Building Reference Dwg: 2 of 6  Basement - Women's Faculty Locker Room 007F  N/A Y Coordinate: N/A  Signage  Permanent Room/Space - Tactile Characters  2010 ADAS 216.2
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Women's Building Reference Dwg: 2 of 6  Basement - Women's Faculty Locker Room 007F  N/A Y Coordinate: N/A  Signage  Permanent Room/Space - Tactile Characters  2010 ADAS 216.2  ndard: No Quantity: EACH As-built: 1
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Women's Building Reference Dwg: 2 of 6  Basement - Women's Faculty Locker Room 007F  N/A Y Coordinate: N/A  Signage  Permanent Room/Space - Tactile Characters  2010 ADAS 216.2  ndard: No Quantity: EACH As-built: 1  No tactile characters at sign identifying permanent rooms and spaces with visual signs
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Women's Building Reference Dwg: 2 of 6  Basement - Women's Faculty Locker Room 007F  N/A Y Coordinate: N/A  Signage  Permanent Room/Space - Tactile Characters  2010 ADAS 216.2  ndard: No Quantity: EACH As-built: 1  No tactile characters at sign identifying permanent rooms and spaces with visual signs  No tactile signage provided at door within public route
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Women's Building Reference Dwg: 2 of 6  Basement - Women's Faculty Locker Room 007F  N/A Y Coordinate: N/A  Signage  Permanent Room/Space - Tactile Characters  2010 ADAS 216.2  ndard: No Quantity: EACH As-built: 1  No tactile characters at sign identifying permanent rooms and spaces with visual signs  No tactile signage provided at door within public route  Provide accessible sign  1 Necessary Cost Est \$250.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 20B
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Women's Faculty Locker Room 007F
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Door Closer - Interior
Code References:	2010 ADAS 404.2.9
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Door opening force exceeds 5 lbf
Findings:	13 lbf
Rec. Solution:	Provide automatic door opening device
Barrier Severity:	1 Necessary Cost Est \$5,000.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 20C
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Women's Faculty Locker Room 007F
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Door Closer - Interior Closing Speed ADA
Code References:	2010 ADAS 404.2.8.1
Performance Sta	indard: No Quantity: EACH As-built: 0
Barrier Description:	Door closer lacks min. 5 second sweep period/back check
Findings:	3 second sweep
Rec. Solution:	Provide automatic door opening device
Barrier Severity:	2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	· · ·
	Priority: 3 Implementation Phase: Implementation Date:



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 20D
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Women's Faculty Locker Room 007F
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Hardware - Operation
Code References:	2010 ADAS 404.2.7
Performance Sta	ndard: No Quantity: EACH As-built : 0
Barrier Description:	Hardware not operable with a closed fist
Findings:	Hardware not operable with a closed fist
Rec. Solution:	Provide automatic door opening device
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 20E
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Women's Faculty Locker Room 007F
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Front App/push 12" SEC
Code References:	2010 ADAS Figure 404.2.4.1
Performance Sta	
	ndard: No Quantity: EACH As-built : 0
Barrier Description:	Door/Gate at push side with min. 48" lacks min. 12" strike edge clearance with latch/closer
Description:	Door/Gate at push side with min. 48" lacks min. 12" strike edge clearance with latch/closer
Description: Findings:	Door/Gate at push side with min. 48" lacks min. 12" strike edge clearance with latch/closer  Lockers block strike edge clearance at entry  Provide automatic door opening device
Description: Findings: Rec. Solution:	Door/Gate at push side with min. 48" lacks min. 12" strike edge clearance with latch/closer  Lockers block strike edge clearance at entry  Provide automatic door opening device  1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 20F
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Women's Faculty Locker Room 007F
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Electrical Switches - Height
Code References:	2010 ADAS 308.2
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Light switch control box top edge not at max. 48" high
Findings:	51-1/2" high
Rec. Solution:	Relocate switch box top edge to max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 20G
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Women's Faculty Locker Room 007F
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Counters and Tables
Barrier Type:	Counter - Surface Height
Code References:	2010 ADAS 902.3
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	No section at least 3 feet long between 28" and 34" provided at existing counter
Findings:	36" high
Rec. Solution:	Provide min. 3 ft long section of counter at max. 34" high
Barrier Severity:	3 Hindrance Cost Est \$875.00 Facility Function: Public Status: Open
Implementation	<u> </u>
	Priority: 3 Implementation Phase: Implementation Date:



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 20H
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Women's Faculty Locker Room 007F
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Actuator/Control - Hi/low Reach
Code References:	2010 ADAS 308.2.2
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Use of control involves low reach of less than 15" above floor or more than 48" high
Findings:	Hair dryer 66" high
Rec. Solution:	Relocate to area at min. 15" or max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 20I
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Women's Faculty Locker Room 007F
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Lockers - Ratio
Code References:	2010 ADAS 803
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	No accessible locker provided in locker room
Findings:	22 lockers provided. Controls not fist operable
Rec. Solution:	Provide min. 1 accessible locker or 5% overall
Barrier Severity:	1 Necessary Cost Est \$450.00 Facility Function: Public Status: Open
Implementation	
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 20J
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Location:	Basement - Women's Faculty Locker Room 007F
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Lockers - Bench Length
Code References:	2010 ADAS 803.4
Performance Sta	indard: No Quantity: EACH As-built : 1
Barrier Description:	Bench provided at lockers not min. 24" x 48" and affixed to a wall
Findings:	No bench provided at lockers for use by persons using mobility assist devices
Rec. Solution:	Provide accessible bench at accessble locker
Barrier Severity:	2 Recommended Cost Est \$650.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 20K
Field Date: Bldg Name:	2/24/2014   Report Date   2/27/2014   Barrier #:   20K
Bldg Name:	Women's Building Reference Dwg: 2 of 6
Bldg Name: Location:	Women's Building   Reference Dwg:   2 of 6
Bldg Name: Location: X Coordinate:	Women's Building Reference Dwg: 2 of 6  Basement - Women's Faculty Locker Room 007F  N/A Y Coordinate: N/A
Bldg Name: Location: X Coordinate: Barrier Area:	Women's Building Reference Dwg: 2 of 6  Basement - Women's Faculty Locker Room 007F  N/A Y Coordinate: N/A  Alarms
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code	Women's Building Reference Dwg: 2 of 6  Basement - Women's Faculty Locker Room 007F  N/A Y Coordinate: N/A  Alarms  Horn/Strobe - Common Use Area  2010 ADAS 702.1
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Women's Building Reference Dwg: 2 of 6  Basement - Women's Faculty Locker Room 007F  N/A Y Coordinate: N/A  Alarms  Horn/Strobe - Common Use Area  2010 ADAS 702.1
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Women's Building Reference Dwg: 2 of 6  Basement - Women's Faculty Locker Room 007F  N/A Y Coordinate: N/A  Alarms  Horn/Strobe - Common Use Area  2010 ADAS 702.1  Indard: No Quantity: EACH As-built: 1
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Women's Building  Reference Dwg: 2 of 6  Basement - Women's Faculty Locker Room 007F  N/A  Y Coordinate: N/A  Alarms  Horn/Strobe - Common Use Area  2010 ADAS 702.1  Indard: No Quantity: EACH As-built: 1  No horn/strobes in common use areas
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Women's Building  Reference Dwg: 2 of 6  Basement - Women's Faculty Locker Room 007F  N/A  Y Coordinate: N/A  Alarms  Horn/Strobe - Common Use Area  2010 ADAS 702.1  Indard: No Quantity: EACH As-built: 1  No horn/strobes in common use areas  No device provided  Provide strobe in common use area
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Women's Building Reference Dwg: 2 of 6  Basement - Women's Faculty Locker Room 007F  N/A Y Coordinate: N/A  Alarms  Horn/Strobe - Common Use Area  2010 ADAS 702.1  Indard: No Quantity: EACH As-built: 1  No horn/strobes in common use areas  No device provided  Provide strobe in common use area  1 Necessary Cost Est \$5,500.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 21A
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Women's Faculty Restroom 007G
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	ISA - Accessible Toilet Room
Code References:	2010 ADAS 216.6
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	No sign identifying toilet room door/doorway as accessible
Findings:	Accessible sign not provided
Rec. Solution:	Provide ISA at accessible entrance door
Barrier Severity:	1 Necessary Cost Est \$250.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes: No door	provided at doorway into toilet/shower room. No signage provided at doorway
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 21B
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Women's Faculty Restroom 007G
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Lavatory - Ratio
Code References:	2010 ADAS 213.3.4
Performance Sta	ndard: No Quantity: JOB As-built : 1
Barrier Description:	Where at least one lavatory is provided, one is not accessible
Findings:	Lavatory provided not accessible
Rec. Solution:	Provide additionl accessible lavatory
Barrier Severity:	1 Necessary Cost Est \$450.00 Facility Function: Public Status: Open
Implementation	
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 21C
Bldg Name:	Women's Building
Location:	Basement - Women's Faculty Restroom 007G
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Mirror
Code References:	2010 ADAS 603.3
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Mirror at lavatory/countertop not max. 40" AFF at edge of reflecting surface
Findings:	56" high
Rec. Solution:	Replace or remount mirror
Barrier Severity:	3 Hindrance Cost Est \$375.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 21D
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Women's Faculty Restroom 007G
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Maneuvering Clearance - 60" Circle
Code References:	2010 ADAS 603.2.1
Performance Sta	andard: No Quantity: SF As-built : 80
Barrier Description:	No 60" turning circle provided in toilet facility (min. 27" high above floor)
Findings:	60" turning circle not provided
Rec. Solution:	Remodel toilet room
Barrier Severity:	2 Recommended Cost Est \$46,000.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 21E
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Women's Faculty Restroom 007G
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Toilet - Clear Space
Code References:	2010 ADAS 604.3.1 & 604.8.1.1
Performance Sta	andard: No Quantity: JOB As-built : 1
Barrier Description:	Water closet clear space not min. 60" measured wall-to-wall
Findings:	32" wide stall
Rec. Solution:	Provide new stall partition
Barrier Severity:	2 Recommended Cost Est \$850.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 21F
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Women's Faculty Restroom 007G
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	RR-showers RR-showers
Barrier Type:	Shower - No Access
Code References:	2010 ADAS 806.2.4
Performance Sta	andard: No Quantity: JOB As-built : 1
Barrier Description:	Shower provided not accessible due to curb at entry
Findings:	Curb at entry to shower stalls
	,
Rec. Solution:	Provide min. one accessible shower
Rec. Solution: Barrier Severity:	
	2 Recommended Cost Est \$1,625.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 21G
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Women's Faculty Restroom 007G
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Showers
Barrier Type:	Accessible Route
Code References:	2010 ADAS 402 & 403
Performance Sta	ndard: No Quantity: SF As-built : 1
Barrier Description:	Accessible route not provided to shower (min. 36" clear width)
Findings:	Entry doorway 28" wide
Rec. Solution:	Relocate restroom or redesign
Barrier Severity:	1 Necessary Cost Est \$575.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 21H
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Women's Faculty Restroom 007G
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Alarm - Horn/Strobe
Code References:	2010 ADAS 702.1
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Where a fire alarm is installed, no horn/strobe provided
Findings:	No device provided
Rec. Solution:	Provide horn/strobe in common use area
Barrier Severity:	1 Necessary Cost Est \$5,500.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes:	Thority. I



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 22A CLEATS
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Women's Locker Room 007
X Coordinate:	N/A Y Coordinate: N/A WOMEN
Barrier Area:	Signage
Barrier Type:	Location - 48" to 60" high
Code References:	2010 ADAS 703.4.1
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Braille/Tactile information on sign not mounted between 48" and 60" from ground or floor
Findings:	63" high
Rec. Solution:	Provide accessible sign and mount at proper height
Barrier Severity:	1 Necessary Cost Est \$250.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
	aille not 3/8" and max. 1/2" directly below the tactile characters and text descriptors not directly below pictogram
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 22B
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Women's Locker Room 007
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Electrical Switches - Height
Code References:	2010 ADAS 308.2
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Light switch control box top edge not at max. 48" high
Findings:	51" high
Rec. Solution:	Relocate switch box top edge to max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 22C
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Women's Locker Room 007
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	ISA - Accessible Entry Door
Code References:	2010 ADAS 216.6
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	No sign identifying door as accessible where all doors are not accessible
Findings:	Accessible sign not provided
Rec. Solution:	Provide ISA at accessible entrance door
Barrier Severity:	1 Necessary Cost Est \$250.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes: ADOD @	inside of entry door has no ISA
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 22D
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Women's Locker Room 007
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Lockers - Ratio
Code References:	2010 ADAS 803
Performance Sta	ndard: No Quantity: EACH As-built : 13
Barrier Description:	No accessible locker provided in locker room
Findings:	Locker controls not fist operable
Rec. Solution:	Provide accessible lockers of each type. 5% of all overall should be accessible
Barrier Severity:	1 Necessary Cost Est \$5,850.00 Facility Function: Public Status: Open
Implementation	
Notes: 40 lg loc	kers, 12 half sized. 210 small lockers



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 22E
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Women's Locker Room 007
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Lockers - Maneuvering Cl
Code References:	2010 ADAS 803.2
Performance Sta	andard: No Quantity: EACH As-built : 13
Barrier Description:	No 60" maneuvering clearance provided at locker or bench
Findings:	60" maneuvering clearance not provided at any of the lockers
Rec. Solution:	Remodel to provide access at each acessible locker
Barrier Severity:	2 Recommended Cost Est \$8,450.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes: 40 lg lo	ckers, 12 half sized. 210 small lockers
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 22F
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Women's Locker Room 007
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Lockers - Bench Length
Code References:	2010 ADAS 803.4
Performance Sta	andard: No Quantity: EACH As-built : 3
Barrier Description:	Bench provided at lockers not min. 24" x 48" and affixed to a wall
Findings:	11" deep benches in dressing section of locker room
Rec. Solution:	Provide accessible bench at accessble locker
Barrier Severity:	2 Recommended Cost Est \$3,300.00 Facility Function: Public Status: Open
Implementation	
	Priority: 3 Implementation Phase: Implementation Date:



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 22G
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Women's Locker Room 007
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Weighing Scale - Clear Floor Space
Code References:	2010 ADAS 305
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Clear floor space of min. 30" by 48" not provided at public scale
Findings:	Scale not wheelchair accessible
Rec. Solution:	Replace scale to provide access for people with mobility impairments
Barrier Severity:	2 Recommended Cost Est \$675.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 23A
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Exit Corridor 007C
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Corridors
Barrier Type:	Protruding Object
Code References:	2010 ADAS 307
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Protruding object in in circulation path protrudes more than 4" between 27" and 80" high
Findings:	Drop box protrudes 9-1/2" at 47" high
Rec. Solution:	Remove object or provide detectable warning (wing walls)
Barrier Severity:	1 Necessary Cost Est \$550.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 23B
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Exit Corridor 007C
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Corridors
Barrier Type:	Bench - Seat Depth
Code References:	2010 ADAS 903.3
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Bench seat not 20" to 24" deep
Findings:	Bench not accessible in vestibule leading to pool
Rec. Solution:	Provide min. one accessible bench
Barrier Severity:	3 Hindrance Cost Est \$1,100.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 23C
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Exit Corridor 007C
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Corridors
Barrier Type:	Sign - Tactile Exit Sign at Door
Code References:	2010 ADAS 216.4.1
Performance Sta	ndard: No Quantity: EACH As-built : 2
Barrier Description:	Ground floor doors that exit directly to the exterior lacks tactile exit sign
Findings:	Accessible signs not provided
Rec. Solution:	Provide new signs stating "EXIT" at exiting side of door
Barrier Severity:	1 Necessary Cost Est \$500.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 23D
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Exit Corridor 007C
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Door Closer - Exterior
Code References:	Performance Standard
Performance Sta	ndard: Yes Quantity: EACH As-built : 1
Barrier Description:	Door opening force exceeds 8.5 lbf
Findings:	Door force and sweep could not be measured due to construction
Rec. Solution:	Provide automatic door opening device when in use
Barrier Severity:	1 Necessary Cost Est \$5,000.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: Due to o	construction, door opening force could not be measured. Likely to exceed 8.5lbf
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 23E
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Exit Corridor 007C
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Doormat
Code References:	2010 ADAS 302.2 & Advisory 302.2
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Doormat not anchored to floor (possible trip hazard)
Findings:	Doormat not secured
Rec. Solution:	Secure exiting doormat or replace
Barrier Severity:	1 Necessary Cost Est \$500.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 24A
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement -Women's Restroom 007A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Clear Width
Code References:	2010 ADAS 404.2.3
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Clear width passage through door, sliding/folding door or gate is not min. 32"
Findings:	29" clear width in doorway from corridor
Rec. Solution:	Alter doorway or provide ISA directional sign with route to and location of accessible entry
Barrier Severity:	1 Necessary Cost Est \$2,250.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes: Accessik	ole entry located on path of travel to shower room and pool
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 24B
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement -Women's Restroom 007A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Electrical Switches
Code References:	2010 ADAS 205.1 & 309.3
Performance Sta	ndard: No Quantity: EACH As-built: 1
Barrier Description:	Light switch control box top edge not at max. 48" high
Findings:	Switch higher than max 48" high
Rec. Solution:	Relocate switch box top edge to max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 24C
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement -Women's Restroom 007A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Bench - Seat Height/Depth
Code References:	2010 ADAS 903.3
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Bench seat not 20" to 24" deep and height not 17" to 19" above ground
Findings:	12" deep bench seat not accessible
Rec. Solution:	Provide min. one accessible bench
Barrier Severity:	3 Hindrance Cost Est \$1,100.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 24D
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement -Women's Restroom 007A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Sink - Rim or Countertop
Code References:	2010 ADAS 606.3
Performance Sta	ndard: No Quantity: LF As-built : 1
Barrier Description:	Sink rim or surface not max. 34" high
Findings:	36" high at wash sink
Rec. Solution:	Provide additional accessible sink for use in area
Barrier Severity:	1 Necessary Cost Est \$370.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 24E
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement -Women's Restroom 007A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Sink - Knee Clearance
Code References:	2010 ADAS 606.2 & 306
Performance Sta	andard: No Quantity: EACH As-built : 0
Barrier Description:	Knee clearance of at least 27" high, 19" deep and 30" wide not provided
Findings:	22" knee clearance at wash sink
Rec. Solution:	Provide additional accessible sink for use in area
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 24F
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement -Women's Restroom 007A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Counters and Tables
Barrier Type:	Counter - Protruding Object
Code References:	2010 ADAS 307
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Counter or table in route of travel protrudes more than 4" above 27" high
Findings:	Sink counter protrudes more than 4" at 36" high along counter side of fixture
Rec. Solution:	Provide detectable warning for the visually impaired
Barrier Severity:	1 Necessary Cost Est \$875.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 24G
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement -Women's Restroom 007A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Lavatory - Knee Clearance
Code References:	2010 ADAS 606.2 & 306
Performance Sta	ndard: No Quantity: JOB As-built : 1
Barrier Description:	Lavatory bottom apron/edge not max 29" reducing to 27" at 8" back from edge
Findings:	25" knee clearance
Rec. Solution:	Provide min. one accessible lavatory
Barrier Severity:	1 Necessary Cost Est \$450.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes: 3 lavato	ries provided. None are accessible
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 24H
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement -Women's Restroom 007A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Dispensers - Sanitary Products
Code References:	2010 ADAS 603.3
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Feminine product dispenser does not operate at 5 lbf or less
Findings:	Dispenser not fist operable
Rec. Solution:	Replace dispenser
Barrier Severity:	1 Necessary Cost Est \$650.00 Facility Function: Public Status: Open
Implementation	
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 24I
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement -Women's Restroom 007A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Toilet - Clear Space
Code References:	2010 ADAS 604.3.1 & 604.8.1.1
Performance Sta	andard: No Quantity: JOB As-built : 1
Barrier Description:	Water closet clear space not min. 60" measured wall-to-wall
Findings:	59-1/2" wide by 54" deep
Rec. Solution:	Provide new stall partition
Barrier Severity:	2 Recommended Cost Est \$850.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 24J
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement -Women's Restroom 007A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Stall Door Closer - Not Self-closing
Code References:	2010 ADAS 604.8.1.2
Performance Sta	andard: No Quantity: JOB As-built : 1
Barrier Description:	Stall door does not self-close
Findings:	Door does not self-close
Findings:	Door does not self-close  Replace compartment closing mechanism with adjustible mechanism
J	Replace compartment closing mechanism with adjustible mechanism
Rec. Solution:	Replace compartment closing mechanism with adjustible mechanism  2 Recommended Cost Est \$1,650.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 24K
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement -Women's Restroom 007A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Toilet Stall - Door Hardware
Code References:	2010 ADAS 604.8.1.2
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Inside of compartment door lacks a loop or U-pull below latch
Findings:	No U-pull provided on inside of door
Rec. Solution:	Provide accessible hardware
Barrier Severity:	1 Necessary Cost Est \$75.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 24L
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement -Women's Restroom 007A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Toilet - Rear Grab Bar
Code References:	2010 ADAS 609.4
Performance Sta	andard: No Quantity: JOB As-built: 1
	· · · · · · · · · · · · · · · · · · ·
Barrier Description:	Rear grab bar not mounted between 33" and 36" above floor
	Rear grab bar not mounted between 33" and 36" above floor  32-1/4" high
Description:	
Description: Findings: Rec. Solution:	32-1/4" high  Replace grab bars with reinforcement
Description: Findings:	32-1/4" high  Replace grab bars with reinforcement  3 Hindrance Cost Est \$450.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 24M
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement -Women's Restroom 007A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Toilet - Rear Grab Bar
Code References:	2010 ADAS 604.5.2
Performance Sta	ndard: No Quantity: JOB As-built : 0
Barrier Description:	Rear grab bar not at least 36" long
Findings:	30" long
Rec. Solution:	Replace grab bars with reinforcement
Barrier Severity:	3 Hindrance Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 24N
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Personant Managala Pertus and 0074
	Basement - Women's Restroom 007A
X Coordinate:	N/A Y Coordinate: N/A
X Coordinate:	N/A Y Coordinate: N/A
X Coordinate: Barrier Area:	N/A Y Coordinate: N/A Restrooms
X Coordinate: Barrier Area: Barrier Type: Code	N/A Y Coordinate: N/A  Restrooms  Toilet - Rear Grab Bar  2010 ADAS 604.5.2
X Coordinate: Barrier Area: Barrier Type: Code References:	N/A Y Coordinate: N/A  Restrooms  Toilet - Rear Grab Bar  2010 ADAS 604.5.2
X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	N/A Y Coordinate: N/A  Restrooms  Toilet - Rear Grab Bar  2010 ADAS 604.5.2  Indard: No Quantity: JOB As-built: 0
X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	N/A  Restrooms  Toilet - Rear Grab Bar  2010 ADAS 604.5.2  Indard: No Quantity: JOB As-built: 0  Rear grab bar not centered 12" from wall and 24" on the other side of WC
X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Restrooms Toilet - Rear Grab Bar 2010 ADAS 604.5.2  Indard: No Quantity: JOB As-built: 0  Rear grab bar not centered 12" from wall and 24" on the other side of WC  15" on center  Replace grab bars with reinforcement
X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Restrooms  Toilet - Rear Grab Bar  2010 ADAS 604.5.2  Indard: No Quantity: JOB As-built: 0  Rear grab bar not centered 12" from wall and 24" on the other side of WC  15" on center  Replace grab bars with reinforcement  Replace grab bars with reinforcement  The content of the



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 240
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement -Women's Restroom 007A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Toilet - Side Grab Bar
Code References:	2010 ADAS 609.4
Performance Sta	ndard: No Quantity: JOB As-built : 1
Barrier Description:	Side grab bar not mounted between 33" and 36" above floor
Findings:	32-1/2" high
Rec. Solution:	Replace grab bars with reinforcement
Barrier Severity:	3 Hindrance Cost Est \$450.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 24P
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement -Women's Restroom 007A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Toilet - Side Grab Bar
Code References:	2010 ADAS 604.5.1
Performance Sta	andard: No Quantity: JOB As-built : 0
Barrier Description:	Side grab bar does not extend min. 54" from rear wall
Findings:	52" from back wall
Rec. Solution:	Replace grab bars with reinforcement
Barrier Severity:	3 Hindrance Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 24Q
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement -Women's Restroom 007A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Toilet - Grab Bars
Code References:	2010 ADAS 604.5 & 609.8
Performance Sta	andard: No Quantity: JOB As-built : 0
Barrier Description:	Grab bars not secure or cannot bear min. 250 N of force
Findings:	Side grab bar mounted on partition wall cannot bear sufficient load
Rec. Solution:	Replace grab bars with reinforcement
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 24R
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement -Women's Restroom 007A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Toilet - Flush Handle
Code References:	2010 ADAS 604.6
Performance Sta	andard: No Quantity: JOB As-built : 1
Barrier Description:	Handle does not point to wide side of stall or compartment
Findings:	Handle points towards the small side of stall/room
Rec. Solution:	Replace water closet
-	
Rec. Solution:	1 Necessary Cost Est \$850.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 24S
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement -Women's Restroom 007A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Alarm - Horn/Strobe
Code References:	2010 ADAS 702.1
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Where a fire alarm is installed, no horn/strobe provided
Findings:	No device provided
Rec. Solution:	Provide horn/strobe in common use area
Barrier Severity:	1 Necessary Cost Est \$5,500.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 25A
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement -Women's Shower Room 007B
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Electrical Switches - Height
Code References:	2010 ADAS 308.2
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Light switch control box top edge not at max. 48" high
Findings:	51" high
Rec. Solution:	D. J
	Relocate switch box top edge to max. 48" high
Barrier Severity:	
Implementation	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 25B
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement -Women's Shower Room 007B
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	RR-showers
Barrier Type:	Floor Surface - Slope
Code References:	2010 ADAS 302 and 303
Performance Sta	ndard: No Quantity: SF As-built : 1
Barrier Description:	Floor surface slope exceeds 2.0%
Findings:	3.1% slope at entry
Rec. Solution:	Remodel to provide level clear floor space at controls/mechanisms
Barrier Severity:	2 Necessary Cost Est \$575.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 25C
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement -Women's Shower Room 007B
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Lockers - Bench Length
Code References:	2010 ADAS 803.4
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Bench provided at lockers not min. 24" x 48" and affixed to a wall
Findings:	12" deep seat not accessible
Rec. Solution:	Provide accessible bench at accessble locker
Barrier Severity:	2 Recommended Cost Est \$1,100.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 25D
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement -Women's Shower Room 007B
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	RR-showers and the showers are the showers and the showers are
Barrier Type:	Floor Surface - Slope
Code References:	2010 ADAS 302 and 303
Performance Sta	ndard: No Quantity: SF As-built : 60
Barrier Description:	Floor surface slope exceeds 2.0%
Findings:	9% slope at entry doorway landing to accessible shower
Rec. Solution:	Remodel to provide access
Barrier Severity:	2 Necessary Cost Est \$34,500.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 25F
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement -Women's Shower Room 007B
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	RR-showers
Barrier Type:	Transfer-type Shower - Entry
Code References:	2010 ADAS 608.2.1
Performance Sta	ndard: No Quantity: SF As-built: 100
Barrier Description:	No min. 36" wide entry along face to shower not provided
Findings:	30" wide at doorway opening and 28" wide inside stall
Rec. Solution:	Remodel to provide accessible shower
Barrier Severity:	2 Recommended Cost Est \$57,500.00 Facility Function: Public Status: Open
Implementation	
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 25G
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement -Women's Shower Room 007B
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Dispensers - Accessible Route
Code References:	2010 ADAS 307.2
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Dispenser not located on an accessible route
Findings:	Soap dispenser at accessible shower not on level landing
Rec. Solution:	Replace or remount dispenser
Barrier Severity:	2 Recommended Cost Est \$125.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 25H
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement -Women's Shower Room 007B
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	RR-showers RR-showers
Barrier Type:	Roll-In Showers - Seat Height
Code References:	2010 ADAS 608.4
Performance Sta	andard: No Quantity: JOB As-built : 1
Barrier Description:	Seat not 17" to 19" from floor
Findings:	3-3/4" from wall
	·
Rec. Solution:	Replace fixed folding shower seat
Rec. Solution: Barrier Severity:	
	2 Recommended Cost Est \$870.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 25I
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement -Women's Shower Room 007B
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Landing - Existing (≥ 5.0%)
Code References:	2010 ADAS 404.2.4.4
Performance Sta	andard: No Quantity: SF As-built : 40
Barrier Description:	Door or gate lacks landing on both sides of door
Findings:	6.1% slope at door landing to pool
Rec. Solution:	Demolish and reconstruct level landing
Barrier Severity:	1 Necessary Cost Est \$5,000.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 25J
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement -Women's Shower Room 007B
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	
	Shower Compartment Seat
Code References:	Shower Compartment Seat 2010 ADAS 610.3
	2010 ADAS 610.3
References:	2010 ADAS 610.3
References: Performance Sta Barrier	2010 ADAS 610.3  andard: Quantity: JOB As-built: 1
References: Performance Sta Barrier Description:	2010 ADAS 610.3  andard: Quantity: JOB As-built: 1  Seat not within 3" of shower entry
References: Performance Sta Barrier Description: Findings:	2010 ADAS 610.3  andard: Quantity: JOB As-built: 1  Seat not within 3" of shower entry  4-1/2" from wall and 8" from entry  Replace shower seat
References: Performance Sta Barrier Description: Findings: Rec. Solution:	2010 ADAS 610.3  andard: Quantity: JOB As-built: 1  Seat not within 3" of shower entry  4-1/2" from wall and 8" from entry  Replace shower seat  1 Necessary Cost Est \$550.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 25K
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement -Women's Shower Room 007B
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Turning Space
Barrier Type:	T-Shaped Turning Space
Code References:	2010 ADAS 304.3.2
Performance Sta	ndard: No Quantity: SF As-built : 1
Barrier Description:	T-shaped turning space not 60" at base at min. 36" at each arm
Findings:	31-1/2" wide door in entry path to pool
Rec. Solution:	Remodel area to remove hazard
Barrier Severity:	2 Recommended Cost Est \$75.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 25L
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement -Women's Shower Room 007B
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Door Closer - Interior
Code References:	2010 ADAS 404.2.9
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Door opening force exceeds 5 lbf
Findings:	18 lbf
Rec. Solution:	Provide automatic door opening device
Barrier Severity:	1 Necessary Cost Est \$5,000.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 25M
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement -Women's Shower Room 007B
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Door Closer - Sweep Period
Code References:	2010 ADAS 404.2.8.1
Performance Sta	ndard: No Quantity: EACH As-built : 0
Barrier Description:	Door closer lacks min. 5 second sweep period
Findings:	3 second sweep
Rec. Solution:	Provide automatic door opening device
Barrier Severity:	2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 25N
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement -Women's Shower Room 007B
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Vision Lights - Existing
Code References:	2010 ADAS 404.2.11
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	View panels in or adjacent to doors or gates not max. 43" above floor or ground
Findings:	View panel located higher than 43" above the floor
Rec. Solution:	Replace door/gate or vision panel
Barrier Severity:	3 Hindrance Cost Est \$2,250.00 Facility Function: Public Status: Open
Implementation	
Notes:	Priority: 3 Implementation Phase: Implementation Date:



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 26A
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Swimming Pool 005
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Landing - Existing (≥ 5.0%)
Code References:	2010 ADAS 404.2.4.4
Performance Sta	andard: No Quantity: SF As-built: 100
Barrier Description:	Door or gate lacks landing on both sides of door
Findings:	7.3% slope and 3.6% counter slope
Rec. Solution:	Demolish and reconstruct level landing
Barrier Severity:	1 Necessary Cost Est \$12,500.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: Women	's entry door
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 26B
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location	
Location:	Basement - Swimming Pool 005
Location: X Coordinate:	Basement - Swimming Pool 005
X Coordinate:	N/A Y Coordinate: N/A
X Coordinate: Barrier Area:	N/A Y Coordinate: N/A  Doors or Gates
X Coordinate: Barrier Area: Barrier Type: Code	N/A Y Coordinate: N/A  Doors or Gates  Recessed Door  2010 ADAS Figure 404.2.4.3
X Coordinate: Barrier Area: Barrier Type: Code References:	N/A Y Coordinate: N/A  Doors or Gates  Recessed Door  2010 ADAS Figure 404.2.4.3
X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier	N/A  V Coordinate:  N/A  Doors or Gates  Recessed Door  2010 ADAS Figure 404.2.4.3  andard:  No  Quantity:  JOB  As-built:  O
X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	N/A    Doors or Gates   Recessed Door     2010 ADAS Figure 404.2.4.3     andard: No Quantity: JOB   As-built:   D    Door in alcove deeper than 8" does not have min. 18" stike edge clearance
X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	N/A  Doors or Gates  Recessed Door  2010 ADAS Figure 404.2.4.3  andard: No Quantity: JOB As-built: 0  Door in alcove deeper than 8" does not have min. 18" stike edge clearance  9-3/4" deep recess with 2" strike edge clearance  Provide automatic door opening device
X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	N/A    No   No   No   No   No   No   No   N
X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution: Barrier Severity: Implementation	N/A    No   No   No   No   No   No   No   N



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 26C
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Swimming Pool 005
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Doorway - Side App 42"
Code References:	2010 ADAS 404.2.4.2
Performance Sta	ndard: No Quantity: EACH As-built : 0
Barrier Description:	Doorway lacks min. 42" perpendicular to door
Findings:	36" between guardrail and door
Rec. Solution:	Provide automatic door opening device
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: Women	's entry door
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 26D
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Swimming Pool 005
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	
	Doors or Gates
Barrier Type:	Hinge App/push 22" @ Hinge
Barrier Type: Code	Hinge App/push 22" @ Hinge 2010 ADAS Figure 404.2.4.1
Barrier Type: Code References:	Hinge App/push 22" @ Hinge 2010 ADAS Figure 404.2.4.1
Barrier Type: Code References: Performance Sta Barrier	Hinge App/push 22" @ Hinge  2010 ADAS Figure 404.2.4.1  Indard: No Quantity: EACH As-built: 0
Barrier Type: Code References: Performance Sta Barrier Description:	Hinge App/push 22" @ Hinge  2010 ADAS Figure 404.2.4.1  Indard: No Quantity: EACH As-built: 0  Door/Gate with hinge approach at push side with min. 42" lacks min. 22" beyond hinge
Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Hinge App/push 22" @ Hinge 2010 ADAS Figure 404.2.4.1  Indard: No Quantity: EACH As-built: 0  Door/Gate with hinge approach at push side with min. 42" lacks min. 22" beyond hinge  Clearance beyond hinge blocked by lane lines on wall  Provide automatic door opening device
Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Hinge App/push 22" @ Hinge  2010 ADAS Figure 404.2.4.1  Indard: No Quantity: EACH As-built: 0  Door/Gate with hinge approach at push side with min. 42" lacks min. 22" beyond hinge  Clearance beyond hinge blocked by lane lines on wall  Provide automatic door opening device  1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 26E
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Swimming Pool 005
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	Tactile Exit Signs - Passage
Code References:	Performance Standard
Performance Sta	ndard: Yes Quantity: EACH As-built : 3
Barrier Description:	Exit thru an exit enclosure/exit passageway lacks tactile exit sign
Findings:	Passageway to exterior exit with low level illuminated sign lacks tactile exit sign
Rec. Solution:	Provide signs stating "EXIT ROUTE" at exit side of door
Barrier Severity:	2 Recommended Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 26F
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Swimming Pool 005
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Chalkboard/Whiteboard - Area of Use
Code References:	Performance Standard & 2010 ADAS 904.3.3
Performance Sta	ndard: Yes Quantity: EACH As-built : 1
Barrier Description:	Bottom edge of writing surface not max. 38" high
Findings:	Lower edge of writing surface 48" high
Rec. Solution:	Remount whiteboard/chalkboard or provide alternate for use by short people
Barrier Severity:	3 Hindrance Cost Est \$1,200.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 26G
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Swimming Pool 005
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Clear Floor Space
Code References:	2010 ADAS 305.3
Performance Sta	ndard: No Quantity: JOB As-built : 0
Barrier Description:	Clear floor space for wheelchair not provided at control or mechanism
Findings:	Drinking fountain blocks chalkboard clear floor space
Rec. Solution:	Move chalkboard or fountain
Barrier Severity:	3 Hindrance Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 26H
Field Date: Bldg Name:	2/24/2014 Report Date 2/27/2014 Barrier #: 26H Women's Building Reference Dwg: 3 of 6
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Bldg Name: Location:	Women's Building Reference Dwg: 3 of 6  Basement - Swimming Pool 005
Bldg Name: Location: X Coordinate:	Women's Building Reference Dwg: 3 of 6  Basement - Swimming Pool 005  N/A Y Coordinate: N/A
Bldg Name: Location: X Coordinate: Barrier Area:	Women's Building Reference Dwg: 3 of 6  Basement - Swimming Pool 005  N/A Y Coordinate: N/A  Drinking Fountains  Alcove - Existing (pre-1992)
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code	Women's Building Reference Dwg: 3 of 6  Basement - Swimming Pool 005  N/A Y Coordinate: N/A  Drinking Fountains  Alcove - Existing (pre-1992)  2010 ADAS 307.2
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Women's Building Reference Dwg: 3 of 6  Basement - Swimming Pool 005  N/A Y Coordinate: N/A  Drinking Fountains  Alcove - Existing (pre-1992)  2010 ADAS 307.2
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Women's Building Reference Dwg: 3 of 6  Basement - Swimming Pool 005  N/A Y Coordinate: N/A  Drinking Fountains  Alcove - Existing (pre-1992)  2010 ADAS 307.2  Indard: No Quantity: SF As-built: 2  Fountain with a leading edge between 27" and 80" high protrudes more than 4" into the
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Women's Building Reference Dwg: 3 of 6  Basement - Swimming Pool 005  N/A Y Coordinate: N/A  Drinking Fountains  Alcove - Existing (pre-1992)  2010 ADAS 307.2  Indard: No Quantity: SF As-built: 2  Fountain with a leading edge between 27" and 80" high protrudes more than 4" into the circulation path.
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Women's Building Reference Dwg: 3 of 6  Basement - Swimming Pool 005  N/A Y Coordinate: N/A  Drinking Fountains  Alcove - Existing (pre-1992)  2010 ADAS 307.2  mdard: No Quantity: SF As-built: 2  Fountain with a leading edge between 27" and 80" high protrudes more than 4" into the circulation path.  No alcove provided. Drinking fountain protrudes into circulation path  Provide wing walls as detectable warning (existing unit only)
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Women's Building Reference Dwg: 3 of 6  Basement - Swimming Pool 005  N/A Y Coordinate: N/A  Drinking Fountains  Alcove - Existing (pre-1992)  2010 ADAS 307.2  Fountain with a leading edge between 27" and 80" high protrudes more than 4" into the circulation path.  No alcove provided. Drinking fountain protrudes into circulation path  Provide wing walls as detectable warning (existing unit only)  1 Necessary Cost Est \$500.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 26I
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Swimming Pool 005
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Drinking Fountains
Barrier Type:	Floor/Ground Space
Code References:	2010 ADAS 602.2
Performance Sta	andard: No Quantity: SF As-built : 20
Barrier Description:	Floor/Ground Space under fountain not level
Findings:	3.6% slope at landing. Bucket also blocks knee clearance
Rec. Solution:	Demolish and construct level landing or relocate fountain
Barrier Severity:	2 Recommended Cost Est \$2,000.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 26J
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Swimming Pool 005
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Drinking Fountains
Barrier Type:	Operation - Manual (Fist)
Code References:	2010 ADAS 602.3
Performance Sta	andard: No Quantity: EACH As-built: 1
Barrier Description:	Operating mechanism at fountain is not operable with a fist
Findings:	Control not fist operable
Findings: Rec. Solution:	Replace fountain with accessible unit
_	Replace fountain with accessible unit
Rec. Solution:	Replace fountain with accessible unit  2 Recommended Cost Est \$750.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 26K
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Swimming Pool 005
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Drinking Fountains
Barrier Type:	Operation - Adjustment
Code References:	2010 ADAS 602.3
Performance Sta	ndard: No Quantity: EACH As-built : 0
Barrier Description:	Operating mechanism involves more than 5 lbf to operate
Findings:	12 lbf needed to operate
Rec. Solution:	Adjust existing controls
Barrier Severity:	2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 26L
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Swimming Pool 005
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Drinking Fountains
Barrier Type:	Bubbler height
Barrier Type: Code References:	Bubbler height
Code	Bubbler height 2010 ADAS 602.4
Code References:	Bubbler height 2010 ADAS 602.4
Code References: Performance Sta Barrier	Bubbler height  2010 ADAS 602.4  Indard: No Quantity: EACH As-built: 0
Code References: Performance Sta Barrier Description:	Bubbler height  2010 ADAS 602.4  Indard: No Quantity: EACH As-built: 0  Bubbler height exceeds 36"
Code References: Performance Sta Barrier Description: Findings:	Bubbler height  2010 ADAS 602.4  Indard: No Quantity: EACH As-built: 0  Bubbler height exceeds 36"  39" bubbler height  Provide low unit in pool area or equivalent
Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Bubbler height  2010 ADAS 602.4  Indard: No Quantity: EACH As-built: 0  Bubbler height exceeds 36"  39" bubbler height  Provide low unit in pool area or equivalent  1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 26M
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Swimming Pool 005
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Drinking Fountains
Barrier Type:	Depth Page 1995
Code References:	2010 ADAS 602.5
Performance Sta	andard: No Quantity: EACH As-built: 0
Barrier Description:	Wall/post mounted fountain not min. 18" deep
Findings:	14" deep
Rec. Solution:	Provide low unit in pool area or equivalent
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 26N
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Swimming Pool 005
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Actuator or Control - Height
Code References:	2010 ADAS 305.3
Performance Sta	andard: No Quantity: EACH As-built: 1
Barrier Description:	Control or mechanism not at max. 48" high for side reach
Findings:	Telephone 64" high
Rec. Solution:	Relocate control or mechanism to max. 48" high
Rec. Solution: Barrier Severity:	
	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 260
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Swimming Pool 005
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	First Aid Kit - High Reach Range
Code References:	2010 ADAS 305.3
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Opening mechanism on first aid kit not at max. 48" high for side reach
Findings:	71-1/4" high
Rec. Solution:	Relocate control or mechanism to max. 48" high
Barrier Severity:	1 Necessary Cost Est \$275.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 26P
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Swimming Pool 005
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Corridors
Barrier Type:	Bench - Seat Depth
Code References:	2010 ADAS 903.3
Performance Sta	andard: No Quantity: EACH As-built: 1
Barrier Description:	Bench seat not 20" to 24" deep
Findings:	11-1/2" deep seats at benches not accessible
Rec. Solution:	Provide min. one accessible bench in corridor
Barrier Severity:	3 Hindrance Cost Est \$1,100.00 Facility Function: Public Status: Open
Implementation	
Notes: 1 bench	Filolity.  2   Implementation Filase.   Implementation Date.



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 26Q
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Swimming Pool 005
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Alarms
Barrier Type:	Horn/Strobe - Common Use Area
Code References:	2010 ADAS 702.1
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	No horn/strobes in common use areas
Findings:	No device provided
Rec. Solution:	Provide strobe in common use area
Barrier Severity:	1 Necessary Cost Est \$5,500.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 27A
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Swimming Pool 005
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Recessed Door - Push Side
Code	Control and a co
References:	2010 ADAS 404.2.4.3
References:	
References: Performance Sta Barrier	andard: No Quantity: EACH As-built : 0
References: Performance Sta Barrier Description:	andard: No Quantity: EACH As-built: 0  Door recessed by more than 8" lacks at least 12" clearance at push side of door
References: Performance Sta Barrier Description: Findings:	andard: No Quantity: EACH As-built: 0  Door recessed by more than 8" lacks at least 12" clearance at push side of door  9-3/4" deep  Provide automatic door opening device
References: Performance Sta Barrier Description: Findings: Rec. Solution:	Door recessed by more than 8" lacks at least 12" clearance at push side of door  9-3/4" deep  Provide automatic door opening device  1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 27B
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Swimming Pool 005
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Landing - Existing (≥ 5.0%)
Code References:	2010 ADAS 404.2.4.4
Performance Sta	ndard: No Quantity: SF As-built: 100
Barrier Description:	Door or gate lacks landing on both sides of door
Findings:	6% running slope and 4.5% counter slope
Rec. Solution:	Demolish and reconstruct level landing
Barrier Severity:	1 Necessary Cost Est \$12,500.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: Men's e	ntry door
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 27C
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Swimming Pool 005
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Front App/pull 60" - Blocked
Code References:	2010 ADAS Figure 404.2.4.1
Performance Sta	ndard: No Quantity: EACH As-built: 1
Barrier Description:	Door/Gate at with min. 18" at pull side lacks min. 60" perpendicular to door
Findings:	36" between guardrail and door
Rec. Solution:	Provide automatic door opening device
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	
Notes: Men's e	ntru door



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 27D
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Men's Shower Room 006B
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Door Closer - Interior
Code References:	2010 ADAS 404.2.9
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Door opening force exceeds 5 lbf
Findings:	18 lbf
Rec. Solution:	Provide automatic door opening device
Barrier Severity:	1 Necessary Cost Est \$5,000.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 27E
Bldg Name:	
blug Maille.	Women's Building Reference Dwg: 3 of 6
Location:	Women's Building   Reference Dwg:  3 of 6     Basement - Men's Shower Room 006B
•	
Location:	Basement - Men's Shower Room 006B
Location: X Coordinate:	Basement - Men's Shower Room 006B  N/A  Y Coordinate: N/A  Doors or Gates  Door Closer - Interior Closing Speed ADA
Location: X Coordinate: Barrier Area:	Basement - Men's Shower Room 006B  N/A  Y Coordinate: N/A  Doors or Gates
Location: X Coordinate: Barrier Area: Barrier Type: Code	Basement - Men's Shower Room 006B  N/A  Y Coordinate: N/A  Doors or Gates  Door Closer - Interior Closing Speed ADA  2010 ADAS 404.2.8.1
Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Basement - Men's Shower Room 006B  N/A  Y Coordinate: N/A  Doors or Gates  Door Closer - Interior Closing Speed ADA  2010 ADAS 404.2.8.1
Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Basement - Men's Shower Room 006B  N/A  Y Coordinate: N/A  Doors or Gates  Door Closer - Interior Closing Speed ADA  2010 ADAS 404.2.8.1  Indard: No Quantity: EACH As-built: 0
Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Basement - Men's Shower Room 006B  N/A  Y Coordinate: N/A  Doors or Gates  Door Closer - Interior Closing Speed ADA  2010 ADAS 404.2.8.1  andard: No Quantity: EACH As-built: 0  Door closer lacks min. 5 second sweep period/back check
Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Basement - Men's Shower Room 006B  N/A  Y Coordinate: N/A  Doors or Gates  Door Closer - Interior Closing Speed ADA  2010 ADAS 404.2.8.1  andard: No Quantity: EACH As-built: 0  Door closer lacks min. 5 second sweep period/back check  3 second sweep  Provide automatic door opening device
Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Basement - Men's Shower Room 006B  N/A  Y Coordinate: N/A  Doors or Gates  Door Closer - Interior Closing Speed ADA  2010 ADAS 404.2.8.1  andard: No Quantity: EACH As-built: 0  Door closer lacks min. 5 second sweep period/back check  3 second sweep  Provide automatic door opening device  2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Papart Data 2/27/2014 Parrior #: 275
	2/24/2014   Report Date   2/27/2014   Barrier #:   27F
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Men's Shower Room 006B
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Vision Lights - Existing
Code References:	2010 ADAS 404.2.11
Performance Sta	andard: No Quantity: EACH As-built: 1
Barrier Description:	View panels in or adjacent to doors or gates not max. 43" above floor or ground
Findings:	View panel located higher than 43" above the floor
Rec. Solution:	Replace door/gate or vision panel
Barrier Severity:	3 Hindrance Cost Est \$2,250.00 Facility Function: Public Status: Open
Implementation	
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 27G
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Men's Shower Room 006B
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Landing - Existing (≥ 5.0%)
Code References:	2010 ADAS 404.2.4.4
Performance Sta	andard: No Quantity: SF As-built : 60
Barrier Description:	Door or gate lacks landing on both sides of door
Findings:	7.3% slope at door landing to pool
Rec. Solution:	Demolish and reconstruct level landing
Barrier Severity:	1 Necessary Cost Est \$7,500.00 Facility Function: Public Status: Open
Implementation	
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 27H
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Men's Shower Room 006B
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Clear Floor Space
Barrier Type:	Passageway - Min. 36"
Code References:	2010 ADAS 403.5.1
Performance Sta	ndard: No Quantity: LF As-built : 20
Barrier Description:	Circulation route not min. 36" wide between elements
Findings:	35-1/4" wide circulation route to pool
Rec. Solution:	Demolish existing and construct new passageway
Barrier Severity:	1 Necessary Cost Est \$2,500.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 27
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Men's Shower Room 006B
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Lockers - Bench Length
Code References:	2010 ADAS 803.4
	,
Performance Sta	ndard: No Quantity: EACH As-built : 1
Performance Sta Barrier Description:	Bench provided at lockers not min. 24" x 48" and affixed to a wall
Barrier	
Barrier Description:	Bench provided at lockers not min. 24" x 48" and affixed to a wall
Barrier Description: Findings:	Bench provided at lockers not min. 24" x 48" and affixed to a wall  Bench in shower room not accessible  Provide accessible bench at accessble locker
Barrier Description: Findings: Rec. Solution:	Bench provided at lockers not min. 24" x 48" and affixed to a wall  Bench in shower room not accessible  Provide accessible bench at accessble locker  2 Recommended Cost Est \$1,100.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 27J
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Men's Shower Room 006B
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	RR-showers 22444114114141414
Barrier Type:	Floor Surface - Slope
Code References:	2010 ADAS 302 and 303
Performance Sta	ndard: No Quantity: SF As-built : 60
Barrier Description:	Floor surface slope exceeds 2.0%
Findings:	9.5% slope at accessible shower landing
Rec. Solution:	Remodel to provide access
Barrier Severity:	2 Necessary Cost Est \$34,500.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 27K
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Men's Shower Room 006B
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	RR-showers
Barrier Type:	Transfer-type Shower - Entry
Code References:	2010 ADAS 608.2.1
Performance Sta	ndard: No Quantity: SF As-built: 100
Barrier Description:	No min. 36" wide entry along face to shower not provided
Findings:	30" wide at entry doorway and 28" at shower interior
Rec. Solution:	Remodel to provide accessible shower
Barrier Severity:	2 Recommended Cost Est \$57,500.00 Facility Function: Public Status: Open
Implementation	
	Priority: 3 Implementation Phase: Implementation Date:



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 27L
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Men's Shower Room 006B
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Dispensers - Accessible Route
Code References:	2010 ADAS 307.2
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Dispenser not located on an accessible route
Findings:	Soap dispenser at accessible shower not on level landing
Rec. Solution:	Replace or remount dispenser
Barrier Severity:	2 Recommended Cost Est \$125.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 27M
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Men's Shower Room 006B
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Shower Compartment Seat
Code References:	2010 ADAS 610.3
Performance Sta	ndard: Quantity: JOB As-built : 1
Barrier Description:	Seat not within 3" of shower entry
Findings:	4-1/2" from wall and 8" from entry
Rec. Solution:	Replace shower seat
Barrier Severity:	1 Necessary Cost Est \$550.00 Facility Function: Public Status: Open
Implementation	
	Priority: 3 Implementation Phase: Implementation Date:



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 27N
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Men's Shower Room 006B
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Roll-In Showers - Seat Height
Code References:	2010 ADAS 608.4
Performance Sta	ndard: No Quantity: JOB As-built : 1
Barrier Description:	Seat not 17" to 19" from floor
Findings:	18-3/4" high
Rec. Solution:	Replace fixed folding shower seat
Barrier Severity:	2 Recommended Cost Est \$870.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 270
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Men's Shower Room 006B
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Sink - Rim or Countertop
Code References:	2010 ADAS 606.3
Performance Sta	ndard: No Quantity: LF As-built : 3
Barrier Description:	Sink rim or surface not max. 34" high
Findings:	36" high
Rec. Solution:	Reposition existing sink or provide additional sink for use in area
Barrier Severity:	1 Necessary Cost Est \$1,110.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	mplementation ruse.



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 27P
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Men's Shower Room 006B
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Sink - Knee Clearance
Code References:	2010 ADAS 606.2 & 306
Performance Sta	ndard: No Quantity: EACH As-built : 0
Barrier Description:	Knee clearance of at least 27" high, 19" deep and 30" wide not provided
Findings:	22" knee clearance
Rec. Solution:	Replace cabinet and remount sink
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 27Q
Field Date: Bldg Name:	2/24/2014   Report Date   2/27/2014   Barrier #:   27Q   Women's Building   Reference Dwg:   3 of 6
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Bldg Name: Location:	Women's Building Reference Dwg: 3 of 6  Basement - Men's Shower Room 006B
Bldg Name: Location: X Coordinate:	Women's Building Reference Dwg: 3 of 6  Basement - Men's Shower Room 006B  N/A Y Coordinate: N/A
Bldg Name: Location: X Coordinate: Barrier Area:	Women's Building Reference Dwg: 3 of 6  Basement - Men's Shower Room 006B  N/A Y Coordinate: N/A  Restrooms
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code	Women's Building Reference Dwg: 3 of 6  Basement - Men's Shower Room 006B  N/A Y Coordinate: N/A  Restrooms  Counter - Protruding Object  2010 ADAS 307
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Women's Building Reference Dwg: 3 of 6  Basement - Men's Shower Room 006B  N/A Y Coordinate: N/A  Restrooms  Counter - Protruding Object  2010 ADAS 307
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Women's Building Reference Dwg: 3 of 6  Basement - Men's Shower Room 006B  N/A Y Coordinate: N/A  Restrooms  Counter - Protruding Object  2010 ADAS 307  Indard: No Quantity: EACH As-built: 1
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Women's Building Reference Dwg: 3 of 6  Basement - Men's Shower Room 006B  N/A Y Coordinate: N/A  Restrooms  Counter - Protruding Object  2010 ADAS 307  Indard: No Quantity: EACH As-built: 1  Counter or table in route of travel protrudes more than 4" above 27" high
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Women's Building  Reference Dwg: 3 of 6  Basement - Men's Shower Room 006B  N/A  Y Coordinate: N/A  Restrooms  Counter - Protruding Object  2010 ADAS 307  Indard: No Quantity: EACH As-built: 1  Counter or table in route of travel protrudes more than 4" above 27" high  Sink counter protrudes more than 4" at 36" high along counter side of fixture  Provide detectable warning for the visually impaired
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Women's Building  Reference Dwg: 3 of 6  Basement - Men's Shower Room 006B  N/A Y Coordinate: N/A  Restrooms  Counter - Protruding Object  2010 ADAS 307  Indard: No Quantity: EACH As-built: 1  Counter or table in route of travel protrudes more than 4" above 27" high  Sink counter protrudes more than 4" at 36" high along counter side of fixture  Provide detectable warning for the visually impaired  I Necessary Cost Est \$875.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 28A
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Men's Toilet Room 006C
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Door Clear Width
Code References:	2010 ADAS 404.2.3
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Door clear width is not min. 32"
Findings:	29-1/2" clear width
Rec. Solution:	Replace door/gate and frame
Barrier Severity:	1 Necessary Cost Est \$2,250.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 28B
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Men's Toilet Room 006C
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Door Landing - Level
Code References:	2010 ADAS 404.2.4.4
Performance Sta	andard: No Quantity: SF As-built: 100
Barrier Description:	Door landing is not level on both sides of door
Findings:	8.3% slope in path to shower room
Rec. Solution:	Demolish and reconstruct level landing
Barrier Severity:	1 Necessary Cost Est \$12,500.00 Facility Function: Public Status: Open
Implementation	
Notes: Alterna	te route has 6.3% floor slope between tables



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 28C
Bldg Name:	Women's Building   Reference Dwg:   3 of 6
Location:	Basement - Men's Toilet Room 006C
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Protruding Object - Wall-mounted
Code References:	2010 ADAS 307.2
Performance Sta	ndard: No Quantity: JOB As-built : 1
Barrier Description:	Object protrudes more than 4" into circulation path
Findings:	Counter protrudes more than 4" at 36" high
Rec. Solution:	Provide detectable warning for the visually impaired
Barrier Severity:	1 Necessary Cost Est \$550.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 28D
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Men's Toilet Room 006C
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Door Landing - Level
Code References:	2010 ADAS 404.2.4.4
Performance Sta	ndard: No Quantity: SF As-built: 100
Barrier Description:	Door landing is not level on both sides of door
Findings:	6.3% slope between tables
Rec. Solution:	Demolish and reconstruct level landing
Barrier Severity:	1 Necessary Cost Est \$12,500.00 Facility Function: Public Status: Open
Implementation	
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 28E
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Men's Toilet Room 006C
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Electrical Switches
Code References:	2010 ADAS 205.1 & 309.3
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Light switch control box top edge not at max. 48" high
Findings:	56" high
Rec. Solution:	Relocate switch box top edge to max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 28F
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Men's Toilet Room 006C
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Lavatory - Knee Clearance
Code References:	2010 ADAS 606.2 & 306
Performance Sta	andard: No Quantity: JOB As-built : 1
Barrier Description:	Lavatory bottom apron/edge not max 29" reducing to 27" at 8" back from edge
Findings:	24" knee clearance
Rec. Solution:	Provide min. one accessible lavatory
-	
Rec. Solution:	1 Necessary Cost Est \$450.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 28G
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Men's Toilet Room 006C
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Mirror
Code References:	2010 ADAS 603.3
Performance Sta	andard: No Quantity: EACH As-built: 1
Barrier Description:	Mirror at lavatory/countertop not max. 40" AFF at edge of reflecting surface
Findings:	53" high
Rec. Solution:	Replace or remount mirror
Barrier Severity:	3 Hindrance Cost Est \$375.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 28H
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Men's Toilet Room 006C
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Urinal - Flush Controls
Code References:	2010 ADAS 309
Performance Sta	andard: No Quantity: JOB As-built : 1
Barrier Description:	Urinal flush controls mounted higher than 48" above the floor
Findings:	48" high
Rec. Solution:	Replace urinal controls where possible or entire urinal
Downian Corregitors	
Barrier Severity:	2 Recommended Cost Est \$800.00 Facility Function: Public Status: Open
Implementation	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 28I
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Men's Toilet Room 006C
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Toilet Stall - Door Hardware
Code References:	2010 ADAS 604.8.1.2
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Outside of compartment door lacks a loop or U-pull below latch
Findings:	No U-pull provided on outside of stall door
Rec. Solution:	Provide accessible hardware
Barrier Severity:	1 Necessary Cost Est \$75.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 28J
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Men's Toilet Room 006C
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Toilet Stall - Door Hardware
Code References:	2010 ADAS 604.8.1.2
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Compartment door hardware involves user to grasp or twist to operate
Findings:	No privacy latch provided
Rec. Solution:	Provide accessible hardware
Barrier Severity:	1 Necessary Cost Est \$300.00 Facility Function: Public Status: Open
Implementation	
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 28K
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Men's Toilet Room 006C
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Toilet Stall - Door Hardware
Code References:	2010 ADAS 604.8.1.2
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Inside of compartment door lacks a loop or U-pull below latch
Findings:	No U-pull provided on inside of door
Rec. Solution:	Provide accessible hardware
Barrier Severity:	1 Necessary Cost Est \$75.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 28L
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Men's Toilet Room 006C
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Coat Hook
Code References:	2010 ADAS 603.4
Performance Sta	ndard: No Quantity: EACH As-built: 1
Barrier Description:	Clothing hooks not max. 48" high AFF
Findings:	68" high
Rec. Solution:	Provide additional hook
Barrier Severity:	
Implementation	
Notes:	, I



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 28M
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Men's Toilet Room 006C
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Toilet - Rear Grab Bar
Code References:	2010 ADAS 609.4
Performance Sta	andard: No Quantity: JOB As-built : 1
Barrier Description:	Rear grab bar not mounted between 33" and 36" above floor
Findings:	32" high
Rec. Solution:	Replace grab bars with reinforcement
Barrier Severity:	3 Hindrance Cost Est \$450.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 280
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Men's Toilet Room 006C
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Toilet - Rear Grab Bar
Code References:	2010 ADAS 604.5.2
Performance Sta	andard: No Quantity: JOB As-built : 0
Barrier Description:	Rear grab bar not at least 36" long
Findings:	32" long
Rec. Solution:	Replace grab bars with reinforcement
Barrier Severity:	3 Hindrance Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 28P
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Men's Toilet Room 006C
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Toilet - Side Grab Bar
Code References:	2010 ADAS 609.4
Performance Sta	andard: No Quantity: JOB As-built : 1
Barrier Description:	Side grab bar not mounted between 33" and 36" above floor
Findings:	32" high
Rec. Solution:	Replace grab bars with reinforcement
Barrier Severity:	3 Hindrance Cost Est \$450.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 28Q
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Men's Toilet Room 006C
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Toilet - Side Grab Bar
Code References:	2010 ADAS 604.5.1
Performance Sta	andard: No Quantity: JOB As-built : 0
Barrier	Cide such have done not extend using CAll frame year visit
Description:	Side grab bar does not extend min. 54" from rear wall
Description: Findings:	53" from back wall
Findings:	
Findings: Rec. Solution:	53" from back wall  Replace grab bars with reinforcement
·	Sall from back wall  Replace grab bars with reinforcement  3 Hindrance Cost Est \$0.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 28R
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Men's Toilet Room 006C
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Toilet - Seat Height
Code References:	2010 ADAS 604.4
Performance Sta	ndard: No Quantity: JOB As-built : 1
Barrier Description:	Water closet seat not between 17" to 19" high
Findings:	16" high
Rec. Solution:	Replace water closet
Barrier Severity:	2 Recommended Cost Est \$850.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 28S
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Men's Toilet Room 006C
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Toilet Centerline
Code References:	2010 ADAS 604.2
Performance Sta	ndard: No Quantity: JOB As-built : 0
Barrier Description:	Water closet centerline not between 16" and 18" O. C.
Findings:	18-1/2" on center
Rec. Solution:	Relocate water closet
Barrier Severity:	3 Hindrance Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 28T
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Men's Toilet Room 006C
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Seat Cover Dispenser
Code References:	2010 ADAS 307.2
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Seat cover dispenser not located on an accessible route
Findings:	Seat cover dispenser blocked by water closet
Rec. Solution:	Replace or remount dispenser on an accessible route with clear floor space
Barrier Severity:	2 Recommended Cost Est \$125.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 29A
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Mens Locker Room Treatment Area 006
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Weighing Scale - Clear Floor Space
Code References:	2010 ADAS 305
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Clear floor space of min. 30" by 48" not provided at public scale
Findings:	Scale not wheel chair accessible
Rec. Solution:	Replace scale to provide access for people with mobility impairments
Barrier Severity:	2 Recommended Cost Est \$675.00 Facility Function: Public Status: Open
Implementation	
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 29B
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Mens Locker Room Treatment Area 006
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Lockers - Bench Length
Code References:	2010 ADAS 803.4
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Bench provided at lockers not min. 24" x 48" and affixed to a wall
Findings:	11" deep
Rec. Solution:	Provide min. one accessible bench at accessble locker
Barrier Severity:	2 Recommended Cost Est \$1,100.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 29C
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Mens Locker Room Treatment Area 006
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Counters and Tables
Barrier Type:	Counter - Knee Clearance
Code References:	2010 ADAS 305.3
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Knee clearance not min. 27" high, 19" deep or 30" wide
Findings:	24-1/2 " knee clearance
Rec. Solution:	Provide min. one accessible table
Barrier Severity:	3 Hindrance Cost Est \$875.00 Facility Function: Public Status: Open
Implementation	
Notes: Treatme	ent table



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 30A
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Men's Locker Room 006A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Lockers - Ratio
Code References:	2010 ADAS 803
Performance Sta	andard: No Quantity: EACH As-built: 8
Barrier Description:	No accessible locker provided in locker room
Findings:	Locker controls not accessible
Rec. Solution:	Provide min. 5% of each type of lockers
Barrier Severity:	1 Necessary Cost Est \$3,600.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes: 36 half s	sized lockers. 12 full sized. 35 small lockers x 5
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 30B
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Men's Locker Room 006A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Lockers - Maneuvering Cl
Code References:	2010 ADAS 803.2
Performance Sta	indard: No Quantity: EACH As-built: 3
Barrier Description:	No 60" maneuvering clearance provided at locker or bench
Findings:	60" maneuvering clearance not provided at any of the lockers
i iliuliigs.	
Rec. Solution:	Provide accessible bench at accessble lockers
Rec. Solution:	
Rec. Solution:	Provide accessible bench at accessble lockers  2 Recommended Cost Est \$1,950.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 30C
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Men's Locker Room 006A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Lockers - Bench Length
Code References:	2010 ADAS 803.4
Performance Sta	ndard: No Quantity: EACH As-built : 3
Barrier Description:	Bench provided at lockers not min. 24" x 48" and affixed to a wall
Findings:	Seat of bench at locker 11" deep at 16" high
Rec. Solution:	Provide accessible bench at each type of accessble lockers
Barrier Severity:	2 Recommended Cost Est \$3,300.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes: 36 half s	sized lockers. 12 full sized. Small 35 x 5
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 31A
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Men's Locker Room Entry 006E
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	Location - 48" to 60" high
Code References:	2010 ADAS 703.4.1
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Braille/Tactile information on sign not mounted between 48" and 60" from ground or floor
Findings:	63" high
Rec. Solution:	Provide accessible sign and mount at proper height
Barrier Severity:	1 Necessary Cost Est \$250.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
	aille not 3/8" and max. 1/2" directly below the tactile characters and text descriptors not directly below pictogram



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 31B
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Men's Locker Room Entry 006E
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	ISA - Accessible Entry Door
Code References:	2010 ADAS 216.6
Performance Sta	ndard: No Quantity: EACH As-built : 2
Barrier Description:	No sign identifying door as accessible where all doors are not accessible
Findings:	Actuators for both locker rooms have 1-1/4" high ISA signs
Rec. Solution:	Recommended: provide 4" x 4" ISA sign above push plate for viewing at a distance
Barrier Severity:	1 Necessary Cost Est \$500.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes: Push pla	ate device lacks identification visible from a distance.
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 31C
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Men's Locker Room Entry 006E
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Vision Lights - Existing
Code References:	2010 ADAS 404.2.11
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	View panels in or adjacent to doors or gates not max. 43" above floor or ground
Findings:	View panel located higher than 43" above the floor
Rec. Solution:	Replace door/gate or vision panel
Barrier Severity:	3 Hindrance Cost Est \$2,250.00 Facility Function: Public Status: Open
Implementation	
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 31D
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Men's Locker Room Entry 006E
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	ISA - Accessible Entry Door
Code References:	2010 ADAS 216.6
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	No sign identifying door as accessible where all doors are not accessible
Findings:	Accessible sign not provided at inner actuator
Rec. Solution:	Provide ISA at accessible entrance door
Barrier Severity:	1 Necessary Cost Est \$250.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes: Accessib	ole sign not provided on the inside of door
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 32A
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Bldg Name: Location:	SANITO STATE OF THE PARTY OF TH
_	Women's Building Reference Dwg: 3 of 6
Location:	Women's Building Reference Dwg: 3 of 6  Basement - Locker Room Service Counter
Location: X Coordinate:	Women's Building Reference Dwg: 3 of 6  Basement - Locker Room Service Counter  N/A Y Coordinate: N/A
Location: X Coordinate: Barrier Area:	Women's Building Reference Dwg: 3 of 6  Basement - Locker Room Service Counter  N/A Y Coordinate: N/A  Signage
Location: X Coordinate: Barrier Area: Barrier Type: Code	Women's Building Reference Dwg: 3 of 6  Basement - Locker Room Service Counter  N/A Y Coordinate: N/A  Signage  Permanent Room/Space - Tactile Characters  2010 ADAS 216.2
Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Women's Building Reference Dwg: 3 of 6  Basement - Locker Room Service Counter  N/A Y Coordinate: N/A  Signage  Permanent Room/Space - Tactile Characters  2010 ADAS 216.2
Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Women's Building Reference Dwg: 3 of 6  Basement - Locker Room Service Counter  N/A Y Coordinate: N/A  Signage  Permanent Room/Space - Tactile Characters  2010 ADAS 216.2  ndard: No Quantity: EACH As-built: 1
Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Women's Building Reference Dwg: 3 of 6  Basement - Locker Room Service Counter  N/A Y Coordinate: N/A  Signage  Permanent Room/Space - Tactile Characters  2010 ADAS 216.2  ndard: No Quantity: EACH As-built: 1  No tactile characters at sign identifying permanent rooms and spaces with visual signs
Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Women's Building Reference Dwg: 3 of 6  Basement - Locker Room Service Counter  N/A Y Coordinate: N/A  Signage  Permanent Room/Space - Tactile Characters  2010 ADAS 216.2  ndard: No Quantity: EACH As-built: 1  No tactile characters at sign identifying permanent rooms and spaces with visual signs  No tactile signage provided at door within public route
Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Women's Building Reference Dwg: 3 of 6  Basement - Locker Room Service Counter  N/A Y Coordinate: N/A  Signage  Permanent Room/Space - Tactile Characters  2010 ADAS 216.2  Indard: No Quantity: EACH As-built: 1  No tactile characters at sign identifying permanent rooms and spaces with visual signs  No tactile signage provided at door within public route  Provide accessible sign  I Necessary Cost Est \$250.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 32B
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Locker Room Service Counter
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Counters and Tables
Barrier Type:	Counter - Surface Height
Code References:	2010 ADAS 902.3
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	No section at least 3 feet long between 28" and 34" provided at existing counter
Findings:	36" high
Rec. Solution:	Provide min. 3 ft long section of counter at max. 34" high
Barrier Severity:	3 Hindrance Cost Est \$875.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 33A
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Corridor H006
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	
	Corridors
Barrier Type:	Sign - Permanent Room/Space
Barrier Type: Code References:	
Code	Sign - Permanent Room/Space 2010 ADAS 703.1
Code References:	Sign - Permanent Room/Space 2010 ADAS 703.1
Code References: Performance Sta Barrier	Sign - Permanent Room/Space  2010 ADAS 703.1  andard: No Quantity: EACH As-built: 2
Code References: Performance Sta Barrier Description:	Sign - Permanent Room/Space  2010 ADAS 703.1  andard: No Quantity: EACH As-built : 2  No sign with raised characters and Braille at permanent room or space with visual sign
Code References: Performance Sta Barrier Description: Findings:	Sign - Permanent Room/Space  2010 ADAS 703.1  Indard: No Quantity: EACH As-built: 2  No sign with raised characters and Braille at permanent room or space with visual sign  No tactile info on sign with visual information  Provide sign at latch side of entry door, where possible
Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Sign - Permanent Room/Space   2010 ADAS 703.1



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 33B
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Corridor H006
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Corridors
Barrier Type:	Protruding Object
Code References:	2010 ADAS 307
Performance Sta	ndard: No Quantity: EACH As-built : 2
Barrier Description:	Protruding object in in circulation path protrudes more than 4" between 27" and 80" high
Findings:	Junction box and telephone protrude 6" at 60-1/4" high
Rec. Solution:	Remove objects or provide detectable warning (wing walls)
Barrier Severity:	1 Necessary Cost Est \$1,100.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes: Junction	box and telephone
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 33C
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Corridor H006
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Actuator or Control - Height
Code References:	2010 ADAS 305.3
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Control or mechanism not at max. 48" high for side reach
Findings:	Telephone 55" high
Rec. Solution:	Relocate control or mechanism to max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 33D
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Corridor H006
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Alarms
Barrier Type:	Fire Extinguisher - Protruding Hazard
Code References:	2010 ADAS 307.2
Performance Sta	andard: No Quantity: JOB As-built : 1
Barrier Description:	Fire extinguisher protrudes into circulation path more than 4" between 27" and 80"
Findings:	Protrudes 5" at 32" high
Rec. Solution:	Remount extinguisher with leading edge below 27" or provide detectable warning
Barrier Severity:	4 Low Severity Cost Est \$1,500.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 33E
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Corridor H006
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	Visual Information Provided (Exhibitions)
Code References:	ADA Title II Technical Assistance Manual 3.2000 Denial of participation
Performance Sta	andard: No Quantity: JOB As-built : 1
Barrier	
Description:	Visual sign providing information for program, service or activity not accessible
	Visual sign providing information for program, service or activity not accessible  Accessible sign not provided
Description: Findings:	
Description: Findings: Rec. Solution:	Accessible sign not provided  Provide information in alternate format to provide access to people with vision impairments
Description:	Accessible sign not provided  Provide information in alternate format to provide access to people with vision impairments  1 Necessary Cost Est \$5,000.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 33F
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Corridor H006
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	Lobby Info Sign
Code References:	Performance Standard
Performance Sta	ndard: Yes Quantity: EACH As-built : 1
Barrier Description:	No lobby informational sign with location of accessible elements
Findings:	Accessible sign not provided
Rec. Solution:	Provide lobby informational sign
Barrier Severity:	1 Necessary Cost Est \$250.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 33G
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Corridor H006
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Corridors
Barrier Type:	Horn/Strobe Device
Code References:	2010 ADAS 702.1
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	No horn or strobe in corridor where fire alarm exists in building
Findings:	No device provided
Rec. Solution:	Provide horn/strobe in common use area
Barrier Severity:	1 Necessary Cost Est \$5,500.00 Facility Function: Public Status: Open
Implementation	
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 33H
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Corridor H006
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Type:	Handrail - Both Sides
Code References:	2010 ADAS 505.10.2
Performance Sta	ndard: No Quantity: LF As-built : 8
Barrier Description:	No handrail provided at both sides of stairway
Findings:	No handrail provided at both sides
Rec. Solution:	Provide handrails at both sides of stairway
Barrier Severity:	2 Recommended Cost Est \$1,800.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 33I
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Corridor H006
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Type:	Contrasting Color - ADA
Code References:	2010 ADAS Advisory 504.4
Performance Sta	indard: Yes Quantity: LF or TR As-built : 1
Barrier Description:	No contrasting color on each tread of interior stairway
Findings:	Treads lack contrasting color defined as 70% contrast
Rec. Solution:	Recommended: Consider providing contrasting color on each tread
Barrier Severity:	2 Recommended Cost Est \$35.00 Facility Function: Public Status: Open
Implementation	2 Recommended 555.00 Facility Family Family Family



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 33J
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Corridor H006
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Type:	Surface Condition - Existing
Code References:	2010 ADAS 504.4
Performance Sta	andard: No Quantity: SF As-built: 16
Barrier Description:	Stairway surface is not slip resistant
Findings:	Slip resistant surface could not be verified
Rec. Solution:	Provide slip-resistant surface when remodeling
Barrier Severity:	4 Low Severity Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 33K
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Corridor H006
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	Permanent Room/Space - Tactile Characters
Code References:	2010 ADAS 216.2
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	At interior or exterior location, no tactile characters at sign identifying permanent rooms and spaces
Findings:	No tactile signage provided at entry door from interior corridor
Rec. Solution:	
	Provide accessible sign
Barrier Severity:	
	1 Necessary Cost Est \$250.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 33L
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Corridor H006
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Door Closer - Automatic Device
Code References:	2010 ADAS 404.2.9
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Door opening force exceeds 5 lbf
Findings:	14 lbf
Rec. Solution:	Provide automatic door opening device
Barrier Severity:	1 Necessary Cost Est \$5,000.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 33M
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Corridor H006
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Door Closer - Sweep
Code References:	2010 ADAS 404.2.8.1
	2010 ADAS 404.2.0.1
Performance Sta	
Performance Sta	indard: No Quantity: EACH As-built : 0
Performance Sta Barrier Description:	ndard: No Quantity: EACH As-built : 0  Door closer lacks min. 5 second sweep period
Performance Sta Barrier Description: Findings:	ndard: No Quantity: EACH As-built: 0  Door closer lacks min. 5 second sweep period  2 second sweep  Provide automatic door opening device
Performance Sta Barrier Description: Findings: Rec. Solution:	Door closer lacks min. 5 second sweep period  2 second sweep  Provide automatic door opening device  1 Necessary  Cost Est \$0.00  Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 33N
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Corridor H006
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Door Hardware - Operation
Code References:	2010 ADAS 404.2.7
Performance Sta	indard: No Quantity: EACH As-built : 0
Barrier Description:	Operating controls involve tight grasping, pinching or twisting
Findings:	Hardware not operable with a closed fist
Rec. Solution:	Provide automatic door opening device
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 330
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Corridor H006
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Door Threshold (Ramp)
Code References:	2010 ADAS 404.2.5
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Door/Gate threshold height exceeds 1/2"
Findings:	2-3/4" high
Rec. Solution:	Provide ramp leading to new level landing at door
Barrier Severity:	1 Necessary Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes:	implementation rade.



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 33P
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Corridor H006
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Door Closer - Exterior Adjustment
Code References:	Performance Standard
Performance Sta	ndard: Yes Quantity: EACH As-built : 1
Barrier Description:	Door opening force exceeds 8.5 lbf
Findings:	16 lbf
Rec. Solution:	Replace or adjust existing closer
Barrier Severity:	1 Necessary Cost Est \$450.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 33Q
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Corridor H006
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Door Closer - Sweep Period
	07/26/2014 19:37
Code References:	2010 ADAS 404.2.8.1
	2010 ADAS 404.2.8.1
References:	2010 ADAS 404.2.8.1
References: Performance Sta Barrier	2010 ADAS 404.2.8.1 andard: No Quantity: EACH As-built: 0
References: Performance Sta Barrier Description:	2010 ADAS 404.2.8.1  Indard: No Quantity: EACH As-built: 0  Door closer lacks min. 5 second sweep period
References: Performance Sta Barrier Description: Findings:	2010 ADAS 404.2.8.1  Indard: No Quantity: EACH As-built: 0  Door closer lacks min. 5 second sweep period  2 second sweep  Replace or adjust existing closer
References: Performance Sta Barrier Description: Findings: Rec. Solution:	2010 ADAS 404.2.8.1  Indard: No Quantity: EACH As-built: 0  Door closer lacks min. 5 second sweep period  2 second sweep  Replace or adjust existing closer  2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 33R
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Corridor H006
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Vision Lights - Existing
Code References:	2010 ADAS 404.2.11
Performance Sta	ndard: No Quantity: EACH As-built : 2
Barrier Description:	View panels in or adjacent to doors or gates not max. 43" above floor or ground
Findings:	View panel located higher than 43" above the floor
Rec. Solution:	Replace doors/gates or vision panels
Barrier Severity:	3 Hindrance Cost Est \$4,500.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: 56" high	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 33S
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Corridor H006
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Threshold - Height exceeding 1/2"
Code References:	2010 ADAS 404.2.5
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Door/Gate threshold exceeds 1/2" in height
Findings:	1" high
Rec. Solution:	Provide new door threshold
Barrier Severity:	1 Necessary Cost Est \$275.00 Facility Function: Public Status: Open
Implementation	
	Priority: 1 Implementation Phase: Implementation Date:



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 33T
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Corridor H006
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	Tactile Exit Signs - Door
Code References:	2010 ADAS 216.4.1
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Ground floor doors that exit to exterior lacks tactile exit sign
Findings:	Exit door with low level illuminated sign lacks tactile exit sign
Rec. Solution:	Provide sign stating "EXIT" at exit side of door
Barrier Severity:	1 Necessary Cost Est \$250.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 33U
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Corridor H006
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Doormat 02/26/2014 11:57
Code References:	2010 ADAS 302.2 & Advisory 302.2
Performance Sta	andard: No Quantity: EACH As-built : 2
Barrier Description:	Doormat not anchored to floor (possible trip hazard)
Findings:	Doormats not secured
Rec. Solution:	Secure exiting doormats or replace
Barrier Severity:	1 Necessary Cost Est \$1,000.00 Facility Function: Public Status: Open
Implementation	
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 34A
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Open Lab 004
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	Permanent Room/Space - Tactile Characters
Code References:	2010 ADAS 216.2
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	At interior or exterior location, no tactile characters at sign identifying permanent rooms and spaces
Findings:	No tactile signage provided at door within public route
Rec. Solution:	Provide accessible sign
Barrier Severity:	1 Necessary Cost Est \$250.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 34B
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Open Lab 004
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Laboratory Facilities
Barrier Type:	Door Closer - Automatic Device
Code	2010 ADAS 404.2.9
References:	
Performance Sta	andard: No Quantity: EACH As-built: 1
	ndard: No Quantity: EACH As-built : 1  Door opening force exceeds 5 lbf
Performance Sta Barrier	
Performance Sta Barrier Description:	Door opening force exceeds 5 lbf
Performance Sta Barrier Description: Findings:	Door opening force exceeds 5 lbf  14 lbf  Provide automatic door opening device
Performance Sta Barrier Description: Findings: Rec. Solution:	Door opening force exceeds 5 lbf  14 lbf  Provide automatic door opening device  1 Necessary Cost Est \$5,000.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 34C
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Open Lab 004
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Laboratory Facilities
Barrier Type:	Door Closer - Sweep
Code References:	2010 ADAS 404.2.8.1
Performance Sta	ndard: No Quantity: EACH As-built : 0
Barrier Description:	Door closer lacks min. 5 second sweep period
Findings:	2 second sweep
Rec. Solution:	Provide automatic door opening device
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 34D
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Open Lab 004
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Laboratory Facilities
Barrier Type:	Door Hardware - Operation
Code References:	2010 ADAS 404.2.7
Performance Sta	ndard: No Quantity: EACH As-built : 0
Barrier Description:	Operating controls involve tight grasping, pinching or twisting
Findings:	Hardware not operable with a closed fist
Rec. Solution:	Provide automatic door opening device
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 34E
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Open Lab 004
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Door Vision Lights
Code References:	2010 ADAS 404.2.11
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	View panels in or adjacent to doors or gates not max. 43" above floor or ground
Findings:	Bottom edge of view panel in door or adjacent to door is not max. 43" high
Rec. Solution:	Replace door/gate or vision panel
Barrier Severity:	3 Hindrance Cost Est \$2,250.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 34F
Field Date: Bldg Name:	2/24/2014   Report Date   2/27/2014   Barrier #:   34F
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Bldg Name: Location:	Women's Building Reference Dwg: 3 of 6  Basement - Open Lab 004
Bldg Name: Location: X Coordinate:	Women's Building Reference Dwg: 3 of 6  Basement - Open Lab 004  N/A Y Coordinate: N/A
Bldg Name: Location: X Coordinate: Barrier Area:	Women's Building Reference Dwg: 3 of 6  Basement - Open Lab 004  N/A Y Coordinate: N/A  Laboratory Facilities
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code	Women's Building Reference Dwg: 3 of 6  Basement - Open Lab 004  N/A Y Coordinate: N/A  Laboratory Facilities  Door Clearance - Min. 18" at Pull Side  2010 ADAS Figure 404.2.4.1
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Women's Building Reference Dwg: 3 of 6  Basement - Open Lab 004  N/A Y Coordinate: N/A  Laboratory Facilities  Door Clearance - Min. 18" at Pull Side  2010 ADAS Figure 404.2.4.1
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Women's Building Reference Dwg: 3 of 6  Basement - Open Lab 004  N/A Y Coordinate: N/A  Laboratory Facilities  Door Clearance - Min. 18" at Pull Side  2010 ADAS Figure 404.2.4.1  Indard: No Quantity: EACH As-built: 0
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Women's Building  Reference Dwg: 3 of 6  Basement - Open Lab 004  N/A  Y Coordinate: N/A  Laboratory Facilities  Door Clearance - Min. 18" at Pull Side  2010 ADAS Figure 404.2.4.1  Indard: No Quantity: EACH As-built: 0  Door lacks min. 18" strike edge clearance at pull side
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Women's Building  Reference Dwg: 3 of 6  Basement - Open Lab 004  N/A  Y Coordinate: N/A  Laboratory Facilities  Door Clearance - Min. 18" at Pull Side  2010 ADAS Figure 404.2.4.1  mdard: No Quantity: EACH As-built: 0  Door lacks min. 18" strike edge clearance at pull side  11-1/4" strike edge clearance
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Women's Building  Reference Dwg: 3 of 6  Basement - Open Lab 004  N/A  Y Coordinate: N/A  Laboratory Facilities  Door Clearance - Min. 18" at Pull Side  2010 ADAS Figure 404.2.4.1  Indard: No Quantity: EACH As-built: 0  Door lacks min. 18" strike edge clearance at pull side  11-1/4" strike edge clearance  Provide automatic door opening device  1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 34G
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Open Lab 004
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Electrical Switches - Height
Code References:	2010 ADAS 308.2
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Light switch control box top edge not at max. 48" high
Findings:	48-1/4" high
Rec. Solution:	Relocate switch box top edge to max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 34H
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Open Lab 004
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Laboratory Facilities
Barrier Type:	Workstation - Surface
Code References:	2010 ADAS 902
References:	
References: Performance Sta Barrier	ndard: No Quantity: EACH As-built : 1
References: Performance Sta Barrier Description:	ndard: No Quantity: EACH As-built: 1  Table or workstation surface height exceeds 34" high
References: Performance Sta Barrier Description: Findings:	Table or workstation surface height exceeds 34" high  47-3/4" surface height  Replace workstation or provide alternative accessible workstation
References: Performance Sta Barrier Description: Findings: Rec. Solution:	Table or workstation surface height exceeds 34" high  47-3/4" surface height  Replace workstation or provide alternative accessible workstation  3 Hindrance Cost Est \$875.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 34I
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Open Lab 004
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Laboratory Facilities
Barrier Type:	Workstation - Knee Clearance
Code References:	2010 ADAS 902
Performance Sta	indard: No Quantity: EACH As-built : 0
Barrier Description:	Knee clearance of at least 27" high, 30" wide and 8" deep not provided underneath workstation
Findings:	No knee clearance
Rec. Solution:	Reposition workstation to provide knee clearance
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: Tall wor	kstation
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 34J
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Open Lab 004
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Actuator/Control - Forward Reach Obstructed (10"-25")
Code References:	2010 ADAS 308.2
Performance Sta	indard: No Quantity: EACH As-built : 1
Barrier Description:	Control or mechanism over an 10" to 25" obstruction max. 34" high located above 44"
Findings:	Monitor at 58-1/2" high and 23-1/4" deep over 47-3/4" high counter
Rec. Solution:	Relocate controls or mechanisms to max. 44" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 34K
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Open Lab 004
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Actuator/Control - Fist Operable
Code References:	2010 ADAS 305.3
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Control or mechanism not usable with a closed fist
Findings:	Cabinets controls not fist operable
Rec. Solution:	Replace operating controls
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 34L
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Open Lab 004
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Clear Floor Space - Stored Elements
Code References:	2010 ADAS 305.3
Performance Sta	indard: No Quantity: JOB As-built : 0
Barrier Description:	Clear floor space for wheelchair not provided at control or mechanism
Findings:	Carts block blackboard clear floor space
Rec. Solution:	Move stored items
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	· · · · · · · · · · · · · · · · · · ·



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 34M
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Open Lab 004
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Laboratory Facilities
Barrier Type:	Workstation - Knee Clearance
Code References:	2010 ADAS 902
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Knee clearance of at least 27" high, 30" wide and 8" deep not provided underneath workstation
Findings:	24" high knee clearance
Rec. Solution:	Provide min. one accessible workstation
Barrier Severity:	1 Necessary Cost Est \$875.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: 2 fixed o	łesks
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 34N
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Open Lab 004
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Laboratory Facilities
Barrier Type:	Electrical Outlets
	89790,0114 19 49
Code References:	2010 ADAS 308.2.2
	2010 ADAS 308.2.2
References:	2010 ADAS 308.2.2
References: Performance Sta Barrier	2010 ADAS 308.2.2  Indard: No Quantity: EACH As-built: 1
References: Performance Sta Barrier Description:	2010 ADAS 308.2.2  Indard: No Quantity: EACH As-built: 1  Use of outlet involves low reach of less than 15" or more than 48"
References: Performance Sta Barrier Description: Findings:	2010 ADAS 308.2.2  Indard: No Quantity: EACH As-built: 1  Use of outlet involves low reach of less than 15" or more than 48"  1" high  Relocate outlet to area with max. 15 low reach or max.48" high reach
References: Performance Sta Barrier Description: Findings: Rec. Solution:	2010 ADAS 308.2.2  Indard: No Quantity: EACH As-built: 1  Use of outlet involves low reach of less than 15" or more than 48"  1" high  Relocate outlet to area with max. 15 low reach or max.48" high reach  3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 340
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Open Lab 004
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Alarms
Barrier Type:	Horn/Strobe
Code References:	2010 ADAS 702.1
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	No horn/strobes in classroom
Findings:	No device provided
Rec. Solution:	Provide strobes in common use area
Barrier Severity:	1 Necessary Cost Est \$5,500.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 35A
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Grad Student Office 004A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	Permanent Room/Space - Tactile Characters
Code References:	2010 ADAS 216.2
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	At interior or exterior location, no tactile characters at sign identifying permanent rooms and spaces
	, .
Findings:	No tactile signage provided at door within public route
Findings: Rec. Solution:	
J	No tactile signage provided at door within public route  Provide accessible sign
Rec. Solution:	No tactile signage provided at door within public route  Provide accessible sign  1 Necessary Cost Est \$250.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 35B
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Grad Student Office 004A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Door Hardware - Operation
Code References:	2010 ADAS 404.2.7
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Operating controls involve tight grasping, pinching or twisting
Findings:	Door knob and lock hardware not fist operable
Rec. Solution:	Replace hardware
Barrier Severity:	1 Necessary Cost Est \$300.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 35C
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Grad Student Office 004A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Door Clear Width - Min. 32"
Code References:	2010 ADAS 404.2.3
Performance Sta	andard: No Quantity: EACH As-built : 0
Barrier Description:	Door clear width is not min. 32"
Findings:	27" clear width
Rec. Solution:	Replace door/gate and frame
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 35D
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Grad Student Office 004A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Front App/push 48"
Code References:	2010 ADAS Figure 404.2.4.1
Performance Sta	ndard: No Quantity: ADMINI As-built : 0
Barrier Description:	Door/Gate at push side with min. 18" lacks min. 48" perpendicular to door
Findings:	46-1/2" perpendicular to cabinet
Rec. Solution:	Remove cabinet
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 35E
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Grad Student Office 004A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Door Clearance - Min. 18" at Pull Side
Code References:	2010 ADAS Figure 404.2.4.1
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Door lacks min. 18" strike edge clearance at pull side
Findings:	10-3/4" strike edge clearance at exit side
Rec. Solution:	Relocate door or gate to provide maneuvering clearance
Barrier Severity:	1 Necessary Cost Est \$2,250.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 35F
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Grad Student Office 004A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Electrical Switches - Max. 48" High
Code References:	2010 ADAS 308.2.1
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Light switch control box top edge not at max. 48" high
Findings:	50-1/2" high
Rec. Solution:	Relocate switch box top edge to max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 35G
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Grad Student Office 004A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Coat Hook - Height
Code References:	2010 ADAS 603.4
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Clothing hooks not max. 48" high AFF
Description.	Clothing Hooks Hot Max. 10 Might All
Findings:	56" high
Findings:	56" high Provide additional hook in new location
Findings: Rec. Solution:	56" high  Provide additional hook in new location  2 Recommended Cost Est \$125.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 35H
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Grad Student Office 004A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Electrical Outlets
Code References:	2010 ADAS 308.2.2
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Use of outlet involves low reach of less than 15" above floor or not max. 48" high
Findings:	1" high
Rec. Solution:	Relocate outlet to area with max. 15 low reach or max.48" high reach
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: Outlets	on ground.
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 35I
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Grad Student Office 004A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Desk - Knee Clearance
Code References:	2010 ADAS 902
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Knee clearance of at least 27" high, 30" wide and 8" deep not provided underneath desk
Findings:	25" high knee clearance
Rec. Solution:	Provide min. one accessible desk
Barrier Severity:	1 Necessary Cost Est \$450.00 Facility Function: Public Status: Open
	1 Weecssury Same States   Spen
implementation	Priority: 2 Implementation Phase: Implementation Date:



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 35J
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Grad Student Office 004A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Actuator/Control - Forward Reach Obstructed (10"-25")
Code References:	2010 ADAS 308.2
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Control or mechanism over an 10" to 25" obstruction max. 34" high located above 44"
Findings:	Phone and office supplies 26" deep
Rec. Solution:	Relocate to max. 25" deep
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 35K
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Bldg Name: Location:	Women's Building Reference Dwg: 3 of 6  Basement - Grad Student Office 004A
Location:	Basement - Grad Student Office 004A
Location: X Coordinate:	Basement - Grad Student Office 004A  N/A  Y Coordinate: N/A
Location: X Coordinate: Barrier Area:	Basement - Grad Student Office 004A  N/A  Y Coordinate: N/A  Controls and Mechanisms
Location: X Coordinate: Barrier Area: Barrier Type: Code	Basement - Grad Student Office 004A  N/A  Y Coordinate: N/A  Controls and Mechanisms  Actuator/Control - Forward Reach Obstructed (10"-25")  2010 ADAS 308.2
Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Basement - Grad Student Office 004A  N/A  Y Coordinate: N/A  Controls and Mechanisms  Actuator/Control - Forward Reach Obstructed (10"-25")  2010 ADAS 308.2
Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Basement - Grad Student Office 004A  N/A  Y Coordinate: N/A  Controls and Mechanisms  Actuator/Control - Forward Reach Obstructed (10"-25")  2010 ADAS 308.2  Indard: No Quantity: EACH As-built: 1
Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Basement - Grad Student Office 004A  N/A  Y Coordinate: N/A  Controls and Mechanisms  Actuator/Control - Forward Reach Obstructed (10"-25")  2010 ADAS 308.2  Indard: No Quantity: EACH As-built: 1  Control or mechanism over an 10" to 25" obstruction max. 34" high located above 44"
Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Basement - Grad Student Office 004A  N/A  Y Coordinate: N/A  Controls and Mechanisms  Actuator/Control - Forward Reach Obstructed (10"-25")  2010 ADAS 308.2  Indard: No Quantity: EACH As-built: 1  Control or mechanism over an 10" to 25" obstruction max. 34" high located above 44"  Printer 61" high and 24-1/2" deep over an obstruction 29-1/2" high  Relocate control or mechanism to max. 44" high
Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Basement - Grad Student Office 004A  N/A  Y Coordinate: N/A  Controls and Mechanisms  Actuator/Control - Forward Reach Obstructed (10"-25")  2010 ADAS 308.2  Indard: No Quantity: EACH As-built: 1  Control or mechanism over an 10" to 25" obstruction max. 34" high located above 44"  Printer 61" high and 24-1/2" deep over an obstruction 29-1/2" high  Relocate control or mechanism to max. 44" high  3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 35L
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Grad Student Office 004A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Shelves or Cabinets
Code References:	2010 ADAS 603.4
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Shelf or cabinet not mounted between 40" and 48" above floor or ground
Findings:	Shelf or cabinet not accessible
Rec. Solution:	Provide additional shelf at accessible height or provide assistance
Barrier Severity:	2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: 55-1/4"	high
Field Deter	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 35M
Bldg Name:	2/24/2014   Report Date   2/27/2014   Barrier #:   35M
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Bldg Name: Location:	Women's Building Reference Dwg: 3 of 6  Basement - Grad Student Office 004A
Bldg Name: Location: X Coordinate:	Women's Building Reference Dwg: 3 of 6  Basement - Grad Student Office 004A  N/A Y Coordinate: N/A
Bldg Name: Location: X Coordinate: Barrier Area:	Women's Building Reference Dwg: 3 of 6  Basement - Grad Student Office 004A  N/A Y Coordinate: N/A  Alarms
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code	Women's Building Reference Dwg: 3 of 6  Basement - Grad Student Office 004A  N/A Y Coordinate: N/A  Alarms  Horn/Strobe  2010 ADAS 702.1
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Women's Building Reference Dwg: 3 of 6  Basement - Grad Student Office 004A  N/A Y Coordinate: N/A  Alarms  Horn/Strobe  2010 ADAS 702.1
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Women's Building Reference Dwg: 3 of 6  Basement - Grad Student Office 004A  N/A Y Coordinate: N/A  Alarms  Horn/Strobe  2010 ADAS 702.1  ndard: No Quantity: EACH As-built: 1
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Women's Building Reference Dwg: 3 of 6  Basement - Grad Student Office 004A  N/A Y Coordinate: N/A  Alarms  Horn/Strobe  2010 ADAS 702.1  ndard: No Quantity: EACH As-built: 1  No horn/strobes in classroom
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Women's Building Reference Dwg: 3 of 6  Basement - Grad Student Office 004A  N/A Y Coordinate: N/A  Alarms  Horn/Strobe  2010 ADAS 702.1  ndard: No Quantity: EACH As-built: 1  No horn/strobes in classroom  No device provided
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Women's Building  Reference Dwg: 3 of 6  Basement - Grad Student Office 004A  N/A  Y Coordinate: N/A  Alarms  Horn/Strobe  2010 ADAS 702.1  No horn/strobes in classroom  No device provided  Provide strobes in common use area  1 Necessary  Cost Est \$5,500.00  Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 36A
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Classroom 003
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	Permanent Room/Space - Tactile Characters
Code References:	2010 ADAS 216.2
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	At interior or exterior location, no tactile characters at sign identifying permanent rooms and spaces
Findings:	No tactile signage provided at door within public route
Rec. Solution:	Provide accessible sign
Barrier Severity:	1 Necessary Cost Est \$250.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes: Hall doo	or
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 36B
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Classroom 003
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Door Closer - Automatic Device
Code References:	2010 ADAS 404.2.9
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Door opening force exceeds 5 lbf
Findings:	19 lbf
Rec. Solution:	Provide automatic door opening device
Barrier Severity:	1 Necessary Cost Est \$5,000.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 36C
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Classroom 003
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Door Closer - Backcheck
Code References:	2010 ADAS 404.2.8.1
Performance Sta	andard: Quantity: JOB As-built : 0
Barrier Description:	Door closer does not stop at least 5" from door frame (no back check)
Findings:	Door does not stop 5" from close
Rec. Solution:	Provide automatic door opening device
Barrier Severity:	2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 36D
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Classroom 003
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	
	Classrooms
Barrier Type:	Door Hardware - Operation
Barrier Type: Code References:	
Code	Door Hardware - Operation 2010 ADAS 404.2.7
Code References:	Door Hardware - Operation 2010 ADAS 404.2.7
Code References: Performance Sta Barrier	Door Hardware - Operation  2010 ADAS 404.2.7  andard: No Quantity: EACH As-built: 1
Code References: Performance Sta Barrier Description:	Door Hardware - Operation  2010 ADAS 404.2.7  andard: No Quantity: EACH As-built: 1  Operating controls involve tight grasping, pinching or twisting
Code References: Performance Sta Barrier Description: Findings:	Door Hardware - Operation  2010 ADAS 404.2.7  andard: No Quantity: EACH As-built: 1  Operating controls involve tight grasping, pinching or twisting  Hardware not operable with a closed fist  Replace hardware
Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Door Hardware - Operation  2010 ADAS 404.2.7  andard: No Quantity: EACH As-built: 1  Operating controls involve tight grasping, pinching or twisting  Hardware not operable with a closed fist  Replace hardware  1 Necessary Cost Est \$300.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 36E
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Classroom 003
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Door Vision Lights
Code References:	2010 ADAS 404.2.11
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	View panels in or adjacent to doors or gates not max. 43" above floor or ground
Findings:	Bottom edge of view panel in door or adjacent to door is not max. 43" high
Rec. Solution:	Replace door/gate or vision panel
Barrier Severity:	3 Hindrance Cost Est \$2,250.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 36F
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Classroom 003
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Door Clearance - Min. 18" at Pull Side
Code References:	2010 ADAS Figure 404.2.4.1
Performance Sta	ndard: No Quantity: EACH As-built : 0
Barrier Description:	Door lacks min. 18" strike edge clearance at pull side
Findings:	10" strike edge clearance
Rec. Solution:	Move furniture to provide access
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: Door to	lab 004



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 36G
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Classroom 003
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Door Clearance - Min. 12" at Push Side
Code References:	2010 ADAS Figure 404.2.4.1
Performance Sta	indard: No Quantity: EACH As-built : 0
Barrier Description:	Door lacks min. 12" strike edge clearance at push side
Findings:	6" strike edge clearance
Rec. Solution:	Move furniture to provide access
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: Door to	lab 004
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 36H
Field Date: Bldg Name:	2/24/2014Report Date2/27/2014Barrier #:36HWomen's BuildingReference Dwg:3 of 6
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Bldg Name: Location:	Women's Building Reference Dwg: 3 of 6  Basement - Classroom 003
Bldg Name: Location: X Coordinate:	Women's Building Reference Dwg: 3 of 6  Basement - Classroom 003  N/A Y Coordinate: N/A  Classrooms  Electrical Switches - Max. 48" High
Bldg Name: Location: X Coordinate: Barrier Area:	Women's Building Reference Dwg: 3 of 6  Basement - Classroom 003  N/A Y Coordinate: N/A  Classrooms
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code	Women's Building Reference Dwg: 3 of 6  Basement - Classroom 003  N/A Y Coordinate: N/A  Classrooms  Electrical Switches - Max. 48" High  2010 ADAS 308.2.1
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Women's Building Reference Dwg: 3 of 6  Basement - Classroom 003  N/A Y Coordinate: N/A  Classrooms  Electrical Switches - Max. 48" High  2010 ADAS 308.2.1
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Women's Building Reference Dwg: 3 of 6  Basement - Classroom 003  N/A Y Coordinate: N/A  Classrooms  Electrical Switches - Max. 48" High  2010 ADAS 308.2.1  Indard: No Quantity: EACH As-built: 1
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Women's Building Reference Dwg: 3 of 6  Basement - Classroom 003  N/A Y Coordinate: N/A  Classrooms  Electrical Switches - Max. 48" High  2010 ADAS 308.2.1  Indard: No Quantity: EACH As-built: 1  Light switch control box top edge not at max. 48" high
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Women's Building Reference Dwg: 3 of 6  Basement - Classroom 003  N/A Y Coordinate: N/A  Classrooms  Electrical Switches - Max. 48" High  2010 ADAS 308.2.1  Indard: No Quantity: EACH As-built: 1  Light switch control box top edge not at max. 48" high  50-1/2" high  Relocate switch box top edge to max. 48" high
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Women's Building Reference Dwg: 3 of 6  Basement - Classroom 003  N/A Y Coordinate: N/A  Classrooms  Electrical Switches - Max. 48" High  2010 ADAS 308.2.1  Indard: No Quantity: EACH As-built: 1  Light switch control box top edge not at max. 48" high  50-1/2" high  Relocate switch box top edge to max. 48" high  Relocate switch box top edge to max. 48" high  3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 36I
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Classroom 003
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Chalkboard/Whiteboard - Area of Use
Code References:	Performance Standard & 2010 ADAS 904.3.3
Performance Sta	ndard: Yes Quantity: EACH As-built : 1
Barrier Description:	Bottom edge of writing surface not max. 38" high
Findings:	Lower edge of writing surface 40" high from floor
Rec. Solution:	Remount whiteboard/chalkboard or provide alternate for use by short people
Barrier Severity:	3 Hindrance Cost Est \$1,200.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 36J
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Classroom 003
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Clear Floor Space - Stored Elements
Code References:	2010 ADAS 305.3
Performance Sta	ndard: No Quantity: JOB As-built : 0
Barrier Description:	Clear floor space for wheelchair not provided at control or mechanism
Findings:	Podium blocks AV controls and telephone clear floor space
Findings: Rec. Solution:	Podium blocks AV controls and telephone clear floor space  Move podium to provide access
_	Move podium to provide access
Rec. Solution:	Move podium to provide access  1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 36K
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Classroom 003
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Podium - Surface Height
Code References:	2010 ADAS 902.3
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Surface height exceeds 34" high
Findings:	40" surface height
Rec. Solution:	Provide min. 1 accessible podium
Barrier Severity:	3 Hindrance Cost Est \$1,275.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 36L
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Classroom 003
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Podium - Knee Clearance
Code References:	2010 ADAS 902.3
Performance Sta	andard: No Quantity: EACH As-built : 0
Barrier Description:	Podium knee clearance not min. 27" high, 19" deep or 30" wide
Findings:	No knee clearance
Rec. Solution:	Provide min. 1 accessible podium
	i Tovide IIIII. 1 decessible bodidiii
Barrier Severity:	
Barrier Severity: Implementation	3 Hindrance Cost Est \$0.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 36M
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Classroom 003
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Actuator or Control - Operation
Code References:	2010 ADAS 305.3
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Control or mechanism not usable with a closed fist
Findings:	Cabinet hardware not fist operable
Rec. Solution:	Replace operating control
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 36N
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Classroom 003
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Workstation - Knee Clearance
Code References:	2010 ADAS 902
Performance Sta	ndard: No Quantity: EACH As-built : 0
Barrier Description:	Knee clearance of at least 27" high, 30" wide and 8" deep not provided
Findings:	24" high knee clearance
Rec. Solution:	Reposition min. 1 workstation to provide knee clearance
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	
	Priority: 2 Implementation Phase: Implementation Date:



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 360
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Classroom 003
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Actuator/Control - Forward Reach Obstructed (10"-25")
Code References:	2010 ADAS 305.3
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Control or mechanism over an 10" to 25" obstruction max. 34" high located above 44"
Findings:	VCR 55" high and 20-1/2" deep over an obstruction 28-1/2" high
Rec. Solution:	Relocate control or mechanism to max. 44" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 36P
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Classroom 003
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Counters and Tables
Barrier Type:	Table - Knee Clearance
Code References:	2010 ADAS 305.3
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Knee clearance not min. 27" high, 19" deep or 30" wide
Findings:	Knee clearance blocked by stored items
Rec. Solution:	Move stored objects
Barrier Severity:	3 Hindrance Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 36Q
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Classroom 003
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Alarm - No Horn/Strobe
Code References:	2010 ADAS 702.1
Performance Sta	indard: No Quantity: EACH As-built: 1
Barrier Description:	Where a fire alarm is installed, no horn/strobe provided
Findings:	No device provided
Rec. Solution:	Provide horn/strobe in common use area
Barrier Severity:	1 Necessary Cost Est \$5,500.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes: These de	esks are accessible Workstations around the back walls are not
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 37A
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Elevator E001
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Elevators
Barrier Type:	Doorjamb marking - Raised Star
Code References:	2010 ADAS 407.2.3.1
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Elevator landing door jamb signage at ground level lacks a raised five pointed star
Findings:	No raised star provided
Rec. Solution:	Replace door jamb signage
Barrier Severity:	1 Necessary Cost Est \$250.00 Facility Function: Public Status: Open
	Tachicy function. Journal Status. Jopen
Implementation	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 37B
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Elevator E001
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Elevators
Barrier Type:	Doorjamb marking - Height
Code References:	2010 ADAS 407.2.3.1
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Elevator landing door jamb signage not located 60" on center on both jamb panels
Findings:	60-5/8" high
Rec. Solution:	Replace door jamb signage
Barrier Severity:	2 Recommended Cost Est \$250.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 37C
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Elevator E001
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Elevators
Barrier Type:	Hall Call Buttons - 42" High
Code References:	2010 ADAS 407.2.1
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	The centerline of the hall call buttons not max. 42" above the floor
Findings:	42-1/2" high
Rec. Solution:	Replace hall call buttons
Barrier Severity:	1 Necessary Cost Est \$3,500.00 Facility Function: Public Status: Open
Implementation	· <u> </u>
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 37D
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Elevator E001
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Elevators
Barrier Type:	Hall Call Buttons
Code References:	2010 ADAS 407.4.5
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Hall call buttons not internally illuminated with a white light over the entire button surface
Findings:	Call button does not illuminate
Rec. Solution:	Replace hall call buttons
Barrier Severity:	1 Necessary Cost Est \$3,500.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 37E
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Elevator E001
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Elevators
Barrier Type:	Door Delay Duration
Code	22/25/2014 11:18
References:	2010 ADAS 407.3.3.3
	2010 ADAS 407.3.3.3
References:	2010 ADAS 407.3.3.3
References: Performance Sta Barrier	2010 ADAS 407.3.3.3  andard: No Quantity: JOB As-built: 1
References: Performance Sta Barrier Description:	2010 ADAS 407.3.3.3  andard: No Quantity: JOB As-built: 1  Door reopening devices does not remain effective for 20 seconds minimum
References: Performance Sta Barrier Description: Findings:	2010 ADAS 407.3.3.3  andard: No Quantity: JOB As-built: 1  Door reopening devices does not remain effective for 20 seconds minimum  10 second delay  Adiust door delay
References: Performance Sta Barrier Description: Findings: Rec. Solution:	2010 ADAS 407.3.3.3  andard: No Quantity: JOB As-built: 1  Door reopening devices does not remain effective for 20 seconds minimum  10 second delay  Adiust door delay  1 Necessary Cost Est \$3,500.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 37F
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Elevator E001
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Elevators
Barrier Type:	Car Control Buttons - Illumination
Code References:	2010 ADAS 407.4.8
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Visual floor buttons do not illuminate as the car passes floors or stops
Findings:	Car buttons do not illuminate (up-down)
Rec. Solution:	Replace car controls
Barrier Severity:	2 Recommended Cost Est \$2,750.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Data	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 37G
Field Date: Bldg Name:	2/24/2014   Report Date  2/27/2014   Barrier #:  37G
	Women's Building Reference Dwg: 3 of 6  Basement - Elevator E001
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Bldg Name: Location:	Women's Building Reference Dwg: 3 of 6  Basement - Elevator E001
Bldg Name: Location: X Coordinate:	Women's Building Reference Dwg: 3 of 6  Basement - Elevator E001  N/A Y Coordinate: N/A
Bldg Name: Location: X Coordinate: Barrier Area:	Women's Building Reference Dwg: 3 of 6  Basement - Elevator E001  N/A Y Coordinate: N/A  Elevators  Audible Signals
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code	Women's Building Reference Dwg: 3 of 6  Basement - Elevator E001  N/A Y Coordinate: N/A  Elevators  Audible Signals  2010 ADAS 407.2.2.1
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Women's Building Reference Dwg: 3 of 6  Basement - Elevator E001  N/A Y Coordinate: N/A  Elevators  Audible Signals  2010 ADAS 407.2.2.1
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Women's Building Reference Dwg: 3 of 6  Basement - Elevator E001  N/A Y Coordinate: N/A  Elevators  Audible Signals  2010 ADAS 407.2.2.1  Indard: No Quantity: EACH As-built: 1
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Women's Building  Reference Dwg: 3 of 6  Basement - Elevator E001  N/A  Y Coordinate: N/A  Elevators  Audible Signals  2010 ADAS 407.2.2.1  Audible signals or verbal announcement does not sound when the car passes a floor or stops
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Women's Building  Reference Dwg: 3 of 6  Basement - Elevator E001  N/A  Y Coordinate: N/A  Elevators  Audible Signals  2010 ADAS 407.2.2.1  Audible signals or verbal announcement does not sound when the car passes a floor or stops  No audible controls to indicate travel  Replace car controls
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Women's Building Reference Dwg: 3 of 6  Basement - Elevator E001  N/A Y Coordinate: N/A  Elevators  Audible Signals  2010 ADAS 407.2.2.1  Audible signals or verbal announcement does not sound when the car passes a floor or stops  No audible controls to indicate travel  Replace car controls  2 Recommended Cost Est \$2,750.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 37H
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Elevator E001
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Elevators
Barrier Type:	Emergency Controls - 2-way
Code References:	2010 ADAS 407.4.9 and ASME A17.1
Performance Sta	andard: No Quantity: JOB As-built : 1
Barrier Description:	Emergency two-way communication system not provided
Findings:	Emergency communication system uses voice command
Rec. Solution:	Replace emergency system
Barrier Severity:	1 Necessary Cost Est \$3,500.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 37I
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Elevator E001
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Elevators
Barrier Type:	Emergency Controls
Code References:	2010 ADAS 409.4.7
Performance Sta	andard: No Quantity: JOB As-built : 1
Barrier Description:	Emergency telephone handset not positioned at max. 4 ft above the floor
Findings:	No phone provided
Rec. Solution:	Replace emergency system
Rec. Solution: Barrier Severity:	
	1 Necessary Cost Est \$3,500.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 38A
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Stairway S006
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Type:	Sign - Encl Stairway Level
Code References:	ICC A117.1
Performance Sta	indard: No Quantity: EACH As-built : 1
Barrier Description:	Tactile stairway signage not provided to indicate floor level
Findings:	No sign indicating floor level and discharge level
Rec. Solution:	Provide sign
Barrier Severity:	2 Recommended Cost Est \$250.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 38B
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Stairway S006
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Type:	Door Closer - Interior Adjustment
Code References:	2010 ADAS 404.2.9
Performance Sta	indard: No Quantity: EACH As-built : 1
Barrier Description:	Door opening force exceeds 5 lbf
Findings:	9 lbf
Rec. Solution:	Replace or adjust existing closer
Barrier Severity:	1 Necessary Cost Est \$450.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	<u> </u>



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 38C
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Stairway S006
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Type:	Door Closer - Interior Sweep ADA
Code References:	2010 ADAS 404.2.8.1
Performance Sta	ndard: No Quantity: EACH As-built : 0
Barrier Description:	Door closer lacks min. 5 second sweep period
Findings:	3 second sweep
Rec. Solution:	Replace or adjust existing closer
Barrier Severity:	2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 38D
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Stairway S006
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Type:	Door Hardware - Operation
Code References:	2010 ADAS 404.2.7
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Hardware not operable with a closed fist
Findings:	Hardware not operable with a closed fist
Rec. Solution:	Replace hardware
Barrier Severity:	1 Necessary Cost Est \$300.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	·



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 38E
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Stairway S006
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Vision Lights - Existing
Code References:	2010 ADAS 404.2.11
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	View panels in or adjacent to doors or gates not max. 43" above floor or ground
Findings:	View panel located higher than 43" above the floor
Rec. Solution:	Replace door/gate or vision panel
Barrier Severity:	3 Hindrance Cost Est \$2,250.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 38F
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Stairway S006
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Electrical Switches - Height
Code References:	2010 ADAS 308.2.1
Performance Sta	indard: No Quantity: EACH As-built : 1
Barrier Description:	Light switch control box top edge not at max. 48" high
Findings:	52-1/4" high
Rec. Solution:	Relocate switch box top edge to max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 38G
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Stairway S006
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Type:	Handrail Height
Code References:	2010 ADAS 505.10.2
Performance Sta	ndard: No Quantity: LF As-built : 72
Barrier Description:	Handrail grip measured at center not 34"- 38" high
Findings:	33" handrail grip height
Rec. Solution:	Provide handrails at both sides of stairway
Barrier Severity:	2 Recommended Cost Est \$16,200.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 38H
	2/24/2014 Report Date 2/27/2014 Barrier #: 38H  Women's Building Reference Dwg: 3 of 6
Bldg Name:	
Bldg Name: Location:	Women's Building Reference Dwg: 3 of 6
Bldg Name: Location: X Coordinate:	Women's Building Reference Dwg: 3 of 6  Basement - Stairway S006
Field Date: Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type:	Women's Building Reference Dwg: 3 of 6  Basement - Stairway S006  N/A Y Coordinate: N/A
Bldg Name: Location: X Coordinate: Barrier Area:	Women's Building Reference Dwg: 3 of 6  Basement - Stairway S006  N/A Y Coordinate: N/A  Stairways  Handrail Extension - Bottom
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code	Women's Building Reference Dwg: 3 of 6  Basement - Stairway S006  N/A Y Coordinate: N/A  Stairways  Handrail Extension - Bottom  2010 ADAS 505.10.3
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Women's Building Reference Dwg: 3 of 6  Basement - Stairway S006  N/A Y Coordinate: N/A  Stairways  Handrail Extension - Bottom  2010 ADAS 505.10.3
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Women's Building Reference Dwg: 3 of 6  Basement - Stairway S006  N/A Y Coordinate: N/A  Stairways  Handrail Extension - Bottom  2010 ADAS 505.10.3  ndard: No Quantity: LF As-built: 0
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Women's Building Reference Dwg: 3 of 6  Basement - Stairway S006  N/A Y Coordinate: N/A  Stairways  Handrail Extension - Bottom  2010 ADAS 505.10.3  ndard: No Quantity: LF As-built: 0  Bottom handrail extension not sloped for length of one tread beyond the last riser nosing
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Women's Building Reference Dwg: 3 of 6  Basement - Stairway S006  N/A Y Coordinate: N/A  Stairways  Handrail Extension - Bottom  2010 ADAS 505.10.3   Mo Quantity: LF As-built: 0  Bottom handrail extension not sloped for length of one tread beyond the last riser nosing  No extensions provided
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Women's Building  Reference Dwg: 3 of 6  Basement - Stairway S006  N/A Y Coordinate: N/A  Stairways  Handrail Extension - Bottom  2010 ADAS 505.10.3  ndard: No Quantity: LF As-built: 0  Bottom handrail extension not sloped for length of one tread beyond the last riser nosing  No extensions provided  Provide handrails at both sides of stairway  2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 38I
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Stairway S006
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Type:	Handrail Extension - Top Length
Code References:	2010 ADAS 505.10.2
Performance Sta	ndard: No Quantity: LF As-built : 0
Barrier Description:	Top Handrail extension does not extend for one tread width or min. 12"
Findings:	Top handrail extension not parallel to ground surface
Rec. Solution:	Provide handrails at both sides of stairway
Barrier Severity:	2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 38J
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Stairway S006
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Type:	Contrasting Color - ADA
Code References:	2010 ADAS Advisory 504.4
Performance Sta	ndard: Yes Quantity: LF or TR As-built : 1
Barrier Description:	No contrasting color on each tread of interior stairway
Findings:	Treads lack contrasting color defined as 70% contrast
Rec. Solution:	Recommended: Consider providing contrasting color on each tread
Barrier Severity:	2 Recommended Cost Est \$35.00 Facility Function: Public Status: Open
Implementation	
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 38K
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Stairway S006
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Type:	Surface Condition - Existing
Code References:	2010 ADAS 504.4
Performance Sta	indard: No Quantity: SF As-built: 0
Barrier Description:	Stairway surface is not slip resistant
Findings:	Slip resistant surface could not be verified
Rec. Solution:	Provide slip-resistant surface when remodeling
Barrier Severity:	4 Low Severity Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 38L
Bldg Name:	Women's Building   Reference Dwg:   3 of 6
Bldg Name: Location:	Women's Building   Reference Dwg:   3 of 6
_	
Location:	Basement - Stairway S006
Location: X Coordinate:	Basement - Stairway S006  N/A Y Coordinate: N/A  Alarms  Horn/Strobe - Common Use Area
Location: X Coordinate: Barrier Area:	Basement - Stairway S006  N/A Y Coordinate: N/A  Alarms
Location: X Coordinate: Barrier Area: Barrier Type: Code	Basement - Stairway S006  N/A  Y Coordinate: N/A  Alarms  Horn/Strobe - Common Use Area  2010 ADAS 702.1
Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Basement - Stairway S006  N/A  Y Coordinate: N/A  Alarms  Horn/Strobe - Common Use Area  2010 ADAS 702.1
Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Basement - Stairway S006  N/A  Y Coordinate: N/A  Alarms  Horn/Strobe - Common Use Area  2010 ADAS 702.1  Indard: No  Quantity: EACH  As-built: 1
Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Basement - Stairway S006  N/A  Y Coordinate: N/A  Alarms  Horn/Strobe - Common Use Area  2010 ADAS 702.1  Indard: No  Quantity: EACH  As-built:  No horn/strobes in common use areas
Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Basement - Stairway S006  N/A  Y Coordinate: N/A  Alarms  Horn/Strobe - Common Use Area  2010 ADAS 702.1  Indard: No Quantity: EACH As-built: 1  No horn/strobes in common use areas  No device provided  Provide strobe in common use area
Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Basement - Stairway S006  N/A  Y Coordinate: N/A  Alarms  Horn/Strobe - Common Use Area  2010 ADAS 702.1  ndard: No Quantity: EACH As-built: 1  No horn/strobes in common use areas  No device provided  Provide strobe in common use area  1 Necessary Cost Est \$5,500.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 39A
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Corridor H001
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Corridors
Barrier Type:	Sign - Permanent Room/Space
Code References:	2010 ADAS 703.1
Performance Sta	ndard: No Quantity: EACH As-built : 6
Barrier Description:	No sign with raised characters and Braille at permanent room or space with visual sign
Findings:	No tactile info on signs with visual information
Rec. Solution:	Provide signs at latch side of entry door
Barrier Severity:	1 Necessary Cost Est \$1,500.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes: Rooms 2	25, 8, 01, 7J, 7I, and a storage room
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 39B
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Corridor H001
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Corridors
Barrier Type:	Protruding Object
Code References:	2010 ADAS 307
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Protruding object in in circulation path protrudes more than 4" between 27" and 80" high
Findings:	Valve protrudes 5-5/8" at 67-1/2" high
Rec. Solution:	Provide detectable warning (wing walls)
Barrier Severity:	1 Necessary Cost Est \$550.00 Facility Function: Public Status: Open
Implementation	
	Priority: 1 Implementation Phase: Implementation Date:



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 39C
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Corridor H001
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	Visual Information Provided (Exhibitions)
Code References:	ADA Title II Technical Assistance Manual 3.2000 Denial of participation
Performance Sta	ndard: No Quantity: JOB As-built : 1
Barrier Description:	Visual sign providing information for program, service or activity not accessible
Findings:	Accessible sign not provided
Rec. Solution:	Provide information in alternate format to provide access to people with vision impairments
Barrier Severity:	1 Necessary Cost Est \$5,000.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes: Multiple	e instances
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 39D
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Corridor H001
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Drinking Fountains
Barrier Type:	Alcove - Existing (pre-1992)
Code References:	2010 ADAS 307.2
Performance Sta	ndard: No Quantity: SF As-built: 1
Barrier Description:	Fountain with a leading edge between 27" and 80" high protrudes more than 4" into the circulation path.
Findings:	No alcove provided. Drinking fountain protrudes into circulation path
Rec. Solution:	Provide wing walls as detectable warning (existing unit only)
Rec. Solution: Barrier Severity:	
	1 Necessary Cost Est \$250.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 39E
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Corridor H001
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Drinking Fountains
Barrier Type:	Operation - Manual (Fist)
Code References:	2010 ADAS 602.3
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Operating mechanism at fountain is not operable with a fist
Findings:	Not fist operable
Rec. Solution:	Replace fountain with accessible unit
Barrier Severity:	2 Recommended Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 39F
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Corridor H001
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Drinking Fountains
Barrier Type:	Operation - Adjustment
Code References:	2010 ADAS 602.3
Performance Sta	ndard: No Quantity: EACH As-built : 0
Barrier Description:	Operating mechanism involves more than 5 lbf to operate
Findings:	12 lbf needed to operate
Rec. Solution:	Adiust existing controls
Barrier Severity:	2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 39G
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Corridor H001
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Drinking Fountains
Barrier Type:	Bubbler height
Code References:	2010 ADAS 602.4
Performance Sta	ndard: No Quantity: EACH As-built : 0
Barrier Description:	Bubbler height exceeds 36"
Findings:	39" bubbler height
Rec. Solution:	Provide min. one low fountain for short people or people who use wheelchairs
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 39H
Dida Nama:	Poforonce Durge 2 . C.C.
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Corridor H001
•	
Location:	Basement - Corridor H001
Location: X Coordinate:	Basement - Corridor H001  N/A Y Coordinate: N/A  Drinking Fountains  Depth
Location: X Coordinate: Barrier Area:	Basement - Corridor H001  N/A Y Coordinate: N/A  Drinking Fountains
Location: X Coordinate: Barrier Area: Barrier Type: Code	Basement - Corridor H001  N/A Y Coordinate: N/A  Drinking Fountains  Depth  2010 ADAS 602.5
Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Basement - Corridor H001  N/A Y Coordinate: N/A  Drinking Fountains  Depth  2010 ADAS 602.5
Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Basement - Corridor H001  N/A  Y Coordinate: N/A  Drinking Fountains  Depth  2010 ADAS 602.5  Indard: No Quantity: EACH As-built: 0
Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Basement - Corridor H001  N/A Y Coordinate: N/A  Drinking Fountains  Depth  2010 ADAS 602.5  Indard: No Quantity: EACH As-built: 0  Wall/post mounted fountain not min. 18" deep
Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Basement - Corridor H001  N/A  Y Coordinate: N/A  Drinking Fountains  Depth  2010 ADAS 602.5  mdard: No Quantity: EACH As-built: 0  Wall/post mounted fountain not min. 18" deep  14" deep  Provide min. one low fountain for short people or people who use wheelchairs
Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Basement - Corridor H001  N/A  Y Coordinate: N/A  Drinking Fountains  Depth  2010 ADAS 602.5  Mall/post mounted fountain not min. 18" deep  Provide min. one low fountain for short people or people who use wheelchairs  1 Necessary  Cost Est \$0.00  Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 39I
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Corridor H001
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Electrical Switches - Height
Code References:	2010 ADAS 308.2.1
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Light switch control box top edge not at max. 48" high
Findings:	52-1/4" high
Rec. Solution:	Relocate switch box top edge to max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 39J
Field Date: Bldg Name:	2/24/2014Report Date2/27/2014Barrier #:39JWomen's BuildingReference Dwg:3 of 6
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Bldg Name: Location:	Women's Building Reference Dwg: 3 of 6  Basement - Corridor H001
Bldg Name: Location: X Coordinate:	Women's Building Reference Dwg: 3 of 6  Basement - Corridor H001  N/A Y Coordinate: N/A
Bldg Name: Location: X Coordinate: Barrier Area:	Women's Building Reference Dwg: 3 of 6  Basement - Corridor H001  N/A Y Coordinate: N/A  Corridors
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code	Women's Building Reference Dwg: 3 of 6  Basement - Corridor H001  N/A Y Coordinate: N/A  Corridors  Horn/Strobe Device  2010 ADAS 702.1
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Women's Building Reference Dwg: 3 of 6  Basement - Corridor H001  N/A Y Coordinate: N/A  Corridors  Horn/Strobe Device  2010 ADAS 702.1
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Women's Building Reference Dwg: 3 of 6  Basement - Corridor H001  N/A Y Coordinate: N/A  Corridors  Horn/Strobe Device  2010 ADAS 702.1  Indard: No Quantity: EACH As-built: 2
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Women's Building   Reference Dwg:   3 of 6     Basement - Corridor H001   N/A   Y Coordinate:   N/A     Corridors   Horn/Strobe Device   2010 ADAS 702.1     Indard:   No   Quantity:   EACH   As-built :   2     No horn or strobe in corridor where fire alarm exists in building
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Women's Building  Reference Dwg: 3 of 6  Basement - Corridor H001  N/A  Y Coordinate: N/A  Corridors  Horn/Strobe Device  2010 ADAS 702.1  No horn or strobe in corridor where fire alarm exists in building  No device provided  Provide horn/strobe in common use area
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Women's Building   Reference Dwg:   3 of 6



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 39K
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Corridor H001
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Corridors
Barrier Type:	Fire Alarm - Pull Actuator Operation
Code References:	2010 ADAS 309.4
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Fire pull has no usable hardware
Findings:	Hardware not operable with a closed fist
Rec. Solution:	Replace fire pull when remodeling
Barrier Severity:	4 Low Severity Cost Est \$3,500.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 39L
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Corridor H001
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	
Daillei Aled.	Corridors
Barrier Type:	Fire Alarm - Pull Actuator Height
Barrier Type: Code	Fire Alarm - Pull Actuator Height 2010 ADAS 308.2.2
Barrier Type: Code References:	Fire Alarm - Pull Actuator Height 2010 ADAS 308.2.2
Barrier Type: Code References: Performance Sta Barrier	Fire Alarm - Pull Actuator Height  2010 ADAS 308.2.2  andard: No Quantity: EACH As-built: 0
Barrier Type: Code References: Performance Sta Barrier Description:	Fire Alarm - Pull Actuator Height  2010 ADAS 308.2.2  andard: No Quantity: EACH As-built: 0  Fire pulls not between 42" and 48" high
Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Fire Alarm - Pull Actuator Height  2010 ADAS 308.2.2  andard: No Quantity: EACH As-built: 0  Fire pulls not between 42" and 48" high  60-3/4" high  Replace fire pull when remodeling
Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Fire Alarm - Pull Actuator Height  2010 ADAS 308.2.2  andard: No Quantity: EACH As-built: 0  Fire pulls not between 42" and 48" high  60-3/4" high  Replace fire pull when remodeling  4 Low Severity Cost Est \$0.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 39M
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Corridor H001
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Clear Floor Space
Barrier Type:	Passageway - Min. 36"
Code References:	2010 ADAS 403.5.1
Performance Sta	andard: No Quantity: LF As-built : 0
Barrier Description:	Circulation route through corridor not min. 36"
Findings:	32" wide circulation route to seating and table
Rec. Solution:	Move furniture to allow access
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: For acce	ess to table between sofas
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 39N
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Corridor H001
X Coordinate:	
	N/A Y Coordinate: N/A
Barrier Area:	N/A
Barrier Area:	Counters and Tables
Barrier Area: Barrier Type: Code	Counters and Tables Table - Knee Clearance 2010 ADAS 305.3
Barrier Area: Barrier Type: Code References:	Counters and Tables Table - Knee Clearance 2010 ADAS 305.3
Barrier Area: Barrier Type: Code References: Performance Sta	Counters and Tables Table - Knee Clearance 2010 ADAS 305.3  andard: No Quantity: EACH As-built: 1
Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Counters and Tables  Table - Knee Clearance  2010 ADAS 305.3  andard: No Quantity: EACH As-built: 1  Knee clearance not min. 27" high, 19" deep or 30" wide
Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Counters and Tables  Table - Knee Clearance  2010 ADAS 305.3  Indard: No Quantity: EACH As-built: 1  Knee clearance not min. 27" high, 19" deep or 30" wide  25-1/4" high and 25-5/8" wide knee clearance  Provide min. 1 accessible table in public space
Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Counters and Tables  Table - Knee Clearance  2010 ADAS 305.3  Indard: No Quantity: EACH As-built: 1  Knee clearance not min. 27" high, 19" deep or 30" wide  25-1/4" high and 25-5/8" wide knee clearance  Provide min. 1 accessible table in public space  3 Hindrance Cost Est \$450.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 40A
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Stairway S002
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Type:	Sign - Encl Stairway Level
Code References:	ICC A117.1
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Tactile stairway signage not provided to indicate floor level
Findings:	No sign indicating floor level and discharge level
Rec. Solution:	Provide sign
Barrier Severity:	2 Recommended Cost Est \$250.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 40B
Field Date: Bldg Name:	2/24/2014   Report Date   2/27/2014   Barrier #:   40B   Women's Building   Reference Dwg:   3 of 6
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Bldg Name: Location:	Women's Building Reference Dwg: 3 of 6  Basement - Stairway S002
Bldg Name: Location: X Coordinate:	Women's Building Reference Dwg: 3 of 6  Basement - Stairway S002  N/A Y Coordinate: N/A
Bldg Name: Location: X Coordinate: Barrier Area:	Women's Building Reference Dwg: 3 of 6  Basement - Stairway S002  N/A Y Coordinate: N/A  Stairways
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code	Women's Building Reference Dwg: 3 of 6  Basement - Stairway S002  N/A Y Coordinate: N/A  Stairways  Handrail Grip  2010 ADAS 505.10.2
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Women's Building Reference Dwg: 3 of 6  Basement - Stairway S002  N/A Y Coordinate: N/A  Stairways  Handrail Grip  2010 ADAS 505.10.2
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Women's Building Reference Dwg: 3 of 6  Basement - Stairway S002  N/A Y Coordinate: N/A  Stairways  Handrail Grip  2010 ADAS 505.10.2  ndard: No Quantity: LF As-built: 2
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Women's Building Reference Dwg: 3 of 6  Basement - Stairway S002  N/A Y Coordinate: N/A  Stairways  Handrail Grip  2010 ADAS 505.10.2  ndard: No Quantity: LF As-built: 2  Handrail grip is not continuous
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Women's Building Reference Dwg: 3 of 6  Basement - Stairway S002  N/A Y Coordinate: N/A  Stairways  Handrail Grip  2010 ADAS 505.10.2  Indard: No Quantity: LF As-built: 2  Handrail grip is not continuous  Handrail grip is not continuous at structural support
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Women's Building Reference Dwg: 3 of 6  Basement - Stairway S002  N/A Y Coordinate: N/A  Stairways  Handrail Grip  2010 ADAS 505.10.2  Handrail grip is not continuous  Handrail grip is not continuous at structural support  Provide handrails at both sides of stairway  2 Recommended Cost Est \$450.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 40C
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Stairway S002
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Type:	Handrail Height
Code References:	2010 ADAS 505.10.2
Performance Sta	andard: No Quantity: LF As-built : 28
Barrier Description:	Handrail grip measured at center not 34"- 38" high
Findings:	29" handrail grip height
Rec. Solution:	Provide handrails at both sides of stairway
Barrier Severity:	2 Recommended Cost Est \$6,300.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 40D
	12/24/2014 Heport Date 12/21/2014 Date III 140D
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Bldg Name: Location:	Women's Building Reference Dwg: 3 of 6  Basement - Stairway S002
Bldg Name: Location: X Coordinate:	Women's Building Reference Dwg: 3 of 6  Basement - Stairway S002  N/A Y Coordinate: N/A
Bldg Name: Location: X Coordinate: Barrier Area:	Women's Building Reference Dwg: 3 of 6  Basement - Stairway S002  N/A Y Coordinate: N/A  Stairways
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code	Women's Building Reference Dwg: 3 of 6  Basement - Stairway S002  N/A Y Coordinate: N/A  Stairways  Handrail Extension - Bottom  2010 ADAS 505.10.3
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Women's Building Reference Dwg: 3 of 6  Basement - Stairway S002  N/A Y Coordinate: N/A  Stairways  Handrail Extension - Bottom  2010 ADAS 505.10.3
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Women's Building Reference Dwg: 3 of 6  Basement - Stairway S002  N/A Y Coordinate: N/A  Stairways  Handrail Extension - Bottom  2010 ADAS 505.10.3  Indard: No Quantity: LF As-built: 0
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Women's Building  Reference Dwg: 3 of 6  Basement - Stairway S002  N/A  Y Coordinate: N/A  Stairways  Handrail Extension - Bottom  2010 ADAS 505.10.3  Indard: No Quantity: LF As-built: 0  Bottom handrail extension not sloped for length of one tread beyond the last riser nosing
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Women's Building Reference Dwg: 3 of 6  Basement - Stairway S002  N/A Y Coordinate: N/A  Stairways  Handrail Extension - Bottom  2010 ADAS 505.10.3  mdard: No Quantity: LF As-built: 0  Bottom handrail extension not sloped for length of one tread beyond the last riser nosing  No extensions provided  Provide handrails at both sides of stairway
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Women's Building Reference Dwg: 3 of 6  Basement - Stairway S002  N/A Y Coordinate: N/A  Stairways  Handrail Extension - Bottom  2010 ADAS 505.10.3  Indard: No Quantity: LF As-built: 0  Bottom handrail extension not sloped for length of one tread beyond the last riser nosing  No extensions provided  Provide handrails at both sides of stairway  2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 40E
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Stairway S002
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Type:	Handrail Extension - Top Length
Code References:	2010 ADAS 505.10.2
Performance Sta	ndard: No Quantity: LF As-built : 0
Barrier Description:	Top Handrail extension does not extend for one tread width or min. 12"
Findings:	Top handrail extension not parallel to ground surface
Rec. Solution:	Provide handrails at both sides of stairway
Barrier Severity:	2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 41A
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Stairway S003
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Type:	Sign - Encl Stairway Level
Code References:	ICC A117.1
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Tactile stairway signage not provided to indicate floor level
Findings:	No sign indicating floor level and discharge level
Rec. Solution:	Provide sign
Barrier Severity:	2 Recommended Cost Est \$250.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	<u> </u>



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 41B
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Stairway S003
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Type:	Handrail Grip
Code References:	2010 ADAS 505.10.2
Performance Sta	ndard: No Quantity: LF As-built : 2
Barrier Description:	Handrail grip is not continuous
Findings:	Handrail grip is not continuous at structural support
Rec. Solution:	Provide handrails at both sides of stairway
Barrier Severity:	2 Recommended Cost Est \$450.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes: Both sid	es
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 41C
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Stairway S003
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Type:	Handrail Height
Code References:	2010 ADAS 505.10.2
Performance Sta	ndard: No Quantity: LF As-built : 28
Barrier Description:	Handrail grip measured at center not 34"- 38" high
Findings:	30" handrail grip height
Rec. Solution:	Provide handrails at both sides of stairway
Barrier Severity:	2 Recommended Cost Est \$6,300.00 Facility Function: Public Status: Open
Implementation	
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 41D
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Stairway S003
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Type:	Handrail Extension - Bottom
Code References:	2010 ADAS 505.10.3
Performance Sta	ndard: No Quantity: LF As-built : 0
Barrier Description:	Bottom handrail extension not sloped for length of one tread beyond the last riser nosing
Findings:	No extension provided
Rec. Solution:	Provide handrails at both sides of stairway
Barrier Severity:	2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 41E
Bldg Name:	Women's Building Reference Dwg: 3 of 6
Location:	Basement - Stairway S003
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Type:	Handrail Extension - Top Length
Code References:	2010 ADAS 505.10.2
Performance Sta	ndard: No Quantity: LF As-built : 0
Barrier Description:	Top Handrail extension does not extend for one tread width or min. 12"
Findings:	Top handrail extension not parallel to ground surface
Rec. Solution:	Provide handrails at both sides of stairway
Barrier Severity:	2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	· _ · <u> </u>
Notes:	p.eee.e.e.e.e.e.e.e.e



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 42A
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Stairway S103
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	Permanent Room/Space - Tactile Characters
Code References:	2010 ADAS 216.2
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	No tactile characters at sign identifying permanent rooms and spaces with visual signs
Findings:	No tactile signage provided at door within public route
Rec. Solution:	Provide accessible sign
Barrier Severity:	1 Necessary Cost Est \$250.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes: Stairway	y S103
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 42B
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Stairway S103
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Door Closer - Interior Adjustment
Code References:	2010 ADAS 404.2.9
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Door opening force exceeds 5 lbf
Findings:	11 lbf
Rec. Solution:	Replace or adjust existing closer
Barrier Severity:	1 Necessary Cost Est \$450.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes: Door no	t part of an accessible route. Automatic door opening device not needed



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 42C
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Stairway S103
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Door Closer - Sweep Period
Code References:	2010 ADAS 404.2.8.1
Performance Sta	ndard: No Quantity: EACH As-built : 0
Barrier Description:	Door closer lacks min. 5 second sweep period
Findings:	4 second sweep
Rec. Solution:	Replace or adjust existing closer
Barrier Severity:	2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes: Door no	t part of an accessible route. Automatic door opening device not needed
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 42D
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Stairway S103
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Hardware - Operation
Code	
References:	2010 ADAS 404.2.7
	2010 ADAS 404.2.7
References:	2010 ADAS 404.2.7
References: Performance Sta Barrier	2010 ADAS 404.2.7  Indard: No Quantity: EACH As-built: 1
References: Performance Sta Barrier Description:	2010 ADAS 404.2.7  Indard: No Quantity: EACH As-built: 1  Hardware not operable with a closed fist
References: Performance Sta Barrier Description: Findings:	2010 ADAS 404.2.7  Indard: No Quantity: EACH As-built: 1  Hardware not operable with a closed fist  Hardware not operable with a closed fist  Provide new hardware
References: Performance Sta Barrier Description: Findings: Rec. Solution:	2010 ADAS 404.2.7  Indard: No Quantity: EACH As-built: 1  Hardware not operable with a closed fist  Hardware not operable with a closed fist  Provide new hardware  1 Necessary Cost Est \$300.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 42E
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Stairway S103
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Type:	Electrical Switches - Height
Code References:	2010 ADAS 308.2.1
Performance Sta	indard: No Quantity: EACH As-built : 1
Barrier Description:	Light switch control box top edge not at max. 48" high
Findings:	50-1/4" high
Rec. Solution:	Relocate switch box top edge to max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 42F
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Stairway S103
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Type:	Sign - Exit Door
Code References:	Performance Standard
Performance Sta	ndard: Yes Quantity: EACH As-built : 1
Barrier Description:	Door leading directly into an exit stairway lacks tactile exit sign
Findings:	Door to exit stair with low level illuminated sign lacks tactile exit sign
Rec. Solution:	Provide sign stating "EXIT STAIR DOWN (or UP)" at latch side of door
Barrier Severity:	2 Recommended Cost Est \$250.00 Facility Function: Public Status: Open
Implementation	
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 42G
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Stairway S103
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Type:	Sign - Encl Stairway Level
Code References:	ICC A117.1
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Tactile stairway signage not provided to indicate floor level
Findings:	No sign indicating floor level
Rec. Solution:	Provide sign
Barrier Severity:	2 Recommended Cost Est \$250.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 43A
Field Date: Bldg Name:	2/24/2014 Report Date 2/27/2014 Barrier #: 43A Women's Building Reference Dwg: 4 of 6
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Bldg Name: Location:	Women's Building Reference Dwg: 4 of 6 Floor 1 - Stairway S102
Bldg Name: Location: X Coordinate:	Women's Building Reference Dwg: 4 of 6  Floor 1 - Stairway S102  N/A Y Coordinate: N/A
Bldg Name: Location: X Coordinate: Barrier Area:	Women's Building Reference Dwg: 4 of 6  Floor 1 - Stairway S102  N/A Y Coordinate: N/A  Signage
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code	Women's Building Reference Dwg: 4 of 6  Floor 1 - Stairway S102  N/A Y Coordinate: N/A  Signage  Permanent Room/Space - Tactile Characters  2010 ADAS 216.2
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Women's Building Reference Dwg: 4 of 6  Floor 1 - Stairway S102  N/A Y Coordinate: N/A  Signage  Permanent Room/Space - Tactile Characters  2010 ADAS 216.2
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Women's Building Reference Dwg: 4 of 6  Floor 1 - Stairway S102  N/A Y Coordinate: N/A  Signage  Permanent Room/Space - Tactile Characters  2010 ADAS 216.2  ndard: No Quantity: EACH As-built: 1  At interior or exterior location, no tactile characters at sign identifying permanent rooms and
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Women's Building Reference Dwg: 4 of 6  Floor 1 - Stairway S102  N/A Y Coordinate: N/A  Signage  Permanent Room/Space - Tactile Characters  2010 ADAS 216.2  ndard: No Quantity: EACH As-built: 1  At interior or exterior location, no tactile characters at sign identifying permanent rooms and spaces
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Women's Building Reference Dwg: 4 of 6  Floor 1 - Stairway S102  N/A Y Coordinate: N/A  Signage  Permanent Room/Space - Tactile Characters  2010 ADAS 216.2  At interior or exterior location, no tactile characters at sign identifying permanent rooms and spaces  No tactile signage provided at door within public route
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Women's Building Reference Dwg: 4 of 6  Floor 1 - Stairway S102  N/A Y Coordinate: N/A  Signage  Permanent Room/Space - Tactile Characters  2010 ADAS 216.2  At interior or exterior location, no tactile characters at sign identifying permanent rooms and spaces  No tactile signage provided at door within public route  Provide accessible sign  1 Necessary Cost Est \$250.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 43B
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Stairway S102
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Door Closer - Interior Adjustment
Code References:	2010 ADAS 404.2.9
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Door opening force exceeds 5 lbf
Findings:	12 lbf
Rec. Solution:	Replace or adjust existing closer
Barrier Severity:	1 Necessary Cost Est \$450.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes: Door no	t part of an accessible route. Automatic door opening device not needed
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 43C
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Stairway S102
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Door Closer - Backcheck
Code References:	2010 ADAS 404.2.8.1
Performance Sta	ndard: Quantity: JOB As-built : 0
Barrier Description:	Door closer does not stop at least 5" from door frame (no back check)
Findings:	Door does not stop 5" from close
Rec. Solution:	Adiust closer
Barrier Severity:	2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes: Does no	t stop 5 inches from close. Door not part of an accessible route. Automatic door opening device



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 43D
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Stairway S102
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Hardware - Operation
Code References:	2010 ADAS 404.2.7
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Hardware not operable with a closed fist
Findings:	Hardware not operable with a closed fist
Rec. Solution:	Provide new hardware
Barrier Severity:	1 Necessary Cost Est \$300.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 43F
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Stairway S102
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Type:	Electrical Switches - Height
Code References:	2010 ADAS 308.2.1
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Light switch control box top edge not at max. 48" high
Findings:	49-3/4" high
Rec. Solution:	Relocate switch box top edge to max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 43G
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Stairway S102
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Type:	Sign - Exit Door
Code References:	Performance Standard
Performance Sta	ndard: Yes Quantity: EACH As-built : 1
Barrier Description:	Door leading directly into an exit stairway lacks tactile exit sign
Findings:	Door to exit stair with low level illuminated sign lacks tactile exit sign
Rec. Solution:	Provide sign stating "EXIT STAIR DOWN (or UP)" at latch side of door
Barrier Severity:	2 Recommended Cost Est \$250.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 43H
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Stairway S102
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Type:	Sign - Encl Stairway Level
Code References:	ICC A117.1
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Tactile stairway signage not provided to indicate floor level
Findings:	No sign indicating floor level
Rec. Solution:	Provide sign
Barrier Severity:	2 Recommended Cost Est \$250.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 44A
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Entry Lobby L101
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Door Closer - Exterior Adjustment
Code References:	Performance Standard
Performance Sta	andard: Yes Quantity: EACH As-built : 2
Barrier Description:	Door opening force exceeds 8.5 lbf
Findings:	13-17 lbf at entry doors
Rec. Solution:	Replace or adjust existing closer
Barrier Severity:	1 Necessary Cost Est \$900.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 44B
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Entry Lobby L101
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Door Closer - Sweep Period
Code References:	2010 ADAS 404.2.8.1
Performance Sta	andard: No Quantity: EACH As-built : 0
Barrier Description:	Door closer lacks min. 5 second sweep period
Findings:	3 to 5 second sweep. No backcheck
Rec. Solution:	Replace or adjust existing closer
Barrier Severity:	2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open
Barrier Severity: Implementation	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 44D
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Entry Lobby L101
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Doormat
Code References:	2010 ADAS 302.2 & Advisory 302.2
Performance Sta	andard: No Quantity: EACH As-built : 6
Barrier Description:	Doormat not anchored to floor (possible trip hazard)
Findings:	Doormats not secured
Rec. Solution:	Secure exiting doormats or replace
Barrier Severity:	1 Necessary Cost Est \$3,000.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 44E
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Entry Lobby L101
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	Tactile Exit Signs - Door
Code References:	2010 ADAS 216.4.1
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Ground floor doors that exit to exterior lacks tactile exit sign
	•
Findings:	Exit door with low level illuminated sign lacks tactile exit sign
Findings: Rec. Solution:	Exit door with low level illuminated sign lacks tactile exit sign  Provide sign stating "EXIT" at exit side of door
-	Provide sign stating "EXIT" at exit side of door
Rec. Solution:	Provide sign stating "EXIT" at exit side of door  1 Necessary Cost Est \$250.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 44F
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Entry Lobby L101
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Actuator or Control - Height
Code References:	2010 ADAS 305.3
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Control or mechanism not at max. 48" high for side reach
Findings:	Hand sanitizer dispenser at 55" high
Rec. Solution:	Relocate control or mechanism to max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 44G
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Entry Lobby L101
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	Lobby Info Sign
Code References:	Performance Standard
Performance Sta	indard: Yes Quantity: EACH As-built : 1
Barrier Description:	No lobby informational sign with location of accessible elements
Findings:	Accessible sign not provided
Rec. Solution:	Provide lobby informational sign
Barrier Severity:	1 Necessary Cost Est \$250.00 Facility Function: Public Status: Open
Implementation	
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 44H
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Entry Lobby L101
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	Visual Information Provided (Exhibitions)
Code References:	ADA Title II Technical Assistance Manual 3.2000 Denial of participation
Performance Sta	andard: No Quantity: JOB As-built : 1
Barrier Description:	Visual sign providing information for program, service or activity not accessible
Findings:	Accessible sign not provided
Rec. Solution:	Provide information in alternate format to provide access to people with vision impairments
Barrier Severity:	1 Necessary Cost Est \$5,000.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes: Display	case and research board on opposite wall
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 44I
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Entry Lobby L101
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Alarms
Barrier Type:	Horn/Strobe
Code References:	2010 ADAS 702.1
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	No horn/strobes in common use areas
Findings.	No device provided
Findings:	
Rec. Solution:	Provide strobes in common use area
_	Provide strobes in common use area
Rec. Solution:	Provide strobes in common use area  1 Necessary Cost Est \$5,500.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 44J
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Entry Lobby Stairway
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Type:	Handrail Height
Code References:	2010 ADAS 505.10.2
Performance Sta	ndard: No Quantity: LF As-built : 1
Barrier Description:	Handrail grip measured at center not 34"- 38" high
Findings:	41" handrail grip height at inner handrail
Rec. Solution:	Provide handrails at both sides of stairway
Barrier Severity:	2 Recommended Cost Est \$225.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes: Side sta	irway handrails start at 39" and they reduce to 37"
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 44K
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Entry Lobby Stairway
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Type:	Handrail Extension
Code References:	2010 ADAS 505.10.2
Performance Sta	ndard: No Quantity: LF As-built: 0
Barrier Description:	Handrail extension does not return to wall, guard or landing surface
Findings:	Handrails protrudes over 4"
Rec. Solution:	Provide handrails at both sides of stairway
Barrier Severity:	2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 44L
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Entry Lobby Stairway
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Type:	Contrasting Color - ADA
Code References:	2010 ADAS Advisory 504.4
Performance Sta	ndard: Yes Quantity: LF or TR As-built: 1
Barrier Description:	No contrasting color on each tread of interior stairway
Findings:	Treads lack contrasting color defined as 70% contrast
Rec. Solution:	Recommended: Consider providing contrasting color on each tread
Barrier Severity:	2 Recommended Cost Est \$35.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 44M
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Entry Lobby Stairway
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Type:	Surface Condition - Existing
Code References:	2010 ADAS 504.4
Performance Sta	ndard: No Quantity: SF As-built : 0
Barrier Description:	Stairway surface is not slip resistant
Findings:	Slip resistant surface could not be verified
Rec. Solution:	Provide slip-resistant surface when remodeling
Barrier Severity:	4 Low Severity Cost Est \$0.00 Facility Function: Public Status: Open
	4 Low Severity Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 44N
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Entry Lobby Stairway
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Type:	Handrail - Opening Limitations
Code References:	2010 ADAS 216.4.1
Performance St	andard: No Quantity: LF As-built : 48
Barrier Description:	Guard or handrail have openings that allow passage of a 4" sphere
Findings:	Openings along handrails 10" to 12" wide
Rec. Solution:	Alter to limit openings
Barrier Severity	: 1 Necessary Cost Est \$10,800.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 45A
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - South Lobby Area
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	Permanent Room/Space - Tactile Characters
Code References:	2010 ADAS 216.2
Performance St	andard: No Quantity: EACH As-built : 1
Barrier Description:	At interior or exterior location, no tactile characters at sign identifying permanent rooms and spaces
Findings:	No tactile signage provided at doors within public route
Rec. Solution:	Provide accessible signs
Barrier Severity	: 1 Necessary Cost Est \$250.00 Facility Function: Public Status: Open
Implementation	
Notes: Room 1	111



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 45B
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - South Lobby Area
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Clear Floor Space
Barrier Type:	Protruding Object
Code References:	2010 ADAS 307
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Protruding object in in circulation path protrudes more than 4" between 27" and 80" high
Findings:	Defibrillator protrudes 6-1/2" at 40-1/2" high
Rec. Solution:	Provide detectable warning (wing walls)
Barrier Severity:	1 Necessary Cost Est \$550.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 45D
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - South Lobby Area
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	Lobby Info Sign
Code References:	Performance Standard
Performance Sta	ndard: Yes Quantity: EACH As-built : 1
Barrier Description:	No lobby informational sign with location of accessible elements
Findings:	Accessible sign not provided
Rec. Solution:	Provide lobby informational sign
Barrier Severity:	1 Necessary Cost Est \$250.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 45E
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - South Lobby Area
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Drinking Fountains
Barrier Type:	Alcove - Existing (pre-1992)
Code References:	2010 ADAS 307.2
Performance Sta	ndard: No Quantity: SF As-built : 2
Barrier Description:	Fountain with a leading edge between 27" and 80" high protrudes more than 4" into the circulation path.
Findings:	No alcove provided. Drinking fountain protrudes into circulation path
Rec. Solution:	Provide wing walls as detectable warning (existing unit only)
Barrier Severity:	1 Necessary Cost Est \$500.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes: Fountain	n protrudes 14-1/4" at 30" high
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 45F
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - South Lobby Area
Location: X Coordinate:	Floor 1 - South Lobby Area  N/A  Y Coordinate: N/A
X Coordinate:	N/A Y Coordinate: N/A  Drinking Fountains  Operation - Adjustment
X Coordinate: Barrier Area:	N/A Y Coordinate: N/A  Drinking Fountains
X Coordinate: Barrier Area: Barrier Type: Code	N/A Y Coordinate: N/A  Drinking Fountains  Operation - Adjustment  2010 ADAS 602.3
X Coordinate: Barrier Area: Barrier Type: Code References:	N/A Y Coordinate: N/A  Drinking Fountains  Operation - Adjustment  2010 ADAS 602.3
X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	N/A Y Coordinate: N/A    Drinking Fountains
X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	N/A  Y Coordinate: N/A  Drinking Fountains  Operation - Adjustment  2010 ADAS 602.3  Indard: No Quantity: EACH As-built: 1  Operating mechanism involves more than 5 lbf to operate
X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	N/A  Drinking Fountains  Operation - Adjustment  2010 ADAS 602.3  Indard: No Quantity: EACH As-built: 1  Operating mechanism involves more than 5 lbf to operate  17 lbf needed to operate  Adjust existing controls
X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	N/A Y Coordinate: N/A    Drinking Fountains     Operation - Adjustment     2010 ADAS 602.3     Indard: No Quantity: EACH   As-built : 1     Operating mechanism involves more than 5 lbf to operate     17 lbf needed to operate     Adjust existing controls     2 Recommended   Cost Est   \$75.00   Facility Function: Public     Open     Ope



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 45G
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - South Lobby Area
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Drinking Fountains
Barrier Type:	Hi-Low Unit
Code References:	2010 ADAS 211.2 and 602.7
Performance Sta	indard: No Quantity: EACH As-built : 1
Barrier Description:	No hi-low drinking fountain provided on each floor of building
Findings:	41" bubbler height
Rec. Solution:	Provide min. one hi-low fountain on each floor
Barrier Severity:	1 Necessary Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 45H
Field Date: Bldg Name:	2/24/2014   Report Date   2/27/2014   Barrier #:   45H   Women's Building   Reference Dwg:   4 of 6
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Bldg Name: Location:	Women's Building Reference Dwg: 4 of 6 Floor 1 - South Lobby Area
Bldg Name: Location: X Coordinate:	Women's Building Reference Dwg: 4 of 6  Floor 1 - South Lobby Area  N/A Y Coordinate: N/A  Drinking Fountains  Bubbler water flow
Bldg Name: Location: X Coordinate: Barrier Area:	Women's Building Reference Dwg: 4 of 6  Floor 1 - South Lobby Area  N/A Y Coordinate: N/A  Drinking Fountains
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code	Women's Building Reference Dwg: 4 of 6 Floor 1 - South Lobby Area N/A Y Coordinate: N/A  Drinking Fountains Bubbler water flow 2010 ADAS 602.6
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Women's Building Reference Dwg: 4 of 6 Floor 1 - South Lobby Area N/A Y Coordinate: N/A  Drinking Fountains Bubbler water flow 2010 ADAS 602.6
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Women's Building Reference Dwg: 4 of 6  Floor 1 - South Lobby Area  N/A Y Coordinate: N/A  Drinking Fountains  Bubbler water flow  2010 ADAS 602.6  Indard: No Quantity: JOB As-built: 0
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Women's Building Reference Dwg: 4 of 6  Floor 1 - South Lobby Area  N/A Y Coordinate: N/A  Drinking Fountains  Bubbler water flow  2010 ADAS 602.6  Indard: No Quantity: JOB As-built: 0  Water flow from bubbler not min. 4" high
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Women's Building Reference Dwg: 4 of 6 Floor 1 - South Lobby Area N/A Y Coordinate: N/A  Drinking Fountains Bubbler water flow 2010 ADAS 602.6  Mater flow from bubbler not min. 4" high  1-3/4" high water flow from bubbler  Adjust drinking fountain to provide min. 4" high water flow
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Women's Building Reference Dwg: 4 of 6 Floor 1 - South Lobby Area N/A Y Coordinate: N/A  Drinking Fountains Bubbler water flow 2010 ADAS 602.6  Water flow from bubbler not min. 4" high  1-3/4" high water flow from bubbler  Addiust drinking fountain to provide min. 4" high water flow  2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 45J
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - South Lobby Area
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Drinking Fountains
Barrier Type:	Depth 02/28/2014 10-50
Code References:	2010 ADAS 602.5
Performance Sta	ndard: No Quantity: EACH As-built : 0
Barrier Description:	Wall/post mounted fountain not min. 18" deep
Findings:	14-1/4" deep
Rec. Solution:	Replace fountain with accessible unit
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 45K
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - South Lobby Area
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Alarms
Barrier Type:	Horn/Strobe
Code References:	2010 ADAS 702.1
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	No horn/strobes in common use areas
Findings:	No device provided
Rec. Solution:	Provide strobes in common use area
Barrier Severity:	1 Necessary Cost Est \$5,500.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 46A
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Restroom Vestibule V100
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	Location - 48" to 60" high
Code References:	2010 ADAS 703.4.1
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Braille/Tactile information on sign not mounted between 48" and 60" from ground or floor
Findings:	66" high
Rec. Solution:	Provide accessible sign and mount at proper height
Barrier Severity:	1 Necessary Cost Est \$250.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
	xt descriptors not provided directly below pictogram, Braille not 3/8" and max. 1/2" directly he tactile characters and contracted (Grade 2) Braille not used on sign
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 46E
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Restroom Vestibule V100
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	ISA - Non-Accessible Toilet Rooms
Code References:	2010 ADAS 216.7
Performance Sta	indard: No Quantity: EACH As-built : 1
Barrier Description:	Where all toilet rooms are not accessible, no sign provided indicating location of accessible toilet room
Findings:	ISA sign not provided
	isa sign not provided
Rec. Solution:	Provide accessible sign when alterations are completed
Rec. Solution: Barrier Severity:	Provide accessible sign when alterations are completed
Barrier Severity:	Provide accessible sign when alterations are completed  2 Recommended Cost Est \$250.00 Facility Function: Public Status: Open
	Provide accessible sign when alterations are completed  2 Recommended Cost Est \$250.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 46F
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Restroom Vestibule V100
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Hardware - Operation
Code References:	2010 ADAS 404.2.7
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Hardware not operable with a closed fist
Findings:	Hardware not operable with a closed fist at vestible door
Rec. Solution:	Provide new hardware
Barrier Severity:	1 Necessary Cost Est \$300.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 46G
Bldg Name:	Women's Building   Reference Dwg:   4 of 6
Location:	Floor 1 - Restroom Vestibule V100
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Clear Width
Code References:	2010 ADAS 404.2.3
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Door, sliding/folding door or gate clear width is not min. 32"
Findings:	27" clear width at vestibule entry door
Rec. Solution:	Replace door or gate and frame
Barrier Severity:	1 Necessary Cost Est \$2,250.00 Facility Function: Public Status: Open
Implementation	
Notes:	Priority: 3 Implementation Phase: Implementation Date:



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 46H
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Restroom Vestibule V100
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Vestibule Doors
Code References:	2010 ADAS 404.2.6
Performance Sta	ndard: No Quantity: SF As-built: 1
Barrier Description:	Space between two consecutive doors not min. 48"
Findings:	21" between vestibule and restroom entry doors
Rec. Solution:	Redesign vestibule
Barrier Severity:	1 Necessary Cost Est \$275.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 46I
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Restroom Vestibule V100
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Electrical Switches - Max. 48" High
Code References:	2010 ADAS 308.2.1
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Light switch control box top edge not at max. 48" high
Findings:	50-1/4" high
Rec. Solution:	Relocate switch box top edge to max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 46J
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Restroom Vestibule V100
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Alarms
Barrier Type:	Horn/Strobe
Code References:	2010 ADAS 702.1
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	No horn/strobes in corridor
Findings:	No device provided
Rec. Solution:	Provide strobes in common use area
Barrier Severity:	1 Necessary Cost Est \$5,500.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 47A
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Men's Restroom 100
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Door Closer - Interior
Code References:	2010 ADAS 404.2.9
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Door opening force exceeds 5 lbf
Findings:	13 lbf at restroom entry door
Rec. Solution:	Provide automatic door opening device
Barrier Severity:	1 Necessary Cost Est \$5,000.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 47B
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Men's Restroom 100
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Door Closer - Sweep Period
Code References:	2010 ADAS 404.2.8.1
Performance Sta	ndard: No Quantity: EACH As-built : 0
Barrier Description:	Door closer lacks min. 5 second sweep period
Findings:	2 second sweep
Rec. Solution:	Provide automatic door opening device
Barrier Severity:	2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 47C
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Men's Restroom 100
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Hardware - Operation
Code References:	2010 ADAS 404.2.7
Performance Sta	ndard: No Quantity: EACH As-built : 0
Barrier Description:	Hardware not operable with a closed fist
Findings:	Hardware not operable with a closed fist
Rec. Solution:	Provide automatic door opening device
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 47D
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Men's Restroom 100
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Vision Lights - Existing
Code References:	2010 ADAS 404.2.11
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	View panels in or adjacent to doors or gates not max. 43" above floor or ground
Findings:	View panel located higher than 43" above the floor
Rec. Solution:	Replace door/gate or vision panel
Barrier Severity:	3 Hindrance Cost Est \$2,250.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes: 48-1/4"	high
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 47E
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Men's Restroom 100
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Clear Width
Code References:	2010 ADAS 404.2.3
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Door, sliding/folding door or gate clear width is not min. 32"
Findings:	27" clear width
Rec. Solution:	Replace door or gate and frame
Barrier Severity:	1 Necessary Cost Est \$2,250.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 47F
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Men's Restroom 100
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Door Clearance - SEC Blocked
Code References:	2010 ADAS Figure 404.2.4.3
Performance Sta	ndard: No Quantity: EACH As-built : 0
Barrier Description:	Trash bin or stored items block strike edge clearance at exit side of door
Findings:	10-3/4" Strike edge clearance
Rec. Solution:	Provide automatic door opening device
Barrier Severity:	2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 47G
Field Date: Bldg Name:	2/24/2014   Report Date   2/27/2014   Barrier #:   47G   Women's Building   Reference Dwg:   4 of 6
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Bldg Name: Location:	Women's Building Reference Dwg: 4 of 6 Floor 1 - Men's Restroom 100
Bldg Name: Location: X Coordinate:	Women's Building Reference Dwg: 4 of 6  Floor 1 - Men's Restroom 100  N/A Y Coordinate: N/A  Restrooms  Electrical Switches
Bldg Name: Location: X Coordinate: Barrier Area:	Women's Building Reference Dwg: 4 of 6  Floor 1 - Men's Restroom 100  N/A Y Coordinate: N/A  Restrooms
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code	Women's Building Reference Dwg: 4 of 6  Floor 1 - Men's Restroom 100  N/A Y Coordinate: N/A  Restrooms  Electrical Switches  2010 ADAS 205.1 & 309.3
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Women's Building Reference Dwg: 4 of 6  Floor 1 - Men's Restroom 100  N/A Y Coordinate: N/A  Restrooms  Electrical Switches  2010 ADAS 205.1 & 309.3
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Women's Building Reference Dwg: 4 of 6  Floor 1 - Men's Restroom 100  N/A Y Coordinate: N/A  Restrooms  Electrical Switches  2010 ADAS 205.1 & 309.3  ndard: No Quantity: EACH As-built: 1
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Women's Building Reference Dwg: 4 of 6  Floor 1 - Men's Restroom 100  N/A Y Coordinate: N/A  Restrooms  Electrical Switches  2010 ADAS 205.1 & 309.3  ndard: No Quantity: EACH As-built: 1  Light switch control box top edge not at max. 48" high
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Women's Building Reference Dwg: 4 of 6 Floor 1 - Men's Restroom 100 N/A Y Coordinate: N/A Restrooms Electrical Switches 2010 ADAS 205.1 & 309.3  ndard: No Quantity: EACH As-built: 1  Light switch control box top edge not at max. 48" high  Relocate switch box top edge to max. 48" high
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Women's Building  Reference Dwg: 4 of 6  Floor 1 - Men's Restroom 100  N/A  Y Coordinate: N/A  Restrooms  Electrical Switches  2010 ADAS 205.1 & 309.3  Indard: No Quantity: EACH As-built: 1  Light switch control box top edge not at max. 48" high  49" high  Relocate switch box top edge to max. 48" high  Relocate switch box top edge to max. 48" high  Relocate switch box top edge to max. 48" high  Relocate switch box top edge to max. 48" high



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 47H
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Men's Restroom 100
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Protruding Object - Wall-mounted
Code References:	2010 ADAS 307.2
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Object protrudes more than 4" into circulation path
Findings:	Paper towel dispenser protrudes 9" at 52" high
Rec. Solution:	Provide detectable warning for the visually impaired
Barrier Severity:	1 Necessary Cost Est \$550.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 47I
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Men's Restroom 100
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Dispensers
Code References:	2010 ADAS 307.2
Performance Sta	indard: No Quantity: EACH As-built : 0
Barrier Description:	Dispenser control point or operating mechanism not max. 48" AFF
Findings:	Paper towel dispenser 52" high
Rec. Solution:	Remount no higher than 48" above floor
Barrier Severity:	2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	
Notes:	implementation rade.



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 47J
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Men's Restroom 100
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Lavatory - Depth
Code References:	2010 ADAS 606.2 & 306
Performance Sta	ndard: No Quantity: JOB As-built : 1
Barrier Description:	Lavatory lacks min. 17" in horizontal depth measured from back wall
Findings:	16-1/2" deep
Rec. Solution:	Replace lavatory
Barrier Severity:	3 Hindrance Cost Est \$450.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 47K
Field Date: Bldg Name:	2/24/2014   Report Date   2/27/2014   Barrier #:   47K   Women's Building   Reference Dwg:   4 of 6
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Bldg Name: Location:	Women's Building Reference Dwg: 4 of 6 Floor 1 - Men's Restroom 100
Bldg Name: Location: X Coordinate:	Women's Building Reference Dwg: 4 of 6  Floor 1 - Men's Restroom 100  N/A Y Coordinate: N/A
Bldg Name: Location: X Coordinate: Barrier Area:	Women's Building Reference Dwg: 4 of 6  Floor 1 - Men's Restroom 100  N/A Y Coordinate: N/A  Restrooms
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code	Women's Building Reference Dwg: 4 of 6  Floor 1 - Men's Restroom 100  N/A Y Coordinate: N/A  Restrooms  Lavatory - Drainpipes  2010 ADAS 606.5
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Women's Building Reference Dwg: 4 of 6  Floor 1 - Men's Restroom 100  N/A Y Coordinate: N/A  Restrooms  Lavatory - Drainpipes  2010 ADAS 606.5
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Women's Building Reference Dwg: 4 of 6  Floor 1 - Men's Restroom 100  N/A Y Coordinate: N/A  Restrooms  Lavatory - Drainpipes  2010 ADAS 606.5  ndard: No Quantity: EACH As-built: 1
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Women's Building Reference Dwg: 4 of 6  Floor 1 - Men's Restroom 100  N/A Y Coordinate: N/A  Restrooms  Lavatory - Drainpipes  2010 ADAS 606.5  ndard: No Quantity: EACH As-built: 1  Hot water and drainpipes accessible under lavatory not insulated or covered
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Women's Building Reference Dwg: 4 of 6 Floor 1 - Men's Restroom 100 N/A Y Coordinate: N/A Restrooms Lavatory - Drainpipes 2010 ADAS 606.5  Indard: No Quantity: EACH As-built: 1 Hot water and drainpipes accessible under lavatory not insulated or covered  No insulation provided  Insulate drainpipes and hot water pipes
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Women's Building Reference Dwg: 4 of 6  Floor 1 - Men's Restroom 100  N/A Y Coordinate: N/A  Restrooms  Lavatory - Drainpipes  2010 ADAS 606.5  Indard: No Quantity: EACH As-built: 1  Hot water and drainpipes accessible under lavatory not insulated or covered  No insulation provided  Insulate drainpipes and hot water pipes  2 Recommended Cost Est \$220.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 47L
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Men's Restroom 100
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Mirror
Code References:	2010 ADAS 603.3
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Mirror at lavatory/countertop not max. 40" AFF at edge of reflecting surface
Findings:	60" high
Rec. Solution:	Replace or remount mirror
Barrier Severity:	3 Hindrance Cost Est \$375.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 47M
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Men's Restroom 100
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Urinal - Flush Controls
Code References:	2010 ADAS 309
Performance Sta	andard: No Quantity: JOB As-built : 1
Barrier Description:	Urinal flush controls mounted higher than 48" above the floor
Findings:	52" high
Rec. Solution:	
	Replace urinal controls where possible or entire urinal
Barrier Severity:	
Barrier Severity: Implementation	2 Recommended Cost Est \$800.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 47N
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Men's Restroom 100
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Urinal - Rim
Code References:	2010 ADAS 605.2
Performance Sta	ndard: No Quantity: JOB As-built : 0
Barrier Description:	Min. 1 urinal has no elongated rim projecting 14" to 17" from wall
Findings:	11" high
Rec. Solution:	Replace urinal
Barrier Severity:	2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 470
Field Date: Bldg Name:	2/24/2014   Report Date   2/27/2014   Barrier #: 470   4 of 6
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Bldg Name: Location:	Women's Building Reference Dwg: 4 of 6 Floor 1 - Men's Restroom 100
Bldg Name: Location: X Coordinate:	Women's Building Reference Dwg: 4 of 6  Floor 1 - Men's Restroom 100  N/A Y Coordinate: N/A  Restrooms  Urinal - Rim
Bldg Name: Location: X Coordinate: Barrier Area:	Women's Building Reference Dwg: 4 of 6  Floor 1 - Men's Restroom 100  N/A Y Coordinate: N/A  Restrooms
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code	Women's Building Reference Dwg: 4 of 6  Floor 1 - Men's Restroom 100  N/A Y Coordinate: N/A  Restrooms  Urinal - Rim  2010 ADAS 605.2
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Women's Building Reference Dwg: 4 of 6  Floor 1 - Men's Restroom 100  N/A Y Coordinate: N/A  Restrooms  Urinal - Rim  2010 ADAS 605.2
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Women's Building Reference Dwg: 4 of 6  Floor 1 - Men's Restroom 100  N/A Y Coordinate: N/A  Restrooms  Urinal - Rim  2010 ADAS 605.2  Indard: No Quantity: JOB As-built: 0
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Women's Building Reference Dwg: 4 of 6  Floor 1 - Men's Restroom 100  N/A Y Coordinate: N/A  Restrooms  Urinal - Rim  2010 ADAS 605.2  Indard: No Quantity: JOB As-built: 0  Urinal not max. 17" above the floor
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Women's Building Reference Dwg: 4 of 6 Floor 1 - Men's Restroom 100 N/A Y Coordinate: N/A Restrooms Urinal - Rim 2010 ADAS 605.2  Indard: No Quantity: JOB As-built: 0  Urinal not max. 17" above the floor  23" high  Replace urinal
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Women's Building Reference Dwg: 4 of 6 Floor 1 - Men's Restroom 100 N/A Y Coordinate: N/A Restrooms Urinal - Rim 2010 ADAS 605.2  Indard: No Quantity: JOB As-built: 0 Urinal not max. 17" above the floor  23" high  Replace urinal 2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 47P
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Men's Restroom 100
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Toilet - Left/Right Approach
Code References:	2010 ADAS 604.8 & 604.3.1
Performance Sta	ndard: No Quantity: JOB As-built : 1
Barrier Description:	Both front, and either left or right approach lacks min. 60" wide x 56" deep clear floor space
Findings:	46-1/2" wide clear floor space between stalls and wall
Rec. Solution:	Remodel toilet room
Barrier Severity:	2 Recommended Cost Est \$850.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 47Q
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Men's Restroom 100
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Toilet - Clear Space (post-ADA)
Code References:	2010 ADAS 604.3.1 & 604.8.1.1
Performance Sta	ndard: No Quantity: SF As-built : 0
Barrier Description:	Water closet clear space not min. 60" measured wall-to-wall
Findings:	36" wide stall
Rec. Solution:	Remodel toilet room to provide clear width
Barrier Severity:	2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes: Door cle	ear width 27"



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 47R
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Men's Restroom 100
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Alarm - Horn/Strobe
Code References:	2010 ADAS 702.1
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Where a fire alarm is installed, no horn/strobe provided
Findings:	No device provided
Rec. Solution:	Provide horn/strobe in common use area
Barrier Severity:	1 Necessary Cost Est \$5,500.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 48A
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Copy Room 101
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	Permanent Room/Space - Tactile Characters
Code References:	2010 ADAS 216.2
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	At interior or exterior location, no tactile characters at sign identifying permanent rooms and spaces
Findings:	No tactile signage provided at door within public route
Rec. Solution:	
Nec. Joidtion.	Provide accessible sign
Barrier Severity: Implementation	1 Necessary Cost Est \$250.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 48B
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Copy Room 101
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Door Closer - Adjustment
Code References:	2010 ADAS 404.2.9
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Door opening force exceeds 5 lbf
Findings:	11 lbf
Rec. Solution:	Replace or adjust existing closer, if door remains open
Barrier Severity:	1 Necessary Cost Est \$450.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 48C
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Copy Room 101
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Door Closer - Sweep Period
Code References:	2010 ADAS 404.2.8.1
Performance Sta	andard: No Quantity: EACH As-built : 0
Barrier Description:	Door closer lacks min. 5 second sweep period
Findings:	4 second sweep
Rec. Solution:	Replace or adjust existing closer, if door remains open
Rec. Solution: Barrier Severity:	
Rec. Solution: Barrier Severity: Implementation	2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 48D
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Copy Room 101
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Door Hardware - Operation
Code References:	2010 ADAS 404.2.7
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Operating controls involve tight grasping, pinching or twisting
Findings:	Hardware not operable with a closed fist
Rec. Solution:	Replace hardware
Barrier Severity:	1 Necessary Cost Est \$300.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 48E
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Copy Room 101
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Clear Floor Space
Barrier Type:	Passageway - Min. 36"
Code References:	2010 ADAS 403.5.1
Performance Sta	ndard: No Quantity: LF As-built : 0
Barrier Description:	Circulation route not min. 36" wide between elements
Findings:	30" wide circulation route between counter and recycle bin
Rec. Solution:	Move recycle bin
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 48F
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Copy Room 101
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Front App/pull 60" - Relocate Door
Code References:	2010 ADAS Figure 404.2.4.1
Performance Sta	ndard: No Quantity: EACH As-built : 0
Barrier Description:	Door/Gate at with min. 18" at pull side lacks min. 60" perpendicular to door
Findings:	46" perpendicular to counter
Rec. Solution:	No remediation recommended if door remains open at allow accessible passage
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 48G
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Copy Room 101
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Front App/pull 18" SEC - Blocked
Code References:	2010 ADAS Figure 404.2.4.1
Performance Sta	andard: No Quantity: ADMINI As-built : 0
Barrier Description:	Door/Gate at pull side with min. 60" lacks min. 18" strike edge clearance at pull side
Findings:	5" strike edge clearance
Rec. Solution:	Move trash can
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	·



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 48H
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Copy Room 101
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Electrical Switches - Max. 48" High
Code References:	2010 ADAS 308.2.1
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Light switch control box top edge not at max. 48" high
Findings:	56" high
Rec. Solution:	Relocate switch box top edge to max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 48J
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Copy Room 101
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Counter - Surface
Code References:	2010 ADAS 902
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Counter surface height exceeds 34" high
Findings:	35-3/4" high
Rec. Solution:	Replace or provide alternative accessible and integrated counter
Barrier Severity:	3 Hindrance Cost Est \$875.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 48K
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Copy Room 101
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Counters and Tables
Barrier Type:	Counter - Knee Clearance
Code References:	2010 ADAS 305.3
Performance Sta	indard: No Quantity: EACH As-built : 0
Barrier Description:	Knee clearance not min. 27" high, 19" deep or 30" wide
Findings:	No knee clearance
Rec. Solution:	Replace counter. Flip-up counters, adiacent tables and similar devices not permitted
Barrier Severity:	3 Hindrance Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 48L
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Copy Room 101
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Sink - Rim or Countertop
Code References:	2010 ADAS 606.3
Performance Sta	indard: No Quantity: LF As-built : 3
Barrier Description:	No accessible section of counter at max 34" high provided
Findings:	Sink rim 35-3/4" high
Rec. Solution:	Reposition existing sink or provide additional sink for use in area
Barrier Severity:	1 Necessary Cost Est \$1,110.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 48M
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Copy Room 101
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Sink - Depth (2/25/2014 12:0)
Code References:	Performance Standard
Performance Sta	ndard: Yes Quantity: EACH As-built : 1
Barrier Description:	Sink depth exceeds 6-1/2" deep
Findings:	7-1/2" deep
Rec. Solution:	Replace sink
Barrier Severity:	1 Necessary Cost Est \$450.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 48N
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Copy Room 101
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Sink - Knee Clearance
Code References:	2010 ADAS 606.2 & 306
Performance Sta	ndard: No Quantity: EACH As-built : 0
Barrier Description:	Knee clearance of at least 27" high, 30" wide and 8" deep not provided underneath sink
Findings:	No knee clearance
Rec. Solution:	Replace cabinet and remount sink
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: None pr	rovided; cabinet flush to counter edge.



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 480
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Copy Room 101
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Dispensers - Parallel Approach
Code References:	2010 ADAS 308.3.2
Performance Sta	ndard: No Quantity: JOB As-built : 2
Barrier Description:	Where the high side reach is over an obstruction, the height of the obstruction exceeds 34" maximum
Findings:	Paper towel dispenser 45-1/2" high. Soap dispensers 35-1/2" high
Rec. Solution:	Relocate dispenser to location within reach range or provide additional dispenser
Barrier Severity:	2 Recommended Cost Est \$500.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: For tow	el dispenser
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 48P
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Copy Room 101
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Mirror (2/25/2014 12:0)
Code References:	2010 ADAS 603.3
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Mirror at lavatory/countertop not max. 40" AFF at edge of reflecting surface
Findings:	58" high
Rec. Solution:	Replace or remount mirror
Barrier Severity:	3 Hindrance Cost Est \$375.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 48Q
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Copy Room 101
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Clear Floor Space
Barrier Type:	Clear Floor Space - 60" Turning Circle
Code References:	2010 ADAS 304.3.1
Performance Sta	andard: No Quantity: SF As-built : 80
Barrier Description:	Clear floor space of min. 60" in diameter not provided where 360 degree turn is made
Findings:	46" turning space at end of room for change of direction
Rec. Solution:	Remodel area to provide min. 60" turning space
Barrier Severity:	2 Recommended Cost Est \$14,000.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 48R
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Copy Room 101
X Coordinate:	N/A Y Coordinate: N/A
	IN/A
Barrier Area:	Classrooms
Barrier Area: Barrier Type:	
	Classrooms
Barrier Type: Code	Classrooms Shelves or Cabinets 2010 ADAS 603.4
Barrier Type: Code References:	Classrooms Shelves or Cabinets 2010 ADAS 603.4
Barrier Type: Code References: Performance Sta Barrier	Classrooms Shelves or Cabinets 2010 ADAS 603.4  Indard: No Quantity: EACH As-built: 1
Barrier Type: Code References: Performance Sta Barrier Description:	Classrooms Shelves or Cabinets 2010 ADAS 603.4  Indard: No Quantity: EACH As-built: 1  Shelf or cabinet not mounted between 40" and 48" above floor or ground
Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Shelves or Cabinets  2010 ADAS 603.4  Indard: No Quantity: EACH As-built: 1  Shelf or cabinet not mounted between 40" and 48" above floor or ground  Shelf or cabinet not accessible  Provide additional shelf at accessible height or provide assistance
Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Classrooms Shelves or Cabinets  2010 ADAS 603.4  Indard: No Quantity: EACH As-built: 1  Shelf or cabinet not mounted between 40" and 48" above floor or ground  Shelf or cabinet not accessible  Provide additional shelf at accessible height or provide assistance  2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 48S
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Copy Room 101
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Electrical Outlets
Code References:	2010 ADAS 308.2.2
Performance Sta	ndard: No Quantity: EACH As-built: 1
Barrier Description:	Use of outlet involves low reach of less than 15" above floor or not max. 48" high
Findings:	12" high
Rec. Solution:	Relocate outlet to area with max. 15 low reach or max.48" high reach
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 48T
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Copy Room 101
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Alarms
Barrier Type:	Horn/Strobe
Code References:	2010 ADAS 702.1
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	No horn/strobes in common use areas
Findings:	No device provided
Rec. Solution:	Provide strobes in common use area
Barrier Severity:	1 Necessary Cost Est \$5,500.00 Facility Function: Public Status: Open
Implementation	· _ · · · <u> · · · · · · · </u>
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 49A
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Corridor H101
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	Permanent Room/Space - Tactile Characters
Code References:	2010 ADAS 216.2
Performance Sta	ndard: No Quantity: EACH As-built : 5
Barrier Description:	At interior or exterior location, no tactile characters at sign identifying permanent rooms and spaces
Findings:	No tactile signage provided at doors within public route
Rec. Solution:	Provide accessible signs
Barrier Severity:	1 Necessary Cost Est \$1,250.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 49B
Field Date: Bldg Name:	2/24/2014 Report Date 2/27/2014 Barrier #: 49B  Women's Building Reference Dwg: 4 of 6
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Bldg Name: Location:	Women's Building Reference Dwg: 4 of 6 Floor 1 - Corridor H101
Bldg Name: Location: X Coordinate:	Women's Building Reference Dwg: 4 of 6  Floor 1 - Corridor H101  N/A Y Coordinate: N/A
Bldg Name: Location: X Coordinate: Barrier Area:	Women's Building Reference Dwg: 4 of 6  Floor 1 - Corridor H101  N/A Y Coordinate: N/A  Corridors
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code	Women's Building Reference Dwg: 4 of 6  Floor 1 - Corridor H101  N/A Y Coordinate: N/A  Corridors  Protruding Object - Free-Standing Element  2010 ADAS 307.3
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Women's Building Reference Dwg: 4 of 6  Floor 1 - Corridor H101  N/A Y Coordinate: N/A  Corridors  Protruding Object - Free-Standing Element  2010 ADAS 307.3
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Women's Building Reference Dwg: 4 of 6  Floor 1 - Corridor H101  N/A Y Coordinate: N/A  Corridors  Protruding Object - Free-Standing Element  2010 ADAS 307.3  andard: No Quantity: JOB As-built: 1
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Women's Building Reference Dwg: 4 of 6 Floor 1 - Corridor H101 N/A Y Coordinate: N/A  Corridors Protruding Object - Free-Standing Element 2010 ADAS 307.3  Indard: No Quantity: JOB As-built: 1  Post-mounted object protrudes more than 12" into pedestrian way
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Women's Building Reference Dwg: 4 of 6 Floor 1 - Corridor H101 N/A Y Coordinate: N/A  Corridors Protruding Object - Free-Standing Element 2010 ADAS 307.3  Andard: No Quantity: JOB As-built: 1  Post-mounted object protrudes more than 12" into pedestrian way  Archway protrudes more than 4" from 66" to 80" high  Provide detectable warning on sides of archway for the visually impaired
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Women's Building Reference Dwg: 4 of 6  Floor 1 - Corridor H101  N/A Y Coordinate: N/A  Corridors  Protruding Object - Free-Standing Element  2010 ADAS 307.3  Indard: No Quantity: JOB As-built: 1  Post-mounted object protrudes more than 12" into pedestrian way  Archway protrudes more than 4" from 66" to 80" high  Provide detectable warning on sides of archway for the visually impaired  1 Necessary Cost Est \$550.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 49C
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Corridor H101
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Electrical Switches - Height
Code References:	2010 ADAS 308.2.1
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Light switch control box top edge not at max. 48" high
Findings:	49-1/2" high
Rec. Solution:	Relocate switch box top edge to max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 49D
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Bldg Name: Location:	Women's Building Reference Dwg: 4 of 6 Floor 1 - Corridor H101
Location:	Floor 1 - Corridor H101
Location: X Coordinate:	Floor 1 - Corridor H101  N/A  Y Coordinate: N/A
Location: X Coordinate: Barrier Area:	Floor 1 - Corridor H101  N/A  Y Coordinate: N/A  Counters and Tables
Location: X Coordinate: Barrier Area: Barrier Type: Code	Floor 1 - Corridor H101  N/A  Y Coordinate: N/A  Counters and Tables  Table - Pedestal Base  2010 ADAS 306.2.2 and 306.2.3
Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Floor 1 - Corridor H101  N/A  Y Coordinate: N/A  Counters and Tables  Table - Pedestal Base  2010 ADAS 306.2.2 and 306.2.3
Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Floor 1 - Corridor H101  N/A  Y Coordinate: N/A  Counters and Tables  Table - Pedestal Base  2010 ADAS 306.2.2 and 306.2.3  Indard: No Quantity: EACH As-built: 1
Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Floor 1 - Corridor H101  N/A  Y Coordinate: N/A  Counters and Tables  Table - Pedestal Base  2010 ADAS 306.2.2 and 306.2.3  Indard: No  Quantity: EACH  As-built:  Knee clearance not min. 27" high, 19" deep or 30" wide
Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Floor 1 - Corridor H101  N/A  Y Coordinate: N/A  Counters and Tables  Table - Pedestal Base  2010 ADAS 306.2.2 and 306.2.3  Indard: No Quantity: EACH As-built: 1  Knee clearance not min. 27" high, 19" deep or 30" wide  Pedestal base blocks knee clearance. 24-7/8" knee clearance at other table  Provide min. 1 accessible table in corridor. Avoid pedestal base tables.
Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Floor 1 - Corridor H101  N/A  Y Coordinate: N/A  Counters and Tables  Table - Pedestal Base  2010 ADAS 306.2.2 and 306.2.3  Indard: No Quantity: EACH As-built: 1  Knee clearance not min. 27" high, 19" deep or 30" wide  Pedestal base blocks knee clearance. 24-7/8" knee clearance at other table  Provide min. 1 accessible table in corridor. Avoid pedestal base tables.  2 Recommended Cost Est \$450.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 49E
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Corridor H101
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Alarms
Barrier Type:	Horn/Strobe
Code References:	2010 ADAS 702.1
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	No horn/strobes in corridor
Findings:	No device provided
Rec. Solution:	Provide strobes in common use area
Barrier Severity:	1 Necessary Cost Est \$5,500.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 50A
Field Date: Bldg Name:	2/24/2014   Report Date   2/27/2014   Barrier #:
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Bldg Name: Location:	Women's Building Reference Dwg: 4 of 6 Floor 1 - Corridor H107
Bldg Name: Location: X Coordinate:	Women's Building Reference Dwg: 4 of 6  Floor 1 - Corridor H107  N/A Y Coordinate: N/A  Signage  Permanent Room/Space - Tactile Characters
Bldg Name: Location: X Coordinate: Barrier Area:	Women's Building Reference Dwg: 4 of 6  Floor 1 - Corridor H107  N/A Y Coordinate: N/A  Signage
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code	Women's Building Reference Dwg: 4 of 6  Floor 1 - Corridor H107  N/A Y Coordinate: N/A  Signage  Permanent Room/Space - Tactile Characters  2010 ADAS 216.2
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Women's Building Reference Dwg: 4 of 6  Floor 1 - Corridor H107  N/A Y Coordinate: N/A  Signage  Permanent Room/Space - Tactile Characters  2010 ADAS 216.2
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Women's Building Reference Dwg: 4 of 6  Floor 1 - Corridor H107  N/A Y Coordinate: N/A  Signage  Permanent Room/Space - Tactile Characters  2010 ADAS 216.2  At interior or exterior location, no tactile characters at sign identifying permanent rooms and
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Women's Building Reference Dwg: 4 of 6  Floor 1 - Corridor H107  N/A Y Coordinate: N/A  Signage  Permanent Room/Space - Tactile Characters  2010 ADAS 216.2  At interior or exterior location, no tactile characters at sign identifying permanent rooms and spaces
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Women's Building Reference Dwg: 4 of 6 Floor 1 - Corridor H107 N/A Y Coordinate: N/A Signage Permanent Room/Space - Tactile Characters 2010 ADAS 216.2  At interior or exterior location, no tactile characters at sign identifying permanent rooms and spaces  No tactile signage provided at doors within public route
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Women's Building Reference Dwg: 4 of 6  Floor 1 - Corridor H107  N/A Y Coordinate: N/A  Signage  Permanent Room/Space - Tactile Characters  2010 ADAS 216.2  At interior or exterior location, no tactile characters at sign identifying permanent rooms and spaces  No tactile signage provided at doors within public route  Provide accessible signs  1 Necessary Cost Est \$1,250.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 50B
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Corridor H107
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Hardware - Operation
Code References:	2010 ADAS 404.2.7
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Hardware not operable with a closed fist
Findings:	Hardware not operable with a closed fist
Rec. Solution:	Provide new hardware
Barrier Severity:	1 Necessary Cost Est \$300.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 50C
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Corridor H107
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Vision Lights - Existing
Code References:	2010 ADAS 404.2.11
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	View panels in or adjacent to doors or gates not max. 43" above floor or ground
Findings:	View panel located higher than 43" above the floor
Rec. Solution:	Replace door/gate or vision panel
Barrier Severity:	3 Hindrance Cost Est \$2,250.00 Facility Function: Public Status: Open
Implementation	· — · — — · ——
Notes: 48-1/2"	high



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 50D
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Corridor H107
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Smooth Surface at Bottom
Code References:	2010 ADAS 404.2.3
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Door stop at bottom of door creates trap condition for wheelchair footrests
Findings:	Door stop can create trapping condition
Rec. Solution:	Remove door stop or any other element within bottom 10" of door
Barrier Severity:	1 Necessary Cost Est \$50.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 50D
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Corridor H107
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Threshold - Height exceeding 1/4" without bevel
Code References:	2010 ADAS 404.2.5
Performance Sta	ndard: No Quantity: EACH As-built : 2
Barrier Description:	Door/Gate threshold exceeds 1/4" in height withouth a bevel
Findings:	1/2" high lip at broken tiles
Rec. Solution:	Repair broken tiles
Barrier Severity:	1 Necessary Cost Est \$550.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 50E
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Corridor H107
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Front App/pull 18" SEC - Blocked
Code References:	2010 ADAS Figure 404.2.4.1
Performance Sta	andard: No Quantity: ADMINI As-built : 1
Barrier Description:	Door/Gate at pull side with min. 60" lacks min. 18" strike edge clearance at pull side
Findings:	Trash can and fire extinguisher block strike edge clearance
Rec. Solution:	Remove stored items
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 50F
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Corridor H107
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Electrical Outlets - Hi/Low Reach
Code References:	2010 ADAS 308.2.2
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Use of outlet involves low reach of less than 15" above floor or more than 48" high
Findings:	12" high
Rec. Solution:	Delegate outlet to area at min. 15" or may 40" high
	Relocate outlet to area at min. 15" or max. 48" high
Barrier Severity:	
Barrier Severity: Implementation	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 50G
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Corridor H107
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Actuator or Control - Height
Code References:	2010 ADAS 305.3
Performance Sta	ndard: No Quantity: EACH As-built : 4
Barrier Description:	Control or mechanism not at max. 48" high for side reach
Findings:	Mailboxes 48-1/2" - 58-3/8" high
Rec. Solution:	Relocate controls or mechanisms to max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$3,000.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: 4 mailbo	oxes
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 50H
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Corridor H107
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Alarms
Barrier Type:	Horn/Strobe
Code References:	2010 ADAS 702.1
Performance Sta	ndard: No Quantity: EACH As-built: 1
Barrier Description:	No horn/strobes in common use areas
Findings:	No device provided
Rec. Solution:	Provide strobes in common use area
Barrier Severity:	1 Necessary Cost Est \$5,500.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 51A
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Grad Student Office 107E
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	Permanent Room/Space - Tactile Characters
Code References:	2010 ADAS 216.2
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	At interior or exterior location, no tactile characters at sign identifying permanent rooms and spaces
Findings:	No tactile signage provided at door within public route
Rec. Solution:	Provide accessible sign
Barrier Severity:	1 Necessary Cost Est \$250.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 51B
Field Date: Bldg Name:	Women's Building Reference Dwg: 4 of 6
	2/24/2014   Report Date  2/2//2014   Barrier #.  518
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Bldg Name: Location:	Women's Building Reference Dwg: 4 of 6  Floor 1 - Grad Student Office 107E
Bldg Name: Location: X Coordinate:	Women's Building Reference Dwg: 4 of 6  Floor 1 - Grad Student Office 107E  N/A Y Coordinate: N/A  Doors or Gates  Hardware - Operation
Bldg Name: Location: X Coordinate: Barrier Area:	Women's Building Reference Dwg: 4 of 6  Floor 1 - Grad Student Office 107E  N/A Y Coordinate: N/A  Doors or Gates
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code	Women's Building Reference Dwg: 4 of 6 Floor 1 - Grad Student Office 107E  N/A Y Coordinate: N/A  Doors or Gates  Hardware - Operation  2010 ADAS 404.2.7
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Women's Building Reference Dwg: 4 of 6 Floor 1 - Grad Student Office 107E  N/A Y Coordinate: N/A  Doors or Gates  Hardware - Operation  2010 ADAS 404.2.7
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Women's Building Reference Dwg: 4 of 6  Floor 1 - Grad Student Office 107E  N/A Y Coordinate: N/A  Doors or Gates  Hardware - Operation  2010 ADAS 404.2.7  Indard: No Quantity: EACH As-built: 1
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Women's Building Reference Dwg: 4 of 6  Floor 1 - Grad Student Office 107E  N/A  Poors or Gates  Hardware - Operation  2010 ADAS 404.2.7  Hardware not operable with a closed fist
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Women's Building Reference Dwg: 4 of 6 Floor 1 - Grad Student Office 107E  N/A Y Coordinate: N/A  Doors or Gates  Hardware - Operation  2010 ADAS 404.2.7  Hardware not operable with a closed fist  Hardware not operable with a closed fist  Provide new hardware
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Women's Building Reference Dwg: 4 of 6  Floor 1 - Grad Student Office 107E  N/A Y Coordinate: N/A  Doors or Gates  Hardware - Operation  2010 ADAS 404.2.7  Hardware not operable with a closed fist  Hardware not operable with a closed fist  Provide new hardware  1 Necessary Cost Est \$300.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 51C
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Grad Student Office 107E
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Coat Hook - Height
Code References:	2010 ADAS 603.4
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Clothing hooks not max. 48" high AFF
Findings:	67-1/2" high
Rec. Solution:	Provide additional hook
Barrier Severity:	2 Recommended Cost Est \$125.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 51D
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Grad Student Office 107E
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Clear Floor Space
Barrier Type:	Passageway - Min. 36" (Stored Item)
Code References:	
	2010 ADAS 403.5.1
Performance Sta	
Performance Sta Barrier Description:	
Barrier	ndard: No Quantity: JOB As-built : 1
Barrier Description:	ndard: No Quantity: JOB As-built : 1  Circulation route not min. 36" wide between elements
Barrier Description: Findings:	ndard: No Quantity: JOB As-built: 1  Circulation route not min. 36" wide between elements  25-1/2" wide circulation route around table  Provide smaller table or remodel to provide access
Barrier Description: Findings: Rec. Solution:	ndard: No Quantity: JOB As-built: 1  Circulation route not min. 36" wide between elements  25-1/2" wide circulation route around table  Provide smaller table or remodel to provide access  1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 51E
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Grad Student Office 107E
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Electrical Outlets - Hi/Low Reach
Code References:	2010 ADAS 308.2.2
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Use of outlet involves low reach of less than 15" above floor or more than 48" high
Findings:	12" high
Rec. Solution:	Relocate outlet to area at min. 15" or max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 51F
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Grad Student Office 107E
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Counters and Tables
Barrier Type:	Table - Knee Clearance
Code References:	2010 ADAS 305.3
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Knee clearance not min. 27" high, 19" deep or 30" wide
Findings:	24" to 26-1/4" knee clearance at multiple tables
Rec. Solution:	Provide min. 1 accessible table
Barrier Severity:	3 Hindrance Cost Est \$450.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: 2 PC wo	rkstations and 1 desk



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 51G
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Grad Student Office 107E
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Shelves or Cabinets
Code References:	2010 ADAS 305.3
Performance Sta	ndard: No Quantity: JOB As-built : 1
Barrier Description:	Shelf or cabinet not mounted max. 48" above floor or ground
Findings:	Shelf or cabinet not accessible
Rec. Solution:	Provide additional shelf at accessible height or provide assistance
Barrier Severity:	3 Hindrance Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: Shelf or	cabinet not accessible at 51-1/2"
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 51H
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Grad Student Office 107E
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Counters and Tables
Barrier Type:	Counter - Surface Height
Code References:	2010 ADAS 902.3
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	No section at least 3 feet long between 28" and 34" provided at existing counter
Findings:	39-3/4" high work counter
Rec. Solution:	Provide min. 3 ft long section of counter at max. 34" high
Barrier Severity:	3 Hindrance Cost Est \$875.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 511
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Grad Student Office 107E
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Counters and Tables
Barrier Type:	Counter - Knee Clearance
Code References:	2010 ADAS 305.3
Performance Sta	ndard: No Quantity: EACH As-built : 0
Barrier Description:	Knee clearance not min. 27" high, 19" deep or 30" wide
Findings:	No knee clearance
Rec. Solution:	Replace counter. Flip-up counters, adiacent tables and similar devices not permitted
Barrier Severity:	3 Hindrance Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 51J
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Grad Student Office 107E
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Electrical Outlets - Side Reach Obstructed (≤10")
Code References:	2010 ADAS 308.2
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Outlet located over an obstruction max. 34" high located above 48"
Findings:	41-1/2" high over an obstruction 39-3/4" high
Rec. Solution:	Relocate control or mechanism to max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 51K
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Grad Student Office 107E
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Alarms
Barrier Type:	Horn/Strobe
Code References:	2010 ADAS 702.1
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	No horn/strobes in meeting room
Findings:	No device provided
Rec. Solution:	Provide strobes in common use area
Barrier Severity:	1 Necessary Cost Est \$5,500.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 52A
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Swimming Pool Spectator Seating 110
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	Permanent Room/Space - Tactile Characters
Code References:	2010 ADAS 216.2
Performance Sta	indard: No Quantity: EACH As-built: 1
Barrier Description:	No tactile characters at sign identifying permanent rooms and spaces with visual signs
Description:	No tactile characters at sign identifying permanent rooms and spaces with visual signs
Description: Findings:	No tactile characters at sign identifying permanent rooms and spaces with visual signs  No tactile signage provided at door within public route  Provide accessible sign
Description: Findings: Rec. Solution:	No tactile characters at sign identifying permanent rooms and spaces with visual signs  No tactile signage provided at door within public route  Provide accessible sign  1 Necessary Cost Est \$250.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 52B
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Swimming Pool Spectator Seating 110
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Door Closer - Interior
Code References:	2010 ADAS 404.2.9
Performance Sta	indard: No Quantity: EACH As-built : 1
Barrier Description:	Door opening force exceeds 5 lbf
Findings:	20 lbf
Rec. Solution:	Provide automatic door opening device at min. 1 entry door and ISA directional sign at other
Barrier Severity:	1 Necessary Cost Est \$5,000.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: 2 entry	doors
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 52C
Bldg Name:	Women's Building Reference Dwg: 4 of 6
2.00.10	women's Building Reference Dwg.  4016
Location:	Floor 1 - Swimming Pool Spectator Seating 110
_	
Location:	Floor 1 - Swimming Pool Spectator Seating 110
Location: X Coordinate:	Floor 1 - Swimming Pool Spectator Seating 110  N/A Y Coordinate: N/A  Doors or Gates  Door Closer - Sweep Period
Location: X Coordinate: Barrier Area:	Floor 1 - Swimming Pool Spectator Seating 110  N/A Y Coordinate: N/A  Doors or Gates
Location: X Coordinate: Barrier Area: Barrier Type: Code	Floor 1 - Swimming Pool Spectator Seating 110  N/A Y Coordinate: N/A  Doors or Gates  Door Closer - Sweep Period  2010 ADAS 404.2.8.1
Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Floor 1 - Swimming Pool Spectator Seating 110  N/A Y Coordinate: N/A  Doors or Gates  Door Closer - Sweep Period  2010 ADAS 404.2.8.1
Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Floor 1 - Swimming Pool Spectator Seating 110  N/A  Y Coordinate:  N/A  Doors or Gates  Door Closer - Sweep Period  2010 ADAS 404.2.8.1  Indard:  NO  Quantity:  EACH  As-built:  O
Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Floor 1 - Swimming Pool Spectator Seating 110  N/A  Y Coordinate: N/A  Doors or Gates  Door Closer - Sweep Period  2010 ADAS 404.2.8.1  andard: No  Quantity: EACH  As-built:  Door closer lacks min. 5 second sweep period
Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Floor 1 - Swimming Pool Spectator Seating 110  N/A  Y Coordinate: N/A  Doors or Gates  Door Closer - Sweep Period  2010 ADAS 404.2.8.1  andard: No  Quantity: EACH  As-built:  Door closer lacks min. 5 second sweep period  3-5 second sweep, does not stop before closing
Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Floor 1 - Swimming Pool Spectator Seating 110  N/A  Y Coordinate: N/A  Doors or Gates  Door Closer - Sweep Period  2010 ADAS 404.2.8.1  mdard: No Quantity: EACH As-built: 0  Door closer lacks min. 5 second sweep period  3-5 second sweep, does not stop before closing  Provide automatic door opening device at min. 1 entry door and ISA directional sign at other  2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 52D
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Swimming Pool Spectator Seating 110
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Front App/pull 18" SEC - Blocked
Code References:	2010 ADAS Figure 404.2.4.1
Performance Sta	andard: No Quantity: ADMINI As-built : 0
Barrier Description:	Door/Gate at pull side with min. 60" lacks min. 18" strike edge clearance at pull side
Findings:	12-1/2" strike edge clearance
Rec. Solution:	Provide automatic door opening device at min. 1 entry door and ISA directional sign at other
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: Entry fro	om H101
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 52E
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Swimming Pool Spectator Seating 110
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Front App/push 12" SEC
Code References:	2010 ADAS Figure 404.2.4.1
Performance Sta	ndard: No Quantity: EACH As-built : 0
Barrier Description:	Door/Gate at push side with min. 48" lacks min. 12" strike edge clearance with latch/closer
Findings:	8" strike edge clearance
Rec. Solution:	Provide automatic door opening device at min. 1 entry door and ISA directional sign at other
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	
Notes: For doo	r to Hall H101



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 52F
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Swimming Pool Spectator Seating 110
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	Tactile Exit Signs - Passage
Code References:	Performance Standard
Performance Sta	ndard: Yes Quantity: EACH As-built : 2
Barrier Description:	Exit thru an exit enclosure/exit passageway lacks tactile exit sign
Findings:	Passageway to exterior exit with low level illuminated sign lacks tactile exit sign
Rec. Solution:	Provide signs stating "EXIT ROUTE" at exit side of door
Barrier Severity:	2 Recommended Cost Est \$500.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes: At both	doors
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 52G
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Swimming Pool Spectator Seating 110
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Type:	Riser Height - Existing
Code References:	2010 ADAS 504.2
Performance Sta	ndard: No Quantity: SF As-built : 0
Barrier Description:	Stair riser height is not between 4" and 7"
Findings:	9-3/4" to 10-1/4" stair riser height
Rec. Solution:	No remediation recommended. Stairway technically infeasible to alter
Barrier Severity:	4 Low Severity Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 52H
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Swimming Pool Spectator Seating 110
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Assembly Areas
Barrier Type:	Wheelchair Clear Space
Code References:	2010 ADAS 802.1.2
Performance Sta	ndard: Quantity: SF As-built : 80
Barrier Description:	Area for wheelchair spaces lacks 36" wide space for a single seat
Findings:	295 seats estimated in seating area. No accessible seating
Rec. Solution:	Redesign assembly seating area to provide accessible seating on upper rows
Barrier Severity:	2 Recommended Cost Est \$22,000.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 521
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Swimming Pool Spectator Seating 110
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Area: Barrier Type:	Contrasting Color - ADA
Barrier Type: Code	Contrasting Color - ADA  2010 ADAS Advisory 504.4
Barrier Type: Code References:	Contrasting Color - ADA  2010 ADAS Advisory 504.4
Barrier Type: Code References: Performance Sta Barrier	Contrasting Color - ADA  2010 ADAS Advisory 504.4  Indard: Yes Quantity: LF or TR As-built: 1
Barrier Type: Code References: Performance Sta Barrier Description:	Contrasting Color - ADA  2010 ADAS Advisory 504.4  Indard: Yes Quantity: LF or TR As-built: 1  No contrasting color on each tread of interior stairway
Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Contrasting Color - ADA  2010 ADAS Advisory 504.4  Indard: Yes Quantity: LF or TR As-built: 1  No contrasting color on each tread of interior stairway  Treads lack contrasting color defined as 70% contrast  Recommended: Consider providing contrasting color on each tread
Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Contrasting Color - ADA  2010 ADAS Advisory 504.4  Indard: Yes Quantity: LF or TR As-built: 1  No contrasting color on each tread of interior stairway  Treads lack contrasting color defined as 70% contrast  Recommended: Consider providing contrasting color on each tread  2 Recommended Cost Est \$35.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 52J
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Swimming Pool Spectator Seating 110
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Type:	Handrail - Both Sides
Code References:	2010 ADAS 505.10.2
Performance Sta	ndard: No Quantity: LF As-built : 36
Barrier Description:	No handrail provided at both sides of stairway
Findings:	No handrail provided at both sides
Rec. Solution:	Provide handrails at both sides of stairway
Barrier Severity:	2 Recommended Cost Est \$8,100.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
r	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 52K
Field Date: Bldg Name:	2/24/2014   Report Date   2/27/2014   Barrier #:
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Bldg Name: Location:	Women's Building Reference Dwg: 4 of 6 Floor 1 - Swimming Pool Spectator Seating 110
Bldg Name: Location: X Coordinate:	Women's Building Reference Dwg: 4 of 6  Floor 1 - Swimming Pool Spectator Seating 110  N/A Y Coordinate: N/A
Bldg Name: Location: X Coordinate: Barrier Area:	Women's Building Reference Dwg: 4 of 6  Floor 1 - Swimming Pool Spectator Seating 110  N/A Y Coordinate: N/A  Alarms
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code	Women's Building Reference Dwg: 4 of 6  Floor 1 - Swimming Pool Spectator Seating 110  N/A Y Coordinate: N/A  Alarms  Horn/Strobe  2010 ADAS 702.1
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Women's Building Reference Dwg: 4 of 6  Floor 1 - Swimming Pool Spectator Seating 110  N/A Y Coordinate: N/A  Alarms  Horn/Strobe  2010 ADAS 702.1
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Women's Building Reference Dwg: 4 of 6  Floor 1 - Swimming Pool Spectator Seating 110  N/A Y Coordinate: N/A  Alarms  Horn/Strobe  2010 ADAS 702.1  Indard: No Quantity: EACH As-built: 2
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Women's Building Reference Dwg: 4 of 6  Floor 1 - Swimming Pool Spectator Seating 110  N/A Y Coordinate: N/A  Alarms  Horn/Strobe  2010 ADAS 702.1  Indard: No Quantity: EACH As-built: 2  No horn/strobes in common use areas
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Women's Building Reference Dwg: 4 of 6  Floor 1 - Swimming Pool Spectator Seating 110  N/A Y Coordinate: N/A  Alarms  Horn/Strobe  2010 ADAS 702.1  mdard: No Quantity: EACH As-built: 2  No horn/strobes in common use areas  No device provided  Provide strobes in common use area
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Women's Building Reference Dwg: 4 of 6  Floor 1 - Swimming Pool Spectator Seating 110  N/A Y Coordinate: N/A  Alarms  Horn/Strobe  2010 ADAS 702.1  Indard: No Quantity: EACH As-built: 2  No horn/strobes in common use areas  No device provided  Provide strobes in common use area  1 Necessary Cost Est \$11,000.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 53
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Elevator E101
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Elevators
Barrier Type:	Doorjamb marking - Height
Code References:	2010 ADAS 407.2.3.1
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Elevator landing door jamb signage not located 60" on center on both jamb panels
Findings:	61-1/4" high
Rec. Solution:	Replace door jamb signage
Barrier Severity:	2 Recommended Cost Est \$250.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 54A
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Vestibule V111
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	
Dairiei Alea.	Signage
Barrier Type:	Permanent Room/Space - Tactile Characters
Barrier Type: Code	Permanent Room/Space - Tactile Characters  2010 ADAS 216.2
Barrier Type: Code References:	Permanent Room/Space - Tactile Characters  2010 ADAS 216.2
Barrier Type: Code References: Performance Sta Barrier	Permanent Room/Space - Tactile Characters  2010 ADAS 216.2  andard: No Quantity: EACH As-built: 1  At interior or exterior location, no tactile characters at sign identifying permanent rooms and
Barrier Type: Code References: Performance Sta Barrier Description:	Permanent Room/Space - Tactile Characters  2010 ADAS 216.2  andard: No Quantity: EACH As-built: 1  At interior or exterior location, no tactile characters at sign identifying permanent rooms and spaces
Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Permanent Room/Space - Tactile Characters  2010 ADAS 216.2  Andard: No Quantity: EACH As-built: 1  At interior or exterior location, no tactile characters at sign identifying permanent rooms and spaces  No tactile signage provided at door within public route  Provide accessible sign
Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Permanent Room/Space - Tactile Characters  2010 ADAS 216.2  andard: No Quantity: EACH As-built: 1  At interior or exterior location, no tactile characters at sign identifying permanent rooms and spaces  No tactile signage provided at door within public route  Provide accessible sign  1 Necessary Cost Est \$250.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 54B
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Vestibule V111
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Door Closer - Interior Adjustment
Code References:	2010 ADAS 404.2.9
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Door opening force exceeds 5 lbf
Findings:	10-12 lbf
Rec. Solution:	Replace or adjust existing closer
Barrier Severity:	1 Necessary Cost Est \$450.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 54C
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Vestibule V111
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Door Closer - Sweep Period
Code References:	2010 ADAS 404.2.8.1
Performance Sta	andard: No Quantity: EACH As-built : 0
Barrier Description:	Door closer lacks min. 5 second sweep period
Findings:	4 second sweep
Rec. Solution:	Replace or adjust existing closer
Barrier Severity:	
	2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 54D
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Vestibule V111
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Hardware - Operation
Code References:	2010 ADAS 404.2.7
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Hardware not operable with a closed fist
Findings:	Hardware not operable with a closed fist
Rec. Solution:	Provide new hardware
Barrier Severity:	1 Necessary Cost Est \$300.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 54E
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Vestibule V111
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Door 10" Bottom Surface - Kickplate
Code References:	2010 ADAS 404.2.10
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Door/Gate lacks min. 10" smooth uninterrupted bottom surface
Findings:	Bottom of door not smooth and uninterrupted
Rec. Solution:	Provide kick plate min. 10" high at push side of door
Barrier Severity:	1 Necessary Cost Est \$225.00 Facility Function: Public Status: Open
Implementation	
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 54F
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Vestibule V111
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Threshold - Height exceeding 1/2"
Code References:	2010 ADAS 404.2.5
Performance Sta	indard: No Quantity: EACH As-built : 1
Barrier Description:	Door/Gate threshold exceeds 1/2" in height
Findings:	1-1/4" high
Rec. Solution:	Provide new door threshold
Barrier Severity:	1 Necessary Cost Est \$275.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 54G
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Vestibule V111
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Type:	Sign - Exit Door
Code References:	Performance Standard
Performance Sta	ndard: Yes Quantity: EACH As-built : 1
Barrier Description:	Door leading directly into an exit stairway lacks tactile exit sign
Findings:	Door to exit stair with low level illuminated sign lacks tactile exit sign
Rec. Solution:	Provide sign stating "EXIT STAIR DOWN (or UP)" at latch side of door
Barrier Severity:	2 Recommended Cost Est \$250.00 Facility Function: Public Status: Open
Implementation	
	Priority: 3 Implementation Phase: Implementation Date:



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 54H
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Vestibule V111
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Clear Floor Space
Barrier Type:	Protruding Object
Code References:	2010 ADAS 307
Performance Sta	andard: No Quantity: EACH As-built : 2
Barrier Description:	Protruding object in in circulation path protrudes more than 4" between 27" and 80" high
Findings:	Valves protrude 15" to 21" at 63-1/4" high to 66" high
Rec. Solution:	Remove objects or provide detectable warning (wing walls)
Barrier Severity:	1 Necessary Cost Est \$1,100.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 54I
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Vestibule V111
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	Tactile Exit Signs - Passage
Code References:	Performance Standard
Performance Sta	andard: Yes Quantity: EACH As-built : 1
Barrier Description:	Exit thru an exit enclosure/exit passageway lacks tactile exit sign
Findings:	Passageway to exterior exit with low level illuminated sign lacks tactile exit sign
Rec. Solution:	Provide sign stating "EXIT ROUTE" at exit side of door
Barrier Severity:	
	2 Recommended Cost Est \$250.00 Facility Function: Public Status: Open
Implementation	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 54J
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Vestibule V111
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Alarms
Barrier Type:	Horn/Strobe
Code References:	2010 ADAS 702.1
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	No horn/strobes in common use areas
Findings:	No device provided
Rec. Solution:	Provide strobes in common use area
Barrier Severity:	1 Necessary Cost Est \$5,500.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 55A
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Stairway S101
X Coordinate:	
A Coordinate.	N/A Y Coordinate: N/A
Barrier Area:	N/A   Y Coordinate:   N/A     Stairways
	Stairways Sign - Encl Stairway Level
Barrier Area:	Stairways
Barrier Area: Barrier Type: Code	Stairways Sign - Encl Stairway Level ICC A117.1
Barrier Area: Barrier Type: Code References:	Stairways Sign - Encl Stairway Level ICC A117.1
Barrier Area: Barrier Type: Code References: Performance Sta Barrier	Stairways Sign - Encl Stairway Level ICC A117.1 Indard: No Quantity: EACH As-built: 1
Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Stairways Sign - Encl Stairway Level ICC A117.1  Indard: No Quantity: EACH As-built: 1  Tactile stairway signage not provided to indicate floor level
Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Stairways Sign - Encl Stairway Level ICC A117.1 Indard: No Quantity: EACH As-built: 1 Tactile stairway signage not provided to indicate floor level No sign indicating floor level Provide sign
Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Stairways  Sign - Encl Stairway Level  ICC A117.1  Indard: No Quantity: EACH As-built: 1  Tactile stairway signage not provided to indicate floor level  No sign indicating floor level  Provide sign  2 Recommended Cost Est \$250.00 Facility Function: Public Status: Open



Field Date:	2/24/2014   Report Date   2/27/2014   Barrier #:
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Stairway S101
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Type:	Handrail Height
Code References:	2010 ADAS 505.10.2
Performance Sta	ndard: No Quantity: LF As-built: 110
Barrier Description:	Handrail grip measured at center not 34"- 38" high
Findings:	31" handrail grip height
Rec. Solution:	Provide handrails at both sides of stairway
Barrier Severity:	2 Recommended Cost Est \$24,750.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes: For left	railing in stairway
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 55C
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Stairway S101
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Type:	Handrail Extension - Bottom
Code References:	2010 ADAS 505.10.3
Performance Sta	ndard: No Quantity: LF As-built : 0
Barrier Description:	Bottom handrail extension not sloped for length of one tread beyond the last riser nosing
Findings:	Extension not the length of one tread
Rec. Solution:	Provide handrails at both sides of stairway
Barrier Severity:	2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes: For thre	e landings in stairway



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 55D
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Stairway S101
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Type:	Handrail Extension - Bottom
Code References:	2010 ADAS 505.10.1
Performance Sta	ndard: No Quantity: LF As-built : 0
Barrier Description:	Bottom handrail extension not level for min. 12"
Findings:	No extension provided
Rec. Solution:	Provide handrails at both sides of stairway
Barrier Severity:	2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes: For left i	railing in stairway
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 55E
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Stairway S101
	JF1001 1 - Stall Way 5101
X Coordinate:	N/A Y Coordinate: N/A
X Coordinate: Barrier Area:	
	N/A Y Coordinate: N/A
Barrier Area:	N/A Y Coordinate: N/A  Stairways  Handrail Extension - Top
Barrier Area: Barrier Type: Code	N/A Y Coordinate: N/A  Stairways  Handrail Extension - Top  2010 ADAS 505.10.2
Barrier Area: Barrier Type: Code References:	N/A Y Coordinate: N/A  Stairways  Handrail Extension - Top  2010 ADAS 505.10.2
Barrier Area: Barrier Type: Code References: Performance Sta Barrier	N/A  Stairways  Handrail Extension - Top  2010 ADAS 505.10.2  ndard: No Quantity: LF As-built: 0
Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	N/A  Stairways  Handrail Extension - Top  2010 ADAS 505.10.2  ndard: No Quantity: LF As-built: 0  Top Handrail extension not parallel to ground/floor surface
Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	N/A  Stairways  Handrail Extension - Top  2010 ADAS 505.10.2  ndard: No Quantity: LF As-built: 0  Top Handrail extension not parallel to ground/floor surface  Top handrail extension not parallel to ground surface
Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	N/A Y Coordinate: N/A  Stairways  Handrail Extension - Top  2010 ADAS 505.10.2  ndard: No Quantity: LF As-built: 0  Top Handrail extension not parallel to ground/floor surface  Top handrail extension not parallel to ground surface  Provide handrails at both sides of stairway  2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 55F
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Stairway S101
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Type:	Handrail Grip
Code References:	2010 ADAS 505.7
Performance Sta	ndard: No Quantity: LF As-built : 0
Barrier Description:	Handrail grip is not 1-1/4" - 2" in diameter
Findings:	3" handrail grip diameter
Rec. Solution:	Provide handrails at both sides of stairway
Barrier Severity:	2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes: At railin	g on left of stairway
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 55G
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Stairway S101
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Type:	Contrasting Color - ADA
Code References:	2010 ADAS Advisory 504.4
Performance Sta	ndard: Yes Quantity: LF or TR As-built : 1
Barrier Description:	No contrasting color on each tread of interior stairway
Findings:	Treads lack contrasting color defined as 70% contrast
Rec. Solution:	Recommended: Consider providing contrasting color on each tread
Barrier Severity:	2 Recommended Cost Est \$35.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes: Through	nout entire stairway.



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 55H
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Stairway S101
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Type:	Surface Condition - Existing
Code References:	2010 ADAS 504.4
Performance Sta	ndard: No Quantity: SF As-built : 0
Barrier Description:	Stairway surface is not slip resistant
Findings:	Slip resistant surface could not be verified
Rec. Solution:	Provide slip-resistant surface when remodeling
Barrier Severity:	4 Low Severity Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes: Entire s	tairway
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 551
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Stairway S101
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Alarms
Barrier Type:	Horn/Strobe
Code References:	2010 ADAS 702.1
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	No horn/strobes in common use areas
Findings:	No device provided
Rec. Solution:	Provide strobes in common use area
Barrier Severity:	1 Necessary Cost Est \$5,500.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 56A
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Central Lobby Area
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Clear Floor Space
Barrier Type:	Protruding Object
Code References:	2010 ADAS 307
Performance Sta	ndard: No Quantity: EACH As-built : 6
Barrier Description:	Protruding object in in circulation path protrudes more than 4" between 27" and 80" high
Findings:	Wall sconces protrude 5-1/2" at 64-1/2" high
Rec. Solution:	Remove objects or provide detectable warning (wing walls)
Barrier Severity:	1 Necessary Cost Est \$3,300.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes: 6 sconce	es protude below 80" but there are a total of 12 such fixtures within the entire space.
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 56B
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Central Lobby Area
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Electrical Outlets - Hi/Low Reach
Code References:	2010 ADAS 308.2.2
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Use of outlet involves low reach of less than 15" above floor or more than 48" high
Findings:	Outlet at floor
Rec. Solution:	Relocate outlet to area at min. 15" or max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 56C
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Central Lobby Area
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	Visual Information Provided (Exhibitions)
Code References:	ADA Title II Technical Assistance Manual 3.2000 Denial of participation
Performance Sta	ndard: No Quantity: JOB As-built : 1
Barrier Description:	Visual sign providing information for program, service or activity not accessible
Findings:	Accessible sign not provided
Rec. Solution:	Provide information in alternate format to provide access to people with vision impairments
Barrier Severity:	1 Necessary Cost Est \$5,000.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes: For Pede	estal base signs
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 56D
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Central Lobby Area
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Alarms
Barrier Type:	Horn/Strobe
Code References:	2010 ADAS 702.1
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	No horn/strobes in common use areas
Findings:	No device provided
Rec. Solution:	Provide strobes in common use area
Barrier Severity:	1 Necessary Cost Est \$5,500.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 57A
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Gymnasium 112
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	Permanent Room/Space - Tactile Characters
Code References:	2010 ADAS 216.2
Performance Sta	ndard: No Quantity: EACH As-built : 4
Barrier Description:	At interior or exterior location, no tactile characters at sign identifying permanent rooms and spaces
Findings:	No tactile signage provided at doors within public route
Rec. Solution:	Provide accessible signs
Barrier Severity:	1 Necessary Cost Est \$1,000.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes: Main Er	stry from corridor H103 and Vest V111, rooms 112E, 112B
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 57B
Field Date: Bldg Name:	2/24/2014Report Date2/27/2014Barrier #:57BWomen's BuildingReference Dwg:4 of 6
	Women's Building Reference Dwg: 4 of 6 Floor 1 - Gymnasium 112
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Bldg Name: Location:	Women's Building Reference Dwg: 4 of 6 Floor 1 - Gymnasium 112
Bldg Name: Location: X Coordinate:	Women's Building Reference Dwg: 4 of 6  Floor 1 - Gymnasium 112  N/A Y Coordinate: N/A  Doors or Gates  Door Closer - Interior
Bldg Name: Location: X Coordinate: Barrier Area:	Women's Building Reference Dwg: 4 of 6  Floor 1 - Gymnasium 112  N/A Y Coordinate: N/A  Doors or Gates
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code	Women's Building Reference Dwg: 4 of 6  Floor 1 - Gymnasium 112  N/A Y Coordinate: N/A  Doors or Gates  Door Closer - Interior  2010 ADAS 404.2.9
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Women's Building Reference Dwg: 4 of 6  Floor 1 - Gymnasium 112  N/A Y Coordinate: N/A  Doors or Gates  Door Closer - Interior  2010 ADAS 404.2.9
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Women's Building Reference Dwg: 4 of 6  Floor 1 - Gymnasium 112  N/A Y Coordinate: N/A  Doors or Gates  Door Closer - Interior  2010 ADAS 404.2.9  Indard: No Quantity: EACH As-built: 1
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Women's Building Reference Dwg: 4 of 6  Floor 1 - Gymnasium 112  N/A Y Coordinate: N/A  Doors or Gates  Door Closer - Interior  2010 ADAS 404.2.9  Indard: No Quantity: EACH As-built: 1  Door opening force exceeds 5 lbf
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Women's Building Reference Dwg: 4 of 6 Floor 1 - Gymnasium 112 N/A Y Coordinate: N/A  Doors or Gates  Door Closer - Interior  2010 ADAS 404.2.9  Indard: No Quantity: EACH As-built: 1  Door opening force exceeds 5 lbf  14-16 lbf  Provide automatic door opening device at min. 1 entry door and ISA directional sign at other
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Women's Building Reference Dwg: 4 of 6  Floor 1 - Gymnasium 112  N/A Y Coordinate: N/A  Doors or Gates  Door Closer - Interior  2010 ADAS 404.2.9  Indard: No Quantity: EACH As-built: 1  Door opening force exceeds 5 lbf  14-16 lbf  Provide automatic door opening device at min. 1 entry door and ISA directional sign at other  1 Necessary Cost Est \$5,000.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 57C
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Gymnasium 112
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Door Closer - Sweep Period
Code References:	2010 ADAS 404.2.8.1
Performance Sta	ndard: No Quantity: EACH As-built: 0
Barrier Description:	Door closer lacks min. 5 second sweep period
Findings:	4-5 second sweep, doors do not have backcheck
Rec. Solution:	Provide automatic door opening device at min. 1 entry door and ISA directional sign at other
Barrier Severity:	2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 57D
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Gymnasium 112
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Hardware - Operation
Code References:	2010 ADAS 404.2.7
Performance Sta	ndard: No Quantity: EACH As-built : 0
Barrier Description:	Hardware not operable with a closed fist
Findings:	Hardware not operable with a closed fist
Rec. Solution:	Provide automatic door opening device at min. 1 entry door and ISA directional sign at other
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: Main en	itry



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 57E
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Gymnasium 112
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Vision Lights - Existing
Code References:	2010 ADAS 404.2.11
Performance Sta	indard: No Quantity: EACH As-built : 2
Barrier Description:	View panels in or adjacent to doors or gates not max. 43" above floor or ground
Findings:	View panels located higher than 43" above the floor
Rec. Solution:	Replace doors/gates or vision panels
Barrier Severity:	3 Hindrance Cost Est \$4,500.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: Main En	rtry 47" high
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 57F
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Gymnasium 112
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Smooth Surface at Bottom
Code References:	2010 ADAS 404.2.3
Performance Sta	indard: No Quantity: EACH As-built : 1
Barrier Description:	Door stop at bottom of door creates trap condition for wheelchair footrests
Findings:	Door stop at bottom of door not accessible
Rec. Solution:	Remove door stop or any other element within bottom 10" of door
Barrier Severity:	1 Necessary Cost Est \$50.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: Main En	itry



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 57G
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Gymnasium 112
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Doormat 02/27/2014 17:16
Code References:	2010 ADAS 302.2 & Advisory 302.2
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Doormat not anchored to floor (possible trip hazard)
Findings:	Doormat not secured
Rec. Solution:	Secure exiting doormat or replace
Barrier Severity:	1 Necessary Cost Est \$500.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: Main En	itry
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 57H
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Gymnasium 112
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Threshold - Height exceeding 1/4" without bevel
Code References:	2010 ADAS 404.2.5
Performance Sta	andard: No Quantity: EACH As-built: 1
Barrier	
Description:	Door/Gate threshold exceeds 1/4" in height withouth a bevel
Description: Findings:	Door/Gate threshold exceeds 1/4" in height withouth a bevel  1-1/4" high
·	
Findings:	1-1/4" high Provide new door threshold
Findings: Rec. Solution:	1-1/4" high  Provide new door threshold  1 Necessary Cost Est \$275.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 57I
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Gymnasium 112
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Electrical Switches - Height
Code References:	2010 ADAS 308.2.1
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Light switch control box top edge not at max. 48" high
Findings:	50" - 83-3/4" high
Rec. Solution:	Relocate switch box top edges to max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: 2 of 2	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 57J
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Gymnasium 112
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Actuator or Control - Height
Code References:	2010 ADAS 305.3
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Control or mechanism not at max. 48" high for side reach
Findings:	Soap dispenser 55" high
Rec. Solution:	Relocate control or mechanism to max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	
	Priority: 2 Implementation Phase: Implementation Date:



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 57K
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Gymnasium 112
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	First Aid Kit - High Reach Range
Code References:	2010 ADAS 305.3
Performance Sta	indard: No Quantity: EACH As-built : 2
Barrier Description:	Opening mechanism on first aid kit not at max. 48" high for side reach
Findings:	62" high
Rec. Solution:	Relocate controls or mechanisms to max. 48" high
Barrier Severity:	1 Necessary Cost Est \$550.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 57L
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Gymnasium 112
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Drinking Fountains
Barrier Type:	
	Alcove - Existing (pre-1992)
Code References:	
	Alcove - Existing (pre-1992) 2010 ADAS 307.2
References:	Alcove - Existing (pre-1992) 2010 ADAS 307.2
References: Performance Sta Barrier	Alcove - Existing (pre-1992)  2010 ADAS 307.2  Indard: No Quantity: SF As-built: 4  Fountain with a leading edge between 27" and 80" high protrudes more than 4" into the
References: Performance Sta Barrier Description:	Alcove - Existing (pre-1992)  2010 ADAS 307.2  Indard: No Quantity: SF As-built: 4  Fountain with a leading edge between 27" and 80" high protrudes more than 4" into the circulation path.
References: Performance Sta Barrier Description: Findings:	Alcove - Existing (pre-1992)  2010 ADAS 307.2  Indard: No Quantity: SF As-built: 4  Fountain with a leading edge between 27" and 80" high protrudes more than 4" into the circulation path.  No alcove provided at either fountain provided in space  Provide wing walls as detectable warning (existing unit only)
References: Performance Sta Barrier Description: Findings: Rec. Solution:	Alcove - Existing (pre-1992)  2010 ADAS 307.2  Indard: No Quantity: SF As-built: 4  Fountain with a leading edge between 27" and 80" high protrudes more than 4" into the circulation path.  No alcove provided at either fountain provided in space  Provide wing walls as detectable warning (existing unit only)  1 Necessary Cost Est \$1,000.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 57M
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Gymnasium 112
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Drinking Fountains
Barrier Type:	Bubbler water flow
Code References:	2010 ADAS 602.6
Performance Sta	andard: No Quantity: JOB As-built : 0
Barrier Description:	Water flow from bubbler not min. 4" high
Findings:	1/2" high water flow from bubblers
Rec. Solution:	Adiust drinking fountains to provide min. 4" high water flow
Barrier Severity:	2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
	cal drinking fountains are both low fountains. No fountain provided for people with bending and g injuries
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 57N
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Gymnasium 112
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Drinking Fountains
Barrier Type:	Toe Clearance
Code References:	2010 ADAS 306.2.3
Performance Sta	ndard: No Quantity: EACH As-built : 0
Barrier Description:	No toe clearance 9" high AFF and 17" deep from front edge
Findings:	14-1/2" deep toe clearance
Rec. Solution:	Provide min one high fountain in room or on floor with ISA directional signs leading to fountain
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
	cal drinking fountains are both low fountains. No fountain provided for people with bending and g injuries



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 570
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Gymnasium 112
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Counters and Tables
Barrier Type:	Table - Knee Clearance
Code References:	2010 ADAS 305.3
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Knee clearance not min. 27" high, 19" deep or 30" wide
Findings:	24-1/2" knee clearance
Rec. Solution:	Move stored objects
Barrier Severity:	3 Hindrance Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 57P
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Gymnasium 112
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	Visual Information Provided (Exhibitions)
Code References:	ADA Title II Technical Assistance Manual 3.2000 Denial of participation
Performance Sta	andard: No Quantity: JOB As-built : 1
Barrier Description:	Visual sign providing information for program, service or activity not accessible
Findings:	Accessible signs not provided
Rec. Solution:	
	Provide information in alternate format to provide access to people with vision impairments
Barrier Severity:	
Barrier Severity: Implementation	1 Necessary Cost Est \$5,000.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 57Q
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Gymnasium 112
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Electrical Outlets - Hi/Low Reach
Code References:	2010 ADAS 308.2.2
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Use of outlet involves low reach of less than 15" above floor or more than 48" high
Findings:	12" high and obstructed by objects
Rec. Solution:	Relocate outlet to area at min. 15" or max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 57R
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Gymnasium 112
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Assembly Areas
Barrier Type:	Wheelchair Clear Space
Code References:	2010 ADAS 802.1.2
Performance Sta	andard: Quantity: SF As-built: 100
Barrier Description:	Area for wheelchair spaces lacks 36" wide space for a single seat
Findings:	85 seats estimated in bleachers. No accessible seating provided
Rec. Solution:	Redesign assembly seating area
Barrier Severity:	2 Recommended Cost Est \$27,500.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 57S
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Gymnasium 112
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	Tactile Exit Signs - Door
Code References:	2010 ADAS 216.4.1
Performance Sta	ndard: No Quantity: EACH As-built : 4
Barrier Description:	Ground floor doors that exit to exterior lacks tactile exit sign
Findings:	Exit door with low level illuminated sign lacks tactile exit sign
Rec. Solution:	Provide signs stating "EXIT" at exit side of door
Barrier Severity:	1 Necessary Cost Est \$1,000.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 57T
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Gymnasium 112
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Alarms
Barrier Type:	Horn/Strobe
Code References:	2010 ADAS 702.1
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	No horn/strobes in common use areas
Findings:	No device provided
Rec. Solution:	Provide strobes in common use area
Barrier Severity:	1 Necessary Cost Est \$5,500.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 58A
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - North Lobby Area
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	Permanent Room/Space - Tactile Characters
Code References:	2010 ADAS 216.2
Performance Sta	ndard: No Quantity: EACH As-built : 2
Barrier Description:	At interior or exterior location, no tactile characters at sign identifying permanent rooms and spaces
Findings:	No tactile signage provided at doors within public route
Rec. Solution:	Provide accessible signs
Barrier Severity:	1 Necessary Cost Est \$500.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes: Rooms 2	124, 125
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 58B
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - North Lobby Area
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Drinking Fountains
Barrier Type:	Alcove - Existing (pre-1992)
Code References:	2010 ADAS 307.2
Performance Sta	ndard: No Quantity: SF As-built : 1
Barrier Description:	Fountain with a leading edge between 27" and 80" high protrudes more than 4" into the circulation path.
Findings:	No alcove provided where fountain protrudes 18-1/2"
Rec. Solution:	Provide wing walls as detectable warning (existing unit only)
Barrier Severity:	1 Necessary Cost Est \$250.00 Facility Function: Public Status: Open
Implementation	
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 58C
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - North Lobby Area
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Electrical Switches - Height
Code References:	2010 ADAS 308.2.1
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Light switch control box top edge not at max. 48" high
Findings:	Sliding light controls 48-1/4" high
Rec. Solution:	Relocate switch box top edge to max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 58D
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - North Lobby Area
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Clear Floor Space
Barrier Type:	Protruding Object
Code References:	2010 ADAS 307
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Protruding object in in circulation path protrudes more than 4" between 27" and 80" high
Findings:	Prongs on pipe protrude 4-1/4" at 69-3/4" high
Rec. Solution:	Remove object or provide detectable warning (wing walls)
Barrier Severity:	1 Necessary Cost Est \$550.00 Facility Function: Public Status: Open
Implementation	
•	Priority: 1 Implementation Phase: Implementation Date:



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 58E
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - North Lobby Area
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Clear Floor Space
Barrier Type:	Protruding Object
Code References:	2010 ADAS 307
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Protruding object in in circulation path protrudes more than 4" between 27" and 80" high
Findings:	Television protrudes 5-1/2" at 62" high
Rec. Solution:	Remove object or provide detectable warning (wing walls)
Barrier Severity:	1 Necessary Cost Est \$550.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 58F
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - North Lobby Area
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Corridors
Barrier Type:	Bench - Seat Height/Depth
Code References:	2010 ADAS 903.3
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Bench seat not 20" to 24" deep and height not 17" to 19" above ground
Findings:	12" high and 12" deep
Rec. Solution:	Provide min. one accessible bench in corridor
Barrier Severity:	3 Hindrance Cost Est \$1,100.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 58G
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - North Lobby Area
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Alarms
Barrier Type:	Fire Pull 02/78/2014 11 41
Code References:	2010 ADAS 309.4
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Fire pull has no usable hardware
Findings:	Fire pull not fist operable
Rec. Solution:	Replace fire pull when remodeling
Barrier Severity:	4 Low Severity Cost Est \$3,500.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 58H
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - North Lobby Area
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Alarms
Barrier Type:	Fire Pull 02/28/2014 11 41
Code References:	2010 ADAS 308.2.2
Performance Sta	ndard: No Quantity: EACH As-built : 0
Barrier Description:	Fire pulls not between 42" and 48" high
Findings:	53-1/2" high
Rec. Solution:	Replace fire pull when remodeling
Barrier Severity:	4 Low Severity Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 58I
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - North Lobby Area
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Actuator or Control - Height
Code References:	2010 ADAS 305.3
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Control or mechanism not at max. 48" high for side reach
Findings:	Mailboxes 37-3/4" high at bottom to 73-1/4" high at top
Rec. Solution:	Relocate control or mechanism to max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: Inbox ro	oom 125
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 58J
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - North Lobby Area
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Alarms
Barrier Type:	Horn - No Strobe
Code References:	2010 ADAS 702
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Horn provided in location where no stobe is provided
Findings:	No strobe device provided
Rec. Solution:	Provide strobe in common use area
Barrier Severity:	1 Necessary Cost Est \$550.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes: No strol	p.e



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 59A
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Public Health/Human Science Dept
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	Permanent Room/Space - Tactile Characters
Code References:	2010 ADAS 216.2
Performance Sta	andard: No Quantity: EACH As-built : 2
Barrier Description:	At interior or exterior location, no tactile characters at sign identifying permanent rooms and spaces
Findings:	No tactile signage provided at doors within public route
Rec. Solution:	Provide accessible signs
Barrier Severity:	1 Necessary Cost Est \$500.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes: Main en	ntry and space 120 on side of cubical in entry corridor
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 59B
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Public Health/Human Science Dept
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Door Closer - Interior
Code References:	2010 ADAS 404.2.9
Performance Sta	indard: No Quantity: EACH As-built : 1
Barrier Description:	Door opening force exceeds 5 lbf
Findings:	10 lbf
Rec. Solution:	Provide automatic door opening device
Barrier Severity:	1 Necessary Cost Est \$5,000.00 Facility Function: Public Status: Open
	1 Necessary Cost Est \$5,000.00 Facility Function: Public Status: Open
Implementation	



Field Date:	
	2/24/2014 Report Date 2/27/2014 Barrier #: 59C
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Public Health/Human Science Dept
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Door Closer - Sweep Period
Code References:	2010 ADAS 404.2.8.1
Performance Sta	andard: No Quantity: EACH As-built : 0
Barrier Description:	Door closer lacks min. 5 second sweep period
Findings:	4 second sweep
Rec. Solution:	Provide automatic door opening device
Barrier Severity:	2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 59D
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Public Health/Human Science Dept
X Coordinate:	N/A Y Coordinate: N/A
X Coordinate: Barrier Area:	N/A Y Coordinate: N/A  Doors or Gates
Barrier Area:	Doors or Gates
Barrier Area: Barrier Type: Code	Doors or Gates Vision Lights - Existing 2010 ADAS 404.2.11
Barrier Area: Barrier Type: Code References:	Doors or Gates Vision Lights - Existing 2010 ADAS 404.2.11
Barrier Area: Barrier Type: Code References: Performance Sta Barrier	Doors or Gates  Vision Lights - Existing  2010 ADAS 404.2.11  andard: No Quantity: EACH As-built: 2
Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Doors or Gates  Vision Lights - Existing  2010 ADAS 404.2.11  andard: No Quantity: EACH As-built: 2  View panels in or adjacent to doors or gates not max. 43" above floor or ground
Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Doors or Gates  Vision Lights - Existing  2010 ADAS 404.2.11  Indard: No Quantity: EACH As-built: 2  View panels in or adjacent to doors or gates not max. 43" above floor or ground  View panels located higher than 43" above the floor  Replace doors/gates or vision panels
Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Doors or Gates  Vision Lights - Existing  2010 ADAS 404.2.11  Indard: No Quantity: EACH As-built: 2  View panels in or adjacent to doors or gates not max. 43" above floor or ground  View panels located higher than 43" above the floor  Replace doors/gates or vision panels  3 Hindrance Cost Est \$4,500.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 59E
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Public Health/Human Science Dept
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Door 10" Bottom Surface - Door Stop
Code References:	2010 ADAS 404.2.10
Performance Sta	andard: No Quantity: EACH As-built : 2
Barrier Description:	Door stop interrupts min.10" smooth bottom surface
Findings:	Door stops at bottom of door not accessible
Rec. Solution:	Remove door stop or any other element within bottom 10" of door
Barrier Severity:	1 Necessary Cost Est \$150.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 59F
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Public Health/Human Science Dept
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Counters and Tables
Barrier Type:	Counter - Surface Height
Code References:	2010 ADAS 902.3
Performance Sta	andard: No Quantity: EACH As-built: 1
Barrier Description:	No section at least 3 feet long between 28" and 34" provided at existing counter
Findings:	44-3/4" high
Rec. Solution:	Provide min. 3 ft long section of counter at max. 34" high
Rec. Solution: Barrier Severity:	
Rec. Solution: Barrier Severity: Implementation	3 Hindrance Cost Est \$875.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 59G
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Public Health/Human Science Dept
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Electrical Outlets - Hi/Low Reach
Code References:	2010 ADAS 308.2.2
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Use of outlet involves low reach of less than 15" above floor or more than 48" high
Findings:	12" high
Rec. Solution:	Relocate outlet to area at min. 15" or max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 59H
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Public Health/Human Science Dept
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Clear Floor Space
Barrier Type:	Passageway - Min. 36"
Code References:	2010 ADAS 403.5.1
Performance Sta	ndard: No Quantity: LF As-built : 0
Barrier Description:	Circulation route not min. 36" wide between elements
Findings:	33" wide circulation route
Rec. Solution:	Rearrange furniture to provide access
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 59
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Public Health/Human Science Dept
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Shelves or Cabinets
Code References:	2010 ADAS 305.3
Performance Sta	ndard: No Quantity: JOB As-built : 1
Barrier Description:	Shelf or cabinet not mounted max. 48" above floor or ground
Findings:	Shelf or cabinet not accessible
Rec. Solution:	Provide additional shelf at accessible height or provide assistance
Barrier Severity:	3 Hindrance Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: 50" high	1
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 60A
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Staff Office 123
X Coordinate:	N/A Y Coordinate: N/A Eileen Kaspar Marie Harvey
Barrier Area:	Signage Heather Turner
Barrier Type:	Permanent Room/Space - Tactile Characters
Code References:	2010 ADAS 216.2
Performance Sta	ndard: No Quantity: EACH As-built : 3
Barrier Description:	At interior or exterior location, no tactile characters at sign identifying permanent rooms and spaces
Findings:	No tactile signage provided at doors within public route
Rec. Solution:	Provide accessible signs
Barrier Severity:	1 Necessary Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes: Main En	etry, Rooms 123A, 124(labled as Room 123)



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 60B
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Staff Office 123
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Threshold - Height exceeding 1/2"
Code References:	2010 ADAS 404.2.5
Performance Sta	indard: No Quantity: EACH As-built : 1
Barrier Description:	Door/Gate threshold exceeds 1/2" in height
Findings:	3/4" high
Rec. Solution:	Provide new door threshold
Barrier Severity:	1 Necessary Cost Est \$275.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 60C
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Staff Office 123
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Clear Floor Space - Stored Elements
Code References:	2010 ADAS 305.3
Performance Sta	indard: No Quantity: JOB As-built : 1
Barrier Description:	Clear floor space for wheelchair not provided at control or mechanism
Findings:	Cabinet blocks clear floor space for light switch
Rec. Solution:	Move stored items
Barrier Severity:	1 Necessary Cost Est \$125.00 Facility Function: Public Status: Open
Implementation	
Notes:	Priority: 2 Implementation Phase: Implementation Date:



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 60D
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Staff Office 123
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Electrical Outlets - Hi/Low Reach
Code References:	2010 ADAS 308.2.2
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Use of outlet involves low reach of less than 15" above floor or more than 48" high
Findings:	10-1/2" high
Rec. Solution:	Relocate outlet to area at min. 15" or max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 60E
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Staff Office 123
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Counters and Tables
Barrier Type:	Counter - Surface Height
Code References:	2010 ADAS 902.3
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	No section at least 3 feet long between 28" and 34" provided at existing counter
Findings:	46-3/4" high
Rec. Solution:	Provide min. 3 ft long section of counter at max. 34" high
Barrier Severity:	3 Hindrance Cost Est \$875.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 60F
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Staff Office 123
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Clear Floor Space
Barrier Type:	Passageway - Min. 36"
Code References:	2010 ADAS 403.5.1
Performance Sta	ndard: No Quantity: LF As-built : 0
Barrier Description:	Circulation route not min. 36" wide between elements
Findings:	28" wide circulation route to desk
Rec. Solution:	Remove stored objects ot provide access
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: At desk	between space heater and tripod.
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 60G
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Staff Office 123
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Alarms
Barrier Type:	Horn/Strobe
Code References:	2010 ADAS 702.1
Performance Sta	ndard: No Quantity: EACH As-built: 1
Barrier Description:	No horn/strobes in common use areas
Findings:	No device provided
Rec. Solution:	Provide strobes in common use area
Barrier Severity:	1 Necessary Cost Est \$5,500.00 Facility Function: Public Status: Open
Implementation	
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 61A
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Mail Room 122
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	Permanent Room/Space - Tactile Characters
Code References:	2010 ADAS 216.2
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	At interior or exterior location, no tactile characters at sign identifying permanent rooms and spaces
Findings:	No tactile signage provided at door within public route
Rec. Solution:	Provide accessible sign
Barrier Severity:	1 Necessary Cost Est \$250.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 61B
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Mail Room 122
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Hardware - Operation
Code References:	2010 ADAS 404.2.7
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier	
Description:	Hardware not operable with a closed fist
Description: Findings:	Hardware not operable with a closed fist  Hardware not operable with a closed fist
·	
Findings:	Hardware not operable with a closed fist  Provide new hardware
Findings: Rec. Solution:	Hardware not operable with a closed fist  Provide new hardware  1 Necessary Cost Est \$300.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 61C
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Mail Room 122
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Vision Lights - Existing
Code References:	2010 ADAS 404.2.11
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	View panels in or adjacent to doors or gates not max. 43" above floor or ground
Findings:	View panel located higher than 43" above the floor
Rec. Solution:	Replace door/gate or vision panel
Barrier Severity:	3 Hindrance Cost Est \$2,250.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: 48-1/2"	high
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 61D
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Mail Room 122
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Front App/pull 18" SEC - Relocate Door
Code References:	2010 ADAS Figure 404.2.4.1
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Door/Gate at pull side with min. 60" lacks min. 18" strike edge clearance at pull side
Findings:	9-3/4" strike edge clearance
Rec. Solution:	Relocate door or gate to provide maneuvering clearance
Barrier Severity:	1 Necessary Cost Est \$2,250.00 Facility Function: Public Status: Open
Implementation	
Notes:	' <u>                                    </u>



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 61E
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Mail Room 122
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Clear Floor Space
Barrier Type:	Passageway - Min. 36"
Code References:	2010 ADAS 403.5.1
Performance Sta	indard: No Quantity: LF As-built : 0
Barrier Description:	Circulation route not min. 36" wide between elements
Findings:	32" wide circulation route within room
Rec. Solution:	Remove stored objects ot provide access
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: No 60"	x 60" for turnaround manuever
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 61F
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Mail Room 122
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Electrical Switches - Height
Code References:	2010 ADAS 308.2.1
Performance Sta	indard: No Quantity: EACH As-built : 1
Barrier Description:	Light switch control box top edge not at max. 48" high
Findings:	49" high
Rec. Solution:	Relocate switch box top edge to max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 61G
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Mail Room 122
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Actuator or Control - Height
Code References:	2010 ADAS 305.3
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Control or mechanism not at max. 48" high for side reach
Findings:	Refrigerator 66" high
Rec. Solution:	Relocate control or mechanism to max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: For min	refrigerator on cabinet
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 61H
Field Date: Bldg Name:	2/24/2014 Report Date 2/27/2014 Barrier #: 61H  Women's Building Reference Dwg: 4 of 6
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Bldg Name: Location:	Women's Building Reference Dwg: 4 of 6 Floor 1 - Mail Room 122
Bldg Name: Location: X Coordinate:	Women's Building Reference Dwg: 4 of 6  Floor 1 - Mail Room 122  N/A Y Coordinate: N/A
Bldg Name: Location: X Coordinate: Barrier Area:	Women's Building Reference Dwg: 4 of 6  Floor 1 - Mail Room 122  N/A Y Coordinate: N/A  Controls and Mechanisms
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code	Women's Building Reference Dwg: 4 of 6  Floor 1 - Mail Room 122  N/A Y Coordinate: N/A  Controls and Mechanisms  First Aid Kit - High Reach Range  2010 ADAS 305.3
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Women's Building Reference Dwg: 4 of 6  Floor 1 - Mail Room 122  N/A Y Coordinate: N/A  Controls and Mechanisms  First Aid Kit - High Reach Range  2010 ADAS 305.3
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Women's Building Reference Dwg: 4 of 6  Floor 1 - Mail Room 122  N/A Y Coordinate: N/A  Controls and Mechanisms  First Aid Kit - High Reach Range  2010 ADAS 305.3  ndard: No Quantity: EACH As-built: 3
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Women's Building Reference Dwg: 4 of 6  Floor 1 - Mail Room 122  N/A Y Coordinate: N/A  Controls and Mechanisms  First Aid Kit - High Reach Range  2010 ADAS 305.3  ndard: No Quantity: EACH As-built: 3  Opening mechanism on first aid kit not at max. 48" high for side reach
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Women's Building Reference Dwg: 4 of 6 Floor 1 - Mail Room 122  N/A Y Coordinate: N/A  Controls and Mechanisms  First Aid Kit - High Reach Range  2010 ADAS 305.3  ndard: No Quantity: EACH As-built: 3  Opening mechanism on first aid kit not at max. 48" high for side reach  59"- 63" high
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Women's Building  Reference Dwg: 4 of 6  Floor 1 - Mail Room 122  N/A  Y Coordinate: N/A  Controls and Mechanisms  First Aid Kit - High Reach Range  2010 ADAS 305.3  ndard: No Quantity: EACH As-built: 3  Opening mechanism on first aid kit not at max. 48" high for side reach  59"- 63" high  Relocate controls or mechanisms to max. 48" high  1 Necessary  Cost Est \$825.00  Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 611
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Mail Room 122
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Coat Hook - Height
Code References:	2010 ADAS 603.4
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Clothing hooks not max. 48" high AFF
Findings:	56-1/2" high
Rec. Solution:	Provide additional hook
Barrier Severity:	2 Recommended Cost Est \$125.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 61J
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Mail Room 122
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Shelves or Cabinets
Code References:	2010 ADAS 305.3
Performance Sta	ndard: No Quantity: JOB As-built : 1
Barrier Description:	Shelf or cabinet not mounted max. 48" above floor or ground
Findings:	Shelf or cabinet not accessible
Rec. Solution:	Provide additional shelf at accessible height or provide assistance
Barrier Severity:	3 Hindrance Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	
Notes: 45-3/4"	high to bottom



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 61K
Bldg Name:	Women's Building Reference Dwg: 4 of 6
Location:	Floor 1 - Mail Room 122
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Alarms
Barrier Type:	Horn/Strobe 02/28/2014 13:28
Code References:	2010 ADAS 702.1
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	No horn/strobes in common use areas
Findings:	No device provided
Rec. Solution:	Provide strobes in common use area
Barrier Severity:	1 Necessary Cost Est \$5,500.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 62A
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Staff Office 120
Location: X Coordinate:	Floor 1 - Staff Office 120  N/A  Y Coordinate: N/A
	120 B) Convert No.
X Coordinate:	N/A Y Coordinate: N/A Signage Permanent Room/Space - Tactile Characters
X Coordinate: Barrier Area:	N/A Y Coordinate: N/A Signage
X Coordinate: Barrier Area: Barrier Type: Code	N/A Y Coordinate: N/A Signage Permanent Room/Space - Tactile Characters 2010 ADAS 216.2
X Coordinate: Barrier Area: Barrier Type: Code References:	N/A Y Coordinate: N/A Signage Permanent Room/Space - Tactile Characters 2010 ADAS 216.2
X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier	N/A  Signage  Permanent Room/Space - Tactile Characters  2010 ADAS 216.2  At interior or exterior location, no tactile characters at sign identifying permanent rooms and
X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	N/A  Signage  Permanent Room/Space - Tactile Characters  2010 ADAS 216.2  At interior or exterior location, no tactile characters at sign identifying permanent rooms and spaces
X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	N/A Signage Permanent Room/Space - Tactile Characters 2010 ADAS 216.2  At interior or exterior location, no tactile characters at sign identifying permanent rooms and spaces  No tactile signage provided at doors within public route  Provide accessible signs
X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	N/A Signage Permanent Room/Space - Tactile Characters 2010 ADAS 216.2  At interior or exterior location, no tactile characters at sign identifying permanent rooms and spaces  No tactile signage provided at doors within public route  Provide accessible signs  1 Necessary  Cost Est \$250.00  Facility Function: Public Status: Open
X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution: Barrier Severity: Implementation	N/A Signage Permanent Room/Space - Tactile Characters 2010 ADAS 216.2  At interior or exterior location, no tactile characters at sign identifying permanent rooms and spaces  No tactile signage provided at doors within public route  Provide accessible signs  1 Necessary  Cost Est \$250.00  Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 62B
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Staff Office 120
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Threshold - Height exceeding 1/2"
Code References:	2010 ADAS 404.2.5
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Door/Gate threshold exceeds 1/2" in height
Findings:	3/4" high
Rec. Solution:	Provide new door threshold
Barrier Severity:	1 Necessary Cost Est \$275.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 62C
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Staff Office 120
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Electrical Switches - Height
Code References:	2010 ADAS 308.2.1
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Light switch control box top edge not at max. 48" high
Findings:	48-1/2" high
Rec. Solution:	Relocate switch box top edge to max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	
	Priority: 2 Implementation Phase: Implementation Date:



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 62D
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Staff Office 120
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Counters and Tables
Barrier Type:	Counter - Surface Height
Code References:	2010 ADAS 902.3
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	No section at least 3 feet long between 28" and 34" provided at existing counter
Findings:	19-3/4" deep at 30" high
Rec. Solution:	Provide min. 3 ft long section of counter at max. 34" high
Barrier Severity:	3 Hindrance Cost Est \$875.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: For acce	essible portion of counter
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 62H
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Staff Office 120
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Counters and Tables
Barrier Type:	Counter - Surface Height
Code References:	2010 ADAS 902.3
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	No section at least 3 feet long between 28" and 34" provided at existing counter
Findings:	43-3/4" high
Rec. Solution:	Provide min. 3 ft long section of counter at max. 34" high
Barrier Severity:	3 Hindrance Cost Est \$875.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: For unir	ntegrated counter



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 62I
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Staff Office 120
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Clear Floor Space
Barrier Type:	Passageway - Min. 36"
Code References:	2010 ADAS 403.5.1
Performance Sta	andard: No Quantity: LF As-built : 0
Barrier Description:	Circulation route not min. 36" wide between elements
Findings:	19-1/2" wide circulation route between wall and counter
Rec. Solution:	Rearrange furniture to provide access
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 62K
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Staff Office 120
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Alarms
Barrier Type:	Horn/Strobe
Code References:	2010 ADAS 702.1
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	No horn/strobes in common use areas
Findings:	No device provided
Rec. Solution:	Provide strobes in common use area
	provide strobes in continion use area
Barrier Severity:	
Barrier Severity: Implementation	1 Necessary Cost Est \$5,500.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 63A
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Modern and Ballet Dance Studio 118
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	Permanent Room/Space - Tactile Characters
Code References:	2010 ADAS 216.2
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	At interior or exterior location, no tactile characters at sign identifying permanent rooms and spaces
Findings:	No tactile signage provided at door within public route
Rec. Solution:	Provide accessible sign
Barrier Severity:	1 Necessary Cost Est \$250.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 63B
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 Modern and Pallet Dance Studie 119
	Floor 1 - Modern and Ballet Dance Studio 118
X Coordinate:	N/A Y Coordinate: N/A
X Coordinate: Barrier Area:	
	N/A Y Coordinate: N/A  Doors or Gates  Door Closer - Interior
Barrier Area:	N/A Y Coordinate: N/A  Doors or Gates
Barrier Area: Barrier Type: Code	N/A Y Coordinate: N/A  Doors or Gates  Door Closer - Interior  2010 ADAS 404.2.9
Barrier Area: Barrier Type: Code References:	N/A Y Coordinate: N/A  Doors or Gates  Door Closer - Interior  2010 ADAS 404.2.9
Barrier Area: Barrier Type: Code References: Performance Sta	N/A  Y Coordinate: N/A  Doors or Gates  Door Closer - Interior  2010 ADAS 404.2.9  Indard: No Quantity: EACH As-built: 1
Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	N/A  Poors or Gates  Door Closer - Interior  2010 ADAS 404.2.9  Indard: No Quantity: EACH As-built: 1  Door opening force exceeds 5 lbf
Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	N/A  Doors or Gates  Door Closer - Interior  2010 ADAS 404.2.9  Indard: No Quantity: EACH As-built: 1  Door opening force exceeds 5 lbf  Provide automatic door opening device
Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	N/A  Doors or Gates  Door Closer - Interior  2010 ADAS 404.2.9  Indard: No Quantity: EACH As-built: 1  Door opening force exceeds 5 lbf  Provide automatic door opening device  1 Necessary Cost Est \$5,000.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 63C
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Modern and Ballet Dance Studio 118
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Door Closer - Sweep Period
Code References:	2010 ADAS 404.2.8.1
Performance Sta	ndard: No Quantity: EACH As-built : 0
Barrier Description:	Door closer lacks min. 5 second sweep period
Findings:	3-4 second sweep
Rec. Solution:	Provide automatic door opening device
Barrier Severity:	2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 63D
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Modern and Ballet Dance Studio 118
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Hardware - Operation
Code References:	2010 ADAS 404.2.7
Performance Sta	ndard: No Quantity: EACH As-built : 0
Barrier Description:	Hardware not operable with a closed fist
Findings:	Hardware not operable with a closed fist
Rec. Solution:	Provide automatic door opening device
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 63E
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Modern and Ballet Dance Studio 118
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Door 10" Bottom Surface - Door Hardware
Code References:	2010 ADAS 404.2.10
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Door hardware interrupts min. 10" smooth bottom surface
Findings:	Door hardware extends into bottom 10" of door
Rec. Solution:	Remove door stop or any other element within bottom 10" of door
Barrier Severity:	1 Necessary Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 63F
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Modern and Ballet Dance Studio 118
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Threshold - Height exceeding 1/2"
Code References:	2010 ADAS 404.2.5
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Door/Gate threshold exceeds 1/2" in height
Findings:	1" high
Rec. Solution:	Provide new door threshold
Barrier Severity:	1 Necessary Cost Est \$275.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 63G
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Modern and Ballet Dance Studio 118
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Electrical Switches - Forward Reach Obstructed (10"-25")
Code References:	2010 ADAS 308.2.2
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Light switch control box top edge over an 10" to 25" obstruction max. 34" high located above 44"
Findings:	45" high and 26-1/2" deep over an obstruction
Rec. Solution:	Relocate control or mechanism to max. 44" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 63H
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Modern and Ballet Dance Studio 118
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Actuator or Control - Height
Code References:	2010 ADAS 305.3
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Control or mechanism not at max. 48" high for side reach
Findings:	Soap dispenser 55-1/4" high
Rec. Solution:	Relocate control or mechanism to max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 63I
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Modern and Ballet Dance Studio 118
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Counters and Tables
Barrier Type:	Table - Knee Clearance
Code References:	2010 ADAS 305.3
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Knee clearance not min. 27" high, 19" deep or 30" wide
Findings:	No knee clearance
Rec. Solution:	Provide min. 1 accessible table
Barrier Severity:	3 Hindrance Cost Est \$450.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 63J
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Modern and Ballet Dance Studio 118
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Corridors
Barrier Type:	Bench - Seat Height
Code References:	2010 ADAS 903.5
	<u> </u>
Performance Sta	andard: No Quantity: EACH As-built : 1
Performance Sta Barrier Description:	Bench seat 17" to 19" above ground
Barrier	
Barrier Description:	Bench seat 17" to 19" above ground
Barrier Description: Findings:	Bench seat 17" to 19" above ground  21" high  Provide min. one accessible bench
Barrier Description: Findings: Rec. Solution:	Bench seat 17" to 19" above ground  21" high  Provide min. one accessible bench  3 Hindrance Cost Est \$1,100.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 63K
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Modern and Ballet Dance Studio 118
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Coat Hook - Height
Code References:	2010 ADAS 603.4
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Clothing hooks not max. 48" high AFF
Findings:	Hangers at 58" high
Rec. Solution:	Provide additional hook
Barrier Severity:	2 Recommended Cost Est \$125.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 63L
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Modern and Ballet Dance Studio 118
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Electrical Outlets - Hi/Low Reach
Code References:	2010 ADAS 308.2.2
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Use of outlet involves low reach of less than 15" above floor or more than 48" high
Findings:	11" high on stage, power strips laying on ground throughout room
Rec. Solution:	Relocate outlet to area at min. 15" or max. 48" high
Rec. Solution: Barrier Severity:	
	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 63M
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Modern and Ballet Dance Studio 118
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Type:	Handrail - Both Sides
Code References:	2010 ADAS 505.10.2
Performance Sta	ndard: No Quantity: LF As-built : 12
Barrier Description:	No handrail provided at both sides of stairway
Findings:	No handrail provided at both sides
Rec. Solution:	Provide handrails at both sides of stairway
Barrier Severity:	2 Recommended Cost Est \$2,700.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 63N
Field Date: Bldg Name:	2/24/2014   Report Date   2/27/2014   Barrier #:   63N     Women's Building   Reference Dwg:   5 of 6
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Bldg Name: Location:	Women's Building Reference Dwg: 5 of 6 Floor 1 - Modern and Ballet Dance Studio 118
Bldg Name: Location: X Coordinate:	Women's Building  Reference Dwg: 5 of 6  Floor 1 - Modern and Ballet Dance Studio 118  N/A  Y Coordinate: N/A  Stairways  Contrasting Color - ADA
Bldg Name: Location: X Coordinate: Barrier Area:	Women's Building Reference Dwg: 5 of 6  Floor 1 - Modern and Ballet Dance Studio 118  N/A Y Coordinate: N/A  Stairways
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code	Women's Building Reference Dwg: 5 of 6  Floor 1 - Modern and Ballet Dance Studio 118  N/A Y Coordinate: N/A  Stairways  Contrasting Color - ADA  2010 ADAS Advisory 504.4
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Women's Building Reference Dwg: 5 of 6  Floor 1 - Modern and Ballet Dance Studio 118  N/A Y Coordinate: N/A  Stairways  Contrasting Color - ADA  2010 ADAS Advisory 504.4
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Women's Building Reference Dwg: 5 of 6  Floor 1 - Modern and Ballet Dance Studio 118  N/A Y Coordinate: N/A  Stairways  Contrasting Color - ADA  2010 ADAS Advisory 504.4  Indard: Yes Quantity: LF or TR As-built: 18
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Women's Building Reference Dwg: 5 of 6  Floor 1 - Modern and Ballet Dance Studio 118  N/A Y Coordinate: N/A  Stairways  Contrasting Color - ADA  2010 ADAS Advisory 504.4  Indard: Yes Quantity: LF or TR As-built: 18  No contrasting color on each tread of interior stairway
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Women's Building  Reference Dwg: 5 of 6  Floor 1 - Modern and Ballet Dance Studio 118  N/A  Y Coordinate: N/A  Stairways  Contrasting Color - ADA  2010 ADAS Advisory 504.4  Indard: Yes Quantity: LF or TR As-built: 18  No contrasting color on each tread of interior stairway  Treads lack contrasting color defined as 70% contrast  Recommended: Consider providing contrasting color on each tread
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Women's Building Reference Dwg: 5 of 6  Floor 1 - Modern and Ballet Dance Studio 118  N/A Y Coordinate: N/A  Stairways  Contrasting Color - ADA  2010 ADAS Advisory 504.4  Indard: Yes Quantity: LF or TR As-built: 18  No contrasting color on each tread of interior stairway  Treads lack contrasting color defined as 70% contrast  Recommended: Consider providing contrasting color on each tread  2 Recommended Cost Est \$630.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 630
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Modern and Ballet Dance Studio 118
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Type:	Surface Condition - Existing
Code References:	2010 ADAS 504.4
Performance Sta	ndard: No Quantity: SF As-built : 0
Barrier Description:	Stairway surface is not slip resistant
Findings:	Slip resistant surface could not be verified
Rec. Solution:	Provide slip-resistant surface when remodeling
Barrier Severity:	4 Low Severity Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 63P
Field Date: Bldg Name:	2/24/2014 Report Date 2/27/2014 Barrier #: 63P Women's Building Reference Dwg: 5 of 6
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Bldg Name: Location:	Women's Building Reference Dwg: 5 of 6 Floor 1 - Modern and Ballet Dance Studio 118
Bldg Name: Location: X Coordinate:	Women's Building  Reference Dwg: 5 of 6  Floor 1 - Modern and Ballet Dance Studio 118  N/A  Y Coordinate: N/A  Classrooms  Shelves or Cabinets
Bldg Name: Location: X Coordinate: Barrier Area:	Women's Building Reference Dwg: 5 of 6  Floor 1 - Modern and Ballet Dance Studio 118  N/A Y Coordinate: N/A  Classrooms
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code	Women's Building Reference Dwg: 5 of 6  Floor 1 - Modern and Ballet Dance Studio 118  N/A Y Coordinate: N/A  Classrooms  Shelves or Cabinets  2010 ADAS 603.4
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Women's Building Reference Dwg: 5 of 6  Floor 1 - Modern and Ballet Dance Studio 118  N/A Y Coordinate: N/A  Classrooms  Shelves or Cabinets  2010 ADAS 603.4
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Women's Building Reference Dwg: 5 of 6  Floor 1 - Modern and Ballet Dance Studio 118  N/A Y Coordinate: N/A  Classrooms  Shelves or Cabinets  2010 ADAS 603.4  Indard: No Quantity: EACH As-built: 1
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Women's Building  Reference Dwg: 5 of 6  Floor 1 - Modern and Ballet Dance Studio 118  N/A  Y Coordinate: N/A  Classrooms  Shelves or Cabinets  2010 ADAS 603.4  Indard: No Quantity: EACH As-built: 1  Shelf or cabinet not mounted between 40" and 48" above floor or ground
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Women's Building  Reference Dwg: 5 of 6  Floor 1 - Modern and Ballet Dance Studio 118  N/A  Y Coordinate: N/A  Classrooms  Shelves or Cabinets  2010 ADAS 603.4  Indard: No Quantity: EACH As-built: 1  Shelf or cabinet not mounted between 40" and 48" above floor or ground  Shelf or cabinet not accessible  Provide additional shelf at accessible height or provide assistance
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Women's Building  Reference Dwg: 5 of 6  Floor 1 - Modern and Ballet Dance Studio 118  N/A  Y Coordinate: N/A  Classrooms  Shelves or Cabinets  2010 ADAS 603.4  Indard: No Quantity: EACH As-built: 1  Shelf or cabinet not mounted between 40" and 48" above floor or ground  Shelf or cabinet not accessible  Provide additional shelf at accessible height or provide assistance  2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 63Q
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Modern and Ballet Dance Studio 118
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Alarms
Barrier Type:	Horn/Strobe - Common Use Area
Code References:	2010 ADAS 702.1
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	No horn/strobes in common use areas
Findings:	No device provided
Rec. Solution:	Provide strobe in common use area
Barrier Severity:	1 Necessary Cost Est \$5,500.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Papert Data 2/27/2014 Parrier #: C44
ו וכוט שמנב.	2/24/2014 Report Date 2/27/2014 Barrier #: 64A
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Bldg Name: Location:	Women's Building Reference Dwg: 5 of 6 Floor 1 - Corridor H103
Bldg Name: Location: X Coordinate:	Women's Building Reference Dwg: 5 of 6  Floor 1 - Corridor H103  N/A Y Coordinate: N/A  Signage  Evacuation Plan
Bldg Name: Location: X Coordinate: Barrier Area:	Women's Building Reference Dwg: 5 of 6  Floor 1 - Corridor H103  N/A Y Coordinate: N/A  Signage
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code	Women's Building Reference Dwg: 5 of 6  Floor 1 - Corridor H103  N/A Y Coordinate: N/A  Signage  Evacuation Plan  Performance Standard
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Women's Building Reference Dwg: 5 of 6  Floor 1 - Corridor H103  N/A Y Coordinate: N/A  Signage  Evacuation Plan  Performance Standard
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Women's Building Reference Dwg: 5 of 6  Floor 1 - Corridor H103  N/A Y Coordinate: N/A  Signage  Evacuation Plan  Performance Standard  andard: Yes Quantity: EACH As-built: 1
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Women's Building   Reference Dwg:   5 of 6
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Women's Building Reference Dwg: 5 of 6 Floor 1 - Corridor H103 N/A Y Coordinate: N/A Signage Evacuation Plan Performance Standard  andard: Yes Quantity: EACH As-built: 1 No evacuation plan provided  Accessible sign not provided  Provide evacuation sign usable by the visually impaired
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Women's Building Reference Dwg: 5 of 6  Floor 1 - Corridor H103  N/A Y Coordinate: N/A  Signage  Evacuation Plan  Performance Standard  andard: Yes Quantity: EACH As-built: 1  No evacuation plan provided  Accessible sign not provided  Provide evacuation sign usable by the visually impaired  2 Recommended Cost Est \$250.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 64B
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Corridor H103
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	Lobby Info Sign
Code References:	Performance Standard
Performance Sta	ndard: Yes Quantity: EACH As-built : 1
Barrier Description:	No lobby informational sign with location of accessible elements
Findings:	Accessible sign not provided
Rec. Solution:	Provide lobby informational sign
Barrier Severity:	1 Necessary Cost Est \$250.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 64C
Field Date: Bldg Name:	2/24/2014   Report Date   2/27/2014   Barrier #:   64C
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Bldg Name: Location:	Women's Building Reference Dwg: 5 of 6 Floor 1 - Corridor H103
Bldg Name: Location: X Coordinate:	Women's Building  Reference Dwg: 5 of 6  Floor 1 - Corridor H103  N/A  Y Coordinate: N/A  Signage  Tactile Exit Signs - Passage
Bldg Name: Location: X Coordinate: Barrier Area:	Women's Building Reference Dwg: 5 of 6  Floor 1 - Corridor H103  N/A Y Coordinate: N/A  Signage
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code	Women's Building  Reference Dwg: 5 of 6  Floor 1 - Corridor H103  N/A  Y Coordinate: N/A  Signage  Tactile Exit Signs - Passage  Performance Standard
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Women's Building  Reference Dwg: 5 of 6  Floor 1 - Corridor H103  N/A  Y Coordinate: N/A  Signage  Tactile Exit Signs - Passage  Performance Standard
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Women's Building  Reference Dwg: 5 of 6  Floor 1 - Corridor H103  N/A  Y Coordinate: N/A  Signage  Tactile Exit Signs - Passage  Performance Standard  Indard: Yes Quantity: EACH As-built: 1
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Women's Building  Reference Dwg: 5 of 6  Floor 1 - Corridor H103  N/A  Y Coordinate: N/A  Signage  Tactile Exit Signs - Passage  Performance Standard  andard: Yes Quantity: EACH As-built: 1  Exit thru an exit enclosure/exit passageway lacks tactile exit sign
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Women's Building  Reference Dwg: 5 of 6  Floor 1 - Corridor H103  N/A  Y Coordinate: N/A  Signage  Tactile Exit Signs - Passage  Performance Standard  mdard: Yes Quantity: EACH As-built: 1  Exit thru an exit enclosure/exit passageway lacks tactile exit sign  Passageway to exterior exit with low level illuminated sign lacks tactile exit sign  Provide sign stating "EXIT ROUTE" at exit side of door
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Women's Building Reference Dwg: 5 of 6  Floor 1 - Corridor H103  N/A Y Coordinate: N/A  Signage  Tactile Exit Signs - Passage  Performance Standard  Indard: Yes Quantity: EACH As-built: 1  Exit thru an exit enclosure/exit passageway lacks tactile exit sign  Passageway to exterior exit with low level illuminated sign lacks tactile exit sign  Provide sign stating "EXIT ROUTE" at exit side of door  2 Recommended Cost Est \$250.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 64D
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Corridor H103
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Alarms
Barrier Type:	Horn/Strobe
Code References:	2010 ADAS 702.1
Performance Sta	indard: No Quantity: EACH As-built : 1
Barrier Description:	No horn/strobes in corridor
Findings:	No device provided
Rec. Solution:	Provide strobes in common use area
Barrier Severity:	1 Necessary Cost Est \$5,500.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 65A
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Women's Bathroom 116A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	Braille - Distance from Characters
Code References:	2010 ADAS 703.3
Performance Sta	indard: No Quantity: EACH As-built : 1
Performance Sta Barrier Description:	Braille not 3/8" and max. 1/2" directly below the tactile characters
Barrier	
Barrier Description:	Braille not 3/8" and max. 1/2" directly below the tactile characters
Barrier Description: Findings:	Braille not 3/8" and max. 1/2" directly below the tactile characters  Braille 1/4" below tactile characters  Provide accessible sign
Barrier Description: Findings: Rec. Solution:	Braille not 3/8" and max. 1/2" directly below the tactile characters  Braille 1/4" below tactile characters  Provide accessible sign  1 Necessary Cost Est \$250.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 65B
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Women's Restroom 116A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Door Closer - Interior
Code References:	2010 ADAS 404.2.9
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Door opening force exceeds 5 lbf
Findings:	6 lbf
Rec. Solution:	Provide automatic door opening device
Barrier Severity:	1 Necessary Cost Est \$5,000.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 65C
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Women's Restroom 116A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Door Closer - Sweep Period
Code References:	2010 ADAS 404.2.8.1
Performance Sta	ndard: No Quantity: EACH As-built : 0
Barrier Description:	Door closer lacks min. 5 second sweep period
Findings:	4 second sweep
Rec. Solution:	Provide automatic door opening device
Barrier Severity:	2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 65D
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Women's Restroom 116A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Hardware - Operation
Code References:	2010 ADAS 404.2.7
Performance Sta	ndard: No Quantity: EACH As-built : 0
Barrier Description:	Hardware not operable with a closed fist
Findings:	Hardware not operable with a closed fist
Rec. Solution:	Provide automatic door opening device
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 65E
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Women's Restroom 116A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Vision Lights - Existing
Code References:	2010 ADAS 404.2.11
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	View panels in or adjacent to doors or gates not max. 43" above floor or ground
Findings:	View panel located higher than 43" above the floor
Rec. Solution:	Replace door/gate or vision panel
Rec. Solution: Barrier Severity:	
	3 Hindrance Cost Est \$2,250.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 65F
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Women's Restroom 116A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Clear Width
Code References:	2010 ADAS 404.2.3
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Door, sliding/folding door or gate clear width is not min. 32"
Findings:	29" clear width
Rec. Solution:	Replace door or gate and frame
Barrier Severity:	1 Necessary Cost Est \$2,250.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 65G
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Women's Restroom 116A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Front App/pull 18" SEC - Blocked
Code References:	2010 ADAS Figure 404.2.4.1
Performance Sta	andard: No Quantity: ADMINI As-built : 0
Barrier Description:	Door/Gate at pull side with min. 60" lacks min. 18" strike edge clearance at pull side
Findings:	13-1/2" strike edge clearance to trash bin
Rec. Solution:	Move trash bin
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	
Notes:	· •



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 65H
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Women's Restroom 116A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Protruding Object - Wall-mounted
Code References:	2010 ADAS 307.2
Performance Sta	indard: No Quantity: JOB As-built : 2
Barrier Description:	Object protrudes more than 4" into circulation path
Findings:	Shelf and paper towel dispenser protrudes 48-1/2" - 65-3/4" high
Rec. Solution:	Remove objects or provide detectable warning for the visually impaired
Barrier Severity:	1 Necessary Cost Est \$1,100.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 65I
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Women's Restroom 116A
Location: X Coordinate:	Floor 1 - Women's Restroom 116A  N/A  Y Coordinate: N/A
X Coordinate:	N/A Y Coordinate: N/A
X Coordinate: Barrier Area:	N/A Y Coordinate: N/A  Restrooms  Shelves
X Coordinate: Barrier Area: Barrier Type: Code	N/A Y Coordinate: N/A  Restrooms  Shelves  2010 ADAS 603.4
X Coordinate: Barrier Area: Barrier Type: Code References:	N/A Y Coordinate: N/A  Restrooms  Shelves 2010 ADAS 603.4
X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	N/A Y Coordinate: N/A  Restrooms  Shelves  2010 ADAS 603.4  Indard: No Quantity: EACH As-built: 1
X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	N/A Y Coordinate: N/A  Restrooms  Shelves  2010 ADAS 603.4  Indard: No Quantity: EACH As-built: 1  Shelf provided not mounted between 40" and 48" above floor or ground
X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	N/A  Restrooms  Shelves  2010 ADAS 603.4  Indard: No Quantity: EACH As-built: 1  Shelf provided not mounted between 40" and 48" above floor or ground  Shelf at 65-3/4" high  Provide additional shelf at accessible height
X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Restrooms Shelves 2010 ADAS 603.4  Indard: No Quantity: EACH As-built: 1  Shelf provided not mounted between 40" and 48" above floor or ground  Shelf at 65-3/4" high  Provide additional shelf at accessible height  2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 65J
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Women's Restroom 116A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Protruding Hazard
Code References:	2010 ADAS 307.2
Performance Sta	ndard: No Quantity: JOB As-built : 1
Barrier Description:	Object protrudes more than 4" into pedestrian way
Findings:	Feminine product dispenser protrudes 6-1/2" at 38-3/4" high
Rec. Solution:	Relocate protruding elements out of pedestrian way or provide cane-detectable warning
Barrier Severity:	1 Necessary Cost Est \$550.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 65K
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Women's Restroom 116A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Dispensers - Sanitary Products
Code References:	2010 ADAS 603.3
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Feminine product dispenser not usable with a closed fist
Findings:	Dispenser not fist operable
Rec. Solution:	Replace dispenser
Barrier Severity:	1 Necessary Cost Est \$650.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 65L
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Women's Restroom 116A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Coat Hook
Code References:	2010 ADAS 603.4
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Clothing hooks not max. 48" high AFF
Findings:	62" high
Rec. Solution:	Provide additional hook
Barrier Severity:	2 Recommended Cost Est \$125.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes: 4 coat h	ooks Two in water closets; two adjacent to lavatory
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 65M
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Women's Restroom 116A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Lavatory - Knee Cl
Code References:	2010 ADAS 606.3
Performance Sta	ndard: No Quantity: JOB As-built : 1
Barrier Description:	Lavatory rim or counter edge is higher than 34" AFF
Findings:	35-1/4" high
Rec. Solution:	Replace lavatory
Rec. Solution: Barrier Severity:	
	1 Necessary Cost Est \$450.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 65N
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Women's Restroom 116A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Lavatory - Knee Clearance
Code References:	2010 ADAS 606.2 & 306
Performance Sta	indard: No Quantity: JOB As-built : 0
Barrier Description:	Lavatory bottom apron/edge not max 29" reducing to 27" at 8" back from edge
Findings:	No accessible knee clearance at pedestal lavatory
Rec. Solution:	Replace lavatory
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 650
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Women's Restroom 116A
Location:	Floor 1 - Women's Restroom 116A
Location: X Coordinate:	Floor 1 - Women's Restroom 116A  N/A  Y Coordinate: N/A
Location: X Coordinate: Barrier Area:	Floor 1 - Women's Restroom 116A  N/A  Y Coordinate: N/A  Restrooms
Location: X Coordinate: Barrier Area: Barrier Type: Code	Floor 1 - Women's Restroom 116A  N/A  Y Coordinate: N/A  Restrooms  Stall Door Closer  2010 ADAS 604.8.1.2
Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Floor 1 - Women's Restroom 116A  N/A  Y Coordinate: N/A  Restrooms  Stall Door Closer  2010 ADAS 604.8.1.2
Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Floor 1 - Women's Restroom 116A  N/A  Y Coordinate: N/A  Restrooms  Stall Door Closer  2010 ADAS 604.8.1.2  Indard: No Quantity: JOB As-built: 1
Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Floor 1 - Women's Restroom 116A  N/A  Y Coordinate: N/A  Restrooms  Stall Door Closer  2010 ADAS 604.8.1.2  Indard: No Quantity: JOB As-built: 1  Stall door not equipped with an automatic closing device
Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Floor 1 - Women's Restroom 116A  N/A  Y Coordinate: N/A  Restrooms  Stall Door Closer  2010 ADAS 604.8.1.2  Indard: No Quantity: JOB As-built: 1  Stall door not equipped with an automatic closing device  Door does not self-close  Replace compartment hinge with adjustible mechanism
Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Floor 1 - Women's Restroom 116A  N/A  Y Coordinate: N/A  Restrooms  Stall Door Closer  2010 ADAS 604.8.1.2  Indard: No Quantity: JOB As-built: 1  Stall door not equipped with an automatic closing device  Door does not self-close  Replace compartment hinge with adjustible mechanism  2 Recommended Cost Est \$1,650.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 65P
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Women's Restroom 116A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Toilet Stall - Door Hardware
Code References:	2010 ADAS 604.8.1.2
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Inside of compartment door lacks a loop or U-pull below latch
Findings:	No U-pull provided
Rec. Solution:	Provide accessible hardware
Barrier Severity:	1 Necessary Cost Est \$75.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 65Q
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Women's Restroom 116A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Toilet Stall - Door Hardware
Code References:	2010 ADAS 604.8.1.2
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Compartment door hardware involves user to grasp or twist to operate
Findings:	Hardware not operable with a closed fist
Rec. Solution:	Provide accessible hardware
Barrier Severity:	1 Necessary Cost Est \$300.00 Facility Function: Public Status: Open
Implementation	
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 65R
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Women's Restroom 116A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Stall Entry - Front App/pull 18" SEC
Code References:	2010 ADAS Figure 404.2.4.1
Performance Sta	andard: No Quantity: SF As-built: 120
Barrier Description:	Stall door at pull side lacks min. 18" strike edge clearance
Findings:	5-1/2" strike edge clearance
Rec. Solution:	Redesign toilet room to provide maneuvering clearance
Barrier Severity:	1 Necessary Cost Est \$66,000.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes: To exit s	stall
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 65S
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Women's Restroom 116A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Toilet Transfer - Floor-mounted
Code References:	2010 ADAS 604.8.1.1
Performance Sta	andard: No Quantity: SF As-built : 0
Barrier Description:	Min. 60" wide x 59" deep clear floor space not provided at floor-mounted fixture
•	<u> </u>
Findings:	24" wall-to-wall and 34" from door-to-toilet
·	24" wall-to-wall and 34" from door-to-toilet  Remodel to provide front transfer space
Findings:	Remodel to provide front transfer space
Findings: Rec. Solution:	Remodel to provide front transfer space  2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 65T
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Women's Restroom 116A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Toilet - Grab Bars
Code References:	2010 ADAS 604.5
Performance Sta	andard: No Quantity: JOB As-built : 1
Barrier Description:	No grab bars provided at water closet
Findings:	No grab bars provided
Rec. Solution:	Provide side and rear grab bars with reinforcement
Barrier Severity:	1 Necessary Cost Est \$900.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 65U
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Bldg Name: Location:	Women's Building Reference Dwg: 5 of 6 Floor 1 - Women's Restroom 116A
Location:	Floor 1 - Women's Restroom 116A
Location: X Coordinate:	Floor 1 - Women's Restroom 116A  N/A  Y Coordinate: N/A
Location: X Coordinate: Barrier Area:	Floor 1 - Women's Restroom 116A  N/A  Y Coordinate: N/A  Restrooms  Dispensers
Location: X Coordinate: Barrier Area: Barrier Type: Code	Floor 1 - Women's Restroom 116A  N/A  Restrooms  Dispensers  2010 ADAS 307.2
Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Floor 1 - Women's Restroom 116A  N/A  Restrooms  Dispensers  2010 ADAS 307.2
Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Floor 1 - Women's Restroom 116A  N/A  Restrooms  Dispensers  2010 ADAS 307.2  andard: No Quantity: EACH As-built: 1
Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Floor 1 - Women's Restroom 116A  N/A  Restrooms  Dispensers  2010 ADAS 307.2  Indard: No Quantity: EACH As-built: 1  Dispenser control point or operating mechanism not max. 48" AFF
Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Floor 1 - Women's Restroom 116A  N/A  Y Coordinate: N/A  Restrooms  Dispensers  2010 ADAS 307.2  andard: No Quantity: EACH As-built: 1  Dispenser control point or operating mechanism not max. 48" AFF  62-1/2" high  Remount no higher than 48" above floor
Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Floor 1 - Women's Restroom 116A  N/A  Y Coordinate: N/A  Restrooms  Dispensers  2010 ADAS 307.2  Indiard: No Quantity: EACH As-built: 1  Dispenser control point or operating mechanism not max. 48" AFF  62-1/2" high  Remount no higher than 48" above floor  2 Recommended Cost Est \$125.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 65V
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Women's Restroom 116A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Restrooms
Barrier Type:	Alarm - Horn/Strobe
Code References:	2010 ADAS 702.1
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Where a fire alarm is installed, no horn/strobe provided
Findings:	No device provided
Rec. Solution:	Provide horn/strobe in common use area
Barrier Severity:	1 Necessary Cost Est \$5,500.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 66A
Field Date: Bldg Name:	2/24/2014   Report Date   2/27/2014   Barrier #:
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Bldg Name: Location:	Women's Building Reference Dwg: 5 of 6 Floor 1 - Corridor H112
Bldg Name: Location: X Coordinate:	Women's Building  Reference Dwg: 5 of 6  Floor 1 - Corridor H112  N/A  Y Coordinate: N/A  Ramps  Running Slope - Existing (>9.5% or more)
Bldg Name: Location: X Coordinate: Barrier Area:	Women's Building Reference Dwg: 5 of 6  Floor 1 - Corridor H112  N/A Y Coordinate: N/A  Ramps
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code	Women's Building Reference Dwg: 5 of 6  Floor 1 - Corridor H112  N/A Y Coordinate: N/A  Ramps  Running Slope - Existing (>9.5% or more)  2010 ADAS 405.3
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Women's Building Reference Dwg: 5 of 6  Floor 1 - Corridor H112  N/A Y Coordinate: N/A  Ramps  Running Slope - Existing (>9.5% or more)  2010 ADAS 405.3
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Women's Building Reference Dwg: 5 of 6  Floor 1 - Corridor H112  N/A Y Coordinate: N/A  Ramps  Running Slope - Existing (>9.5% or more)  2010 ADAS 405.3  Indard: No Quantity: LF As-built: 1
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Women's Building  Reference Dwg: 5 of 6  Floor 1 - Corridor H112  N/A  Y Coordinate: N/A  Ramps  Running Slope - Existing (>9.5% or more)  2010 ADAS 405.3  Indard: No Quantity: LF As-built: 1  Running slope exceeds 8.33% (>9.5% or more)
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Women's Building  Reference Dwg: 5 of 6  Floor 1 - Corridor H112  N/A  Y Coordinate: N/A  Ramps  Running Slope - Existing (>9.5% or more)  2010 ADAS 405.3  mdard: No Quantity: LF As-built: 1  Running slope exceeds 8.33% (>9.5% or more)  15.7% running slope  Provide ISA directional sign with route to and location of elevator
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Women's Building  Reference Dwg: 5 of 6  Floor 1 - Corridor H112  N/A  Y Coordinate: N/A  Ramps  Running Slope - Existing (>9.5% or more)  2010 ADAS 405.3  Indard: No Quantity: LF As-built: 1  Running slope exceeds 8.33% (>9.5% or more)  15.7% running slope  Provide ISA directional sign with route to and location of elevator  1 Necessary Cost Est \$200.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 66B
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Corridor H112
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Ramps
Barrier Type:	Handrail 03/03/20019 14:18
Code References:	2010 ADAS 505.2
Performance Sta	ndard: No Quantity: LF As-built : 0
Barrier Description:	No handrail provided at both sides
Findings:	Ramp lacks handrail at both sides
Rec. Solution:	Provide ISA directional sign with location of and route to elevator
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: No remo	ediation recommended. Ramp is not an accessible route
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 66C
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	
	Floor 1 - Corridor H112
X Coordinate:	
X Coordinate: Barrier Area:	Floor 1 - Corridor H112
	Floor 1 - Corridor H112  N/A  Y Coordinate: N/A  Alarms  Horn/Strobe - Common Use Area
Barrier Area:	Floor 1 - Corridor H112  N/A  Y Coordinate: N/A  Alarms
Barrier Area: Barrier Type: Code	Floor 1 - Corridor H112  N/A  Y Coordinate: N/A  Alarms  Horn/Strobe - Common Use Area  2010 ADAS 702.1
Barrier Area: Barrier Type: Code References:	Floor 1 - Corridor H112  N/A  Y Coordinate: N/A  Alarms  Horn/Strobe - Common Use Area  2010 ADAS 702.1
Barrier Area: Barrier Type: Code References: Performance Sta Barrier	Floor 1 - Corridor H112  N/A  Y Coordinate: N/A  Alarms  Horn/Strobe - Common Use Area  2010 ADAS 702.1  Indard: No Quantity: EACH As-built: 1
Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Floor 1 - Corridor H112  N/A  Y Coordinate: N/A  Alarms  Horn/Strobe - Common Use Area  2010 ADAS 702.1  Indard: No Quantity: EACH As-built: 1  No horn/strobes in common use areas
Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Floor 1 - Corridor H112  N/A  Y Coordinate: N/A  Alarms  Horn/Strobe - Common Use Area  2010 ADAS 702.1  Indard: No Quantity: EACH As-built: 1  No horn/strobes in common use areas  No device provided  Provide strobe in common use area
Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Floor 1 - Corridor H112  N/A  Y Coordinate: N/A  Alarms  Horn/Strobe - Common Use Area  2010 ADAS 702.1  mdard: No Quantity: EACH As-built: 1  No horn/strobes in common use areas  No device provided  Provide strobe in common use area  1 Necessary Cost Est \$5,500.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 67A
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Social Dance Studio 116
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	Permanent Room/Space - Tactile Characters
Code References:	2010 ADAS 216.2
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	At interior or exterior location, no tactile characters at sign identifying permanent rooms and spaces
Findings:	No tactile signage provided at door within public route
Rec. Solution:	Provide accessible sign
Barrier Severity:	1 Necessary Cost Est \$250.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 67B
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Social Dance Studio 116
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Door Closer - Interior
Code References:	2010 ADAS 404.2.9
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Door opening force exceeds 5 lbf
Findings:	10 lbf
Rec. Solution:	Provide automatic door opening device
Barrier Severity:	
Implementation	
Notes: Double	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 67C
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Social Dance Studio 116
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Door Closer - Sweep Period
Code References:	2010 ADAS 404.2.8.1
Performance Sta	andard: No Quantity: EACH As-built : 0
Barrier Description:	Door closer lacks min. 5 second sweep period
Findings:	3-4 second sweep
Rec. Solution:	Provide automatic door opening device
Barrier Severity:	2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 67D
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Social Dance Studio 116
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Vision Lights - Existing
Code References:	2010 ADAS 404.2.11
Performance Sta	andard: No Quantity: EACH As-built : 2
Barrier Description:	View panels in or adjacent to doors or gates not max. 43" above floor or ground
Findings:	View panels located higher than 43" above the floor
Rec. Solution:	Replace doors/gates or vision panels
Rec. Solution: Barrier Severity:	
	3 Hindrance Cost Est \$4,500.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 67E
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Social Dance Studio 116
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Door 10" Bottom Surface - Door Hardware
Code References:	2010 ADAS 404.2.10
Performance Sta	indard: No Quantity: EACH As-built : 1
Barrier Description:	Door stop interrupts min.10" smooth bottom surface
Findings:	Door hardware extends into bottom 10" of door
Rec. Solution:	Remove door stop or any other element within bottom 10" of door
Barrier Severity:	1 Necessary Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 67F
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Social Dance Studio 116
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Doormat 03/03/2014 14-33
Code References:	2010 ADAS 302.2 & Advisory 302.2
Performance Sta	andard: No Quantity: EACH As-built : 2
Barrier Description:	Doormat not anchored to floor (possible trip hazard)
Findings:	Doormats not secured
Rec. Solution:	Secure exiting doormats or replace
Barrier Severity:	1 Necessary Cost Est \$1,000.00 Facility Function: Public Status: Open
Implementation	
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 67H
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Social Dance Studio 116
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Corridors
Barrier Type:	Bench - Seat Height/Depth
Code References:	2010 ADAS 903.3
Performance Sta	ndard: No Quantity: EACH As-built: 1
Barrier Description:	Bench seat not 20" to 24" deep and height not 17" to 19" above ground
Findings:	11-3/4"-14-1/2" high and 9"-9-1/4" deep
Rec. Solution:	Provide min. one accessible bench in corridor
Barrier Severity:	3 Hindrance Cost Est \$1,100.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: 6 bench	es
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 67K
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Social Dance Studio 116
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Actuator or Control - Height
Code References:	2010 ADAS 305.3
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Control or mechanism not at max. 48" high for side reach
Findings:	Soap dispenser 50-1/2" high
Rec. Solution:	Relocate control or mechanism to max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 67M
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Social Dance Studio 116
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Clear Floor Space
Barrier Type:	Protruding Object
Code References:	2010 ADAS 307
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Protruding object in circulation path protrudes more than 4" between 27" and 80" high
Findings:	Television protrudes 5" at 44-1/2" high
Rec. Solution:	Remove object or provide detectable warning for the visually impaired
Barrier Severity:	1 Necessary Cost Est \$550.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 67N
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Social Dance Studio 116
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Clear Floor Space
Barrier Type:	Protruding Object
Code References:	2010 ADAS 307
Performance Sta	andard: No Quantity: EACH As-built: 1
Barrier Description:	Protruding object in circulation path protrudes more than 4" between 27" and 80" high
Findings:	VCR Shelf protrudes 12-1/4" at 46" high
Rec. Solution:	
	Remove object or provide detectable warning for the visually impaired
Barrier Severity:	
Barrier Severity: Implementation	1 Necessary Cost Est \$550.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 670
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Social Dance Studio 116
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Lockers - Accessible Route
Code References:	2010 ADAS 803.2
Performance Sta	ndard: No Quantity: SF As-built : 0
Barrier Description:	Path of travel to lockers not at least 36" wide
Findings:	Path blocked by chalkboard and buckets
Rec. Solution:	Relocate lockers or dressing area
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 67P
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Social Dance Studio 116
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Lockers - Control
Code References:	2010 ADAS 803.5
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Locker mechanism not operable with fist or involves turning and grasping
Findings:	Mechanism not fist operable
Rec. Solution:	Provide min. 1 accessible locker or 5% overall
Barrier Severity:	1 Necessary Cost Est \$450.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: None of	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 67Q
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Social Dance Studio 116
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Lockers - Maneuvering Clearance
Code References:	2010 ADAS 803.2
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	No 60" maneuvering clearance provided at locker or bench
Findings:	60" maneuvering clearance not provided at any of the lockers
Rec. Solution:	Provide accessible bench at accessble locker
Barrier Severity:	2 Recommended Cost Est \$650.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 67R
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Social Dance Studio 116
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Counters and Tables
Barrier Type:	Table - Knee Clearance
Code References:	2010 ADAS 305.3
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Knee clearance not min. 27" high, 19" deep or 30" wide
Findings:	24" knee clearance
Rec. Solution:	Provide min. 1 accessible table
Barrier Severity:	3 Hindrance Cost Est \$450.00 Facility Function: Public Status: Open
Implementation	· · · · · · · · _
Notes: Table ag	gainst far wall



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 67S
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Social Dance Studio 116
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Shelves or Cabinets
Code References:	2010 ADAS 305.3
Performance Sta	ndard: No Quantity: JOB As-built : 1
Barrier Description:	Shelf or cabinet not mounted max. 48" above floor or ground
Findings:	Shelf or cabinet not accessible
Rec. Solution:	Provide additional shelf at accessible height or provide assistance
Barrier Severity:	3 Hindrance Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: Blue She	elf against far wall
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 67T
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Social Dance Studio 116
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Coat Hook - Height
Code References:	2010 ADAS 603.4
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Clothing hooks not max. 48" high AFF
Findings:	55-1/2"-59" high
Rec. Solution:	Provide additional hook
Barrier Severity:	2 Recommended Cost Est \$125.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 67U
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Social Dance Studio 116
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Electrical Switches - Height
Code References:	2010 ADAS 308.2.1
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Light switch control box top edge not at max. 48" high
Findings:	52" high
Rec. Solution:	Relocate switch box top edge to max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 67V
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Social Dance Studio 116
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Alarms
Barrier Type:	Horn/Strobe
Code References:	2010 ADAS 702.1
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	No horn/strobes in common use areas
Findings:	No strobe provided
Rec. Solution:	Provide strobes in common use area
Barrier Severity:	
	1 Necessary Cost Est \$5,500.00 Facility Function: Public Status: Open
Implementation	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 68A
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Stairway S106
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	Permanent Room/Space - Tactile Characters
Code References:	2010 ADAS 404.2.9
Performance Sta	ndard: No Quantity: EACH As-built : 2
Barrier Description:	At interior or exterior location, no tactile characters at sign identifying permanent rooms and spaces
Findings:	No tactile signage provided at door within public route
Rec. Solution:	Provide accessible sign
Barrier Severity:	1 Necessary Cost Est \$500.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 68B
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Stairway S106
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Type:	Sign - Exit Door
Code References:	Performance Standard
Performance Sta	ndard: Yes Quantity: EACH As-built : 1
Barrier Description:	Door leading directly into an exit stairway lacks tactile exit sign
Findings:	Door to exit stair with low level illuminated sign lacks tactile exit sign
Rec. Solution:	Provide sign stating "EXIT STAIR DOWN (or UP)" at latch side of door
Barrier Severity:	2 Recommended Cost Est \$250.00 Facility Function: Public Status: Open
Implementation	
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 68C
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Stairway S106
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Door Closer - Interior Adjustment
Code References:	2010 ADAS 404.2.9
Performance Sta	andard: No Quantity: EACH As-built : 2
Barrier Description:	Door opening force exceeds 5 lbf
Findings:	10-15 lbf
Rec. Solution:	Replace or adjust existing closer
Barrier Severity:	1 Necessary Cost Est \$900.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 68D
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Stairway S106
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	
a 1	Door Closer - Sweep Period
Code References:	Door Closer - Sweep Period  2010 ADAS 404.2.8.1
	2010 ADAS 404.2.8.1
References:	2010 ADAS 404.2.8.1
References: Performance Sta Barrier	2010 ADAS 404.2.8.1  andard: No Quantity: EACH As-built: 0
References: Performance Sta Barrier Description:	2010 ADAS 404.2.8.1  andard: No Quantity: EACH As-built: 0  Door closer lacks min. 5 second sweep period
References: Performance Sta Barrier Description: Findings: Rec. Solution:	2010 ADAS 404.2.8.1  andard: No Quantity: EACH As-built: 0  Door closer lacks min. 5 second sweep period  3 - 4 second sweep
References: Performance Sta Barrier Description: Findings: Rec. Solution:	2010 ADAS 404.2.8.1  andard: No Quantity: EACH As-built: 0  Door closer lacks min. 5 second sweep period  3 - 4 second sweep  Replace or adjust existing closer  2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 68E
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Stairway S106
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Hardware - Operation
Code References:	2010 ADAS 404.2.7
Performance Sta	ndard: No Quantity: EACH As-built : 2
Barrier Description:	Hardware not operable with a closed fist
Findings:	Hardware not operable with a closed fist
Rec. Solution:	Provide new hardware
Barrier Severity:	1 Necessary Cost Est \$600.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes: For both	n entry ways
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 68F
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Stairway S106
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Vision Lights - Existing
Code References:	2010 ADAS 404.2.11
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	View panels in or adjacent to doors or gates not max. 43" above floor or ground
Findings:	View panel located higher than 43" above the floor
Rec. Solution:	Replace door/gate or vision panel
Barrier Severity:	3 Hindrance Cost Est \$2,250.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes: For nort	· · · · · · · · · · · · · · · · · · ·
	th doors. 55-1/2" high



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 68G
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Stairway S106
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Door 10" Bottom Surface - Kickplate
Code References:	2010 ADAS 404.2.10
Performance Sta	ndard: No Quantity: EACH As-built : 2
Barrier Description:	Door/Gate lacks min. 10" smooth uninterrupted bottom surface
Findings:	Bottom of door not smooth and uninterrupted
Rec. Solution:	Provide kick plate min. 10" high at push side of door
Barrier Severity:	1 Necessary Cost Est \$450.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 68H
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Stairway S106
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Threshold - Height exceeding 1/2"
Code References:	2010 ADAS 404.2.5
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Door/Gate threshold exceeds 1/2" in height
Findings:	1-3/4" high
Rec. Solution:	Provide new door threshold
Barrier Severity:	1 Necessary Cost Est \$275.00 Facility Function: Public Status: Open
Implementation	
Notes: For east	entry way



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 681
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Stairway S106
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Type:	Sign - Encl Stairway Level
Code References:	ICC A117.1
Performance Sta	indard: No Quantity: EACH As-built : 1
Barrier Description:	Tactile stairway signage not provided to indicate floor level
Findings:	No sign indicating floor level
Rec. Solution:	Provide sign
Barrier Severity:	2 Recommended Cost Est \$250.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 68J
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Stairway S106
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Electrical Switches - Height
Code References:	2010 ADAS 308.2.1
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Light switch control box top edge not at max. 48" high
Findings:	51" high and located above first step on stairway
Rec. Solution:	Relocate switch box top edge to max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	13 Hilldrance Cost Est 15750.00 Tacility Function. 1Public Status. 10pen
Implementation	Priority: 3 Implementation Phase: Implementation Date:



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 68K
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Stairway S106
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Type:	Handrail Height
Code References:	2010 ADAS 505.10.2
Performance Sta	ndard: No Quantity: LF As-built: 110
Barrier Description:	Handrail grip measured at center not 34"- 38" high
Findings:	30" handrail grip height
Rec. Solution:	Provide handrails at both sides of stairway
Barrier Severity:	2 Recommended Cost Est \$24,750.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes: Inside ra	ailing; also not firm and stable.
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 68L
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Stairway S106
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Type:	Handrail Grip
Code References:	2010 ADAS 505.7
Performance Sta	ndard: No Quantity: LF As-built : 0
Barrier Description:	Handrail grip is not 1-1/4" - 2" in diameter
Findings:	3" handrail grip diameter
Rec. Solution:	Provide handrails at both sides of stairwav
Barrier Severity:	2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes: For insid	de railing



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 68M
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Stairway S106
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Type:	Handrail Extension - Bottom
Code References:	2010 ADAS 505.10.3
Performance Sta	ndard: No Quantity: LF As-built : 0
Barrier Description:	Bottom handrail extension not sloped for length of one tread beyond the last riser nosing
Findings:	No bottom handrail extensions
Rec. Solution:	Provide handrails at both sides of stairway
Barrier Severity:	2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes: For all h	andrails
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 68N
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Stairway S106
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Type:	Handrail Extension - Top
Code References:	2010 ADAS 505.10.2
Performance Sta	ndard: No Quantity: LF As-built : 0
Barrier Description:	Top Handrail extension not parallel to ground/floor surface
Findings:	Top handrail extension not parallel to ground surface
Rec. Solution:	Provide handrails at both sides of stairway
Barrier Severity:	
	2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 680
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Stairway S106
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Type:	Surface Condition - Existing
Code References:	2010 ADAS 504.4
Performance Sta	andard: No Quantity: SF As-built: 0
Barrier Description:	Stairway surface is not slip resistant
Findings:	Slip resistant surface could not be verified
Rec. Solution:	Provide slip-resistant surface when remodeling
Barrier Severity:	4 Low Severity Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 68P
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Stairway S106
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Type:	Contrasting Color - ADA
Code References:	2010 ADAS Advisory 504.4
Performance Sta	ndard: Yes Quantity: LF or TR As-built: 1
Barrier Description:	No contrasting color on each tread of interior stairway
Findings:	Treads lack contrasting color defined as 70% contrast
Rec. Solution:	Recommended: Consider providing contrasting color on each tread
	Recommended: Consider providing contrasting color on each tread  2 Recommended Cost Est \$35.00 Facility Function: Public Status: Open
	2 Recommended Cost Est \$35.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 68Q
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 1 - Stairway S106
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Alarms
Barrier Type:	Horn/Strobe
Code References:	2010 ADAS 702.1
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	No horn/strobes in corridor
Findings:	No device provided
Rec. Solution:	Provide strobes in common use area
Barrier Severity:	1 Necessary Cost Est \$5,500.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 69A
Field Date: Bldg Name:	2/24/2014   Report Date   2/27/2014   Barrier #:   69A
	- In
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Bldg Name: Location:	Women's Building Reference Dwg: 6 of 6 Floor 2 - Stairway S201
Bldg Name: Location: X Coordinate:	Women's Building Reference Dwg: 6 of 6  Floor 2 - Stairway S201  N/A Y Coordinate: N/A  Signage  Permanent Room/Space - Tactile Characters
Bldg Name: Location: X Coordinate: Barrier Area:	Women's Building Reference Dwg: 6 of 6 Floor 2 - Stairway S201 N/A Y Coordinate: N/A Signage
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code	Women's Building Reference Dwg: 6 of 6  Floor 2 - Stairway S201  N/A Y Coordinate: N/A  Signage  Permanent Room/Space - Tactile Characters  2010 ADAS 216.2
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Women's Building Reference Dwg: 6 of 6  Floor 2 - Stairway S201  N/A Y Coordinate: N/A  Signage  Permanent Room/Space - Tactile Characters  2010 ADAS 216.2
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Women's Building Reference Dwg: 6 of 6  Floor 2 - Stairway S201  N/A Y Coordinate: N/A  Signage  Permanent Room/Space - Tactile Characters  2010 ADAS 216.2  At interior or exterior location, no tactile characters at sign identifying permanent rooms and
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Women's Building Reference Dwg: 6 of 6  Floor 2 - Stairway S201  N/A Y Coordinate: N/A  Signage  Permanent Room/Space - Tactile Characters  2010 ADAS 216.2  At interior or exterior location, no tactile characters at sign identifying permanent rooms and spaces
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Women's Building Reference Dwg: 6 of 6 Floor 2 - Stairway S201 N/A Y Coordinate: N/A Signage Permanent Room/Space - Tactile Characters 2010 ADAS 216.2  At interior or exterior location, no tactile characters at sign identifying permanent rooms and spaces  No tactile signage provided at door within public route
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Women's Building Reference Dwg: 6 of 6  Floor 2 - Stairway S201  N/A Y Coordinate: N/A  Signage  Permanent Room/Space - Tactile Characters  2010 ADAS 216.2  At interior or exterior location, no tactile characters at sign identifying permanent rooms and spaces  No tactile signage provided at door within public route  Provide accessible sign  I Necessary Cost Est \$250.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 69B
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Stairway S201
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Type:	Sign - Exit Door
Code References:	Performance Standard
Performance Sta	andard: Yes Quantity: EACH As-built : 1
Barrier Description:	Door leading directly into an exit stairway lacks tactile exit sign
Findings:	Door to exit stair with low level illuminated sign lacks tactile exit sign
Rec. Solution:	Provide sign stating "EXIT STAIR DOWN (or UP)" at latch side of door
Barrier Severity:	2 Recommended Cost Est \$250.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 69C
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Stairway S201
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Door Closer - Interior Adjustment
Code References:	2010 ADAS 404.2.9
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Door opening force exceeds 5 lbf
e	11 lbf
Findings:	
Rec. Solution:	Replace or adjust existing closer
-	Replace or adjust existing closer
Rec. Solution:	Replace or adjust existing closer  1 Necessary Cost Est \$450.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 69D
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Stairway S201
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Door Closer - Sweep Period
Code References:	2010 ADAS 404.2.8.1
Performance Sta	indard: No Quantity: EACH As-built : 0
Barrier Description:	Door closer lacks min. 5 second sweep period
Findings:	2 second sweep
Rec. Solution:	Replace or adjust existing closer
Barrier Severity:	2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 69E
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Bldg Name: Location:	Women's Building Reference Dwg: 6 of 6 Floor 2 - Stairway S201
Location:	Floor 2 - Stairway S201
Location: X Coordinate:	Floor 2 - Stairway S201  N/A  Y Coordinate: N/A  Doors or Gates  Hardware - Operation
Location: X Coordinate: Barrier Area:	Floor 2 - Stairway S201  N/A  Y Coordinate: N/A  Doors or Gates
Location: X Coordinate: Barrier Area: Barrier Type: Code	Floor 2 - Stairway S201  N/A  Y Coordinate: N/A  Doors or Gates  Hardware - Operation  2010 ADAS 404.2.7
Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Floor 2 - Stairway S201  N/A  Y Coordinate: N/A  Doors or Gates  Hardware - Operation  2010 ADAS 404.2.7
Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Floor 2 - Stairway S201  N/A  Y Coordinate: N/A  Doors or Gates  Hardware - Operation  2010 ADAS 404.2.7  Indard: No Quantity: EACH As-built: 1
Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Floor 2 - Stairway S201  N/A  Y Coordinate: N/A  Doors or Gates  Hardware - Operation  2010 ADAS 404.2.7  Indard: No Quantity: EACH As-built: 1  Hardware not operable with a closed fist
Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Floor 2 - Stairway S201  N/A  Y Coordinate: N/A  Doors or Gates  Hardware - Operation  2010 ADAS 404.2.7  Indard: No Quantity: EACH As-built: 1  Hardware not operable with a closed fist  Hardware not operable with a closed fist  Provide new hardware
Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Floor 2 - Stairway S201  N/A  Y Coordinate: N/A  Doors or Gates  Hardware - Operation  2010 ADAS 404.2.7  Indard: No Quantity: EACH As-built: 1  Hardware not operable with a closed fist  Hardware not operable with a closed fist  Provide new hardware  1 Necessary Cost Est \$300.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 69F
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Stairway S201
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Vision Lights - Existing
Code References:	2010 ADAS 404.2.11
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	View panels in or adjacent to doors or gates not max. 43" above floor or ground
Findings:	View panel located higher than 43" above the floor
Rec. Solution:	Replace door/gate or vision panel
Barrier Severity:	3 Hindrance Cost Est \$2,250.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes: 56-1/2"	high
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 69H
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Stairway S201
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Type:	Sign - Encl Stairway Level
Code References:	ICC A117.1
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Tactile stairway signage not provided to indicate floor level
Findings:	No sign indicating floor level
Rec. Solution:	Provide sign
Barrier Severity:	2 Recommended Cost Est \$250.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 691
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Stairway S201
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Electrical Switches - Height
Code References:	2010 ADAS 308.2.1
Performance Sta	indard: No Quantity: EACH As-built: 1
Barrier Description:	Light switch control box top edge not at max. 48" high
Findings:	50-1/2" high
Rec. Solution:	Relocate switch box top edge to max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
E: 115 ·	District Day of District Day in the Control of District Day in the Control of District Day of
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 69J
Field Date: Bldg Name:	2/24/2014   Report Date   2/27/2014   Barrier #:   69J   Women's Building   Reference Dwg:   6 of 6
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Bldg Name: Location:	Women's Building Reference Dwg: 6 of 6 Floor 2 - Stairway S201
Bldg Name: Location: X Coordinate:	Women's Building Reference Dwg: 6 of 6  Floor 2 - Stairway S201  N/A Y Coordinate: N/A
Bldg Name: Location: X Coordinate: Barrier Area:	Women's Building Reference Dwg: 6 of 6  Floor 2 - Stairway S201  N/A Y Coordinate: N/A  Clear Floor Space  Protruding Object
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code	Women's Building Reference Dwg: 6 of 6  Floor 2 - Stairway S201  N/A Y Coordinate: N/A  Clear Floor Space  Protruding Object  2010 ADAS 307
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Women's Building Reference Dwg: 6 of 6  Floor 2 - Stairway S201  N/A Y Coordinate: N/A  Clear Floor Space  Protruding Object  2010 ADAS 307
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Women's Building Reference Dwg: 6 of 6  Floor 2 - Stairway S201  N/A Y Coordinate: N/A  Clear Floor Space  Protruding Object  2010 ADAS 307  Indard: No Quantity: EACH As-built: 1
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Women's Building Reference Dwg: 6 of 6  Floor 2 - Stairway S201  N/A Y Coordinate: N/A  Clear Floor Space  Protruding Object  2010 ADAS 307  Indard: No Quantity: EACH As-built: 1  Protruding object in in circulation path protrudes more than 4" between 27" and 80" high
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Women's Building Reference Dwg: 6 of 6  Floor 2 - Stairway S201  N/A Y Coordinate: N/A  Clear Floor Space  Protruding Object  2010 ADAS 307  Indard: No Quantity: EACH As-built: 1  Protruding object in in circulation path protrudes more than 4" between 27" and 80" high  Valve protrudes 10-1/4" at 64-1/2" high  Remove object or provide detectable warning (wing walls)
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Women's Building Reference Dwg: 6 of 6  Floor 2 - Stairway S201  N/A Y Coordinate: N/A  Clear Floor Space  Protruding Object  2010 ADAS 307  Indard: No Quantity: EACH As-built: 1  Protruding object in in circulation path protrudes more than 4" between 27" and 80" high  Valve protrudes 10-1/4" at 64-1/2" high  Remove object or provide detectable warning (wing walls)  I Necessary Cost Est \$550.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 69K
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Stairway S201
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Alarms
Barrier Type:	Horn/Strobe
Code References:	2010 ADAS 702.1
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	No horn/strobes in common use areas
Findings:	No device provided
Rec. Solution:	Provide strobes in common use area
Barrier Severity:	1 Necessary Cost Est \$5,500.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes: No horn	n/strobe on second level of stairway
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 70A
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Corridor H201
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	Permanent Room/Space - Tactile Characters
Code References:	2010 ADAS 216.2
Performance Sta	andard: No Quantity: EACH As-built : 2
Barrier Description:	At interior or exterior location, no tactile characters at sign identifying permanent rooms and spaces
Findings:	No tactile signage provided at doors within public route
Rec. Solution:	Provide accessible signs
Rec. Solution: Barrier Severity:	
	1 Necessary Cost Est \$500.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 70B
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Corridor H201
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	Visual Information Provided (Exhibitions)
Code References:	ADA Title II Technical Assistance Manual 3.2000 Denial of participation
Performance Sta	ndard: No Quantity: JOB As-built : 1
Barrier Description:	Visual sign providing information for program, service or activity not accessible
Findings:	Accessible sign not provided
Rec. Solution:	Provide information in alternate format to provide access to people with vision impairments
Barrier Severity:	1 Necessary Cost Est \$5,000.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes: Four bu	lletin boards, three advisory signs
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 70C  Women's Building Reference Dwg: 6 of 6
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Corridor H201
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Drinking Fountains
Barrier Type:	Alcove - Existing (pre-1992)
Code References:	2010 ADAS 307.2
Performance Sta	ndard: No Quantity: SF As-built : 1
Barrier Description:	Fountain with a leading edge between 27" and 80" high protrudes more than 4" into the circulation path.
Findings:	No alcove provided and fountain protrudes 13-1/2" at 28-1/2" high
Rec. Solution:	Provide wing walls as detectable warning (existing unit only)
Barrier Severity:	1 Necessary Cost Est \$250.00 Facility Function: Public Status: Open
Implementation	
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 70D
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Corridor H201
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Drinking Fountains
Barrier Type:	Operation - Manual (Fist)
Code References:	2010 ADAS 602.3
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Operating mechanism at fountain is not operable with a fist
Findings:	Not fist operable
Rec. Solution:	Replace fountain with accessible unit
Barrier Severity:	2 Recommended Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 70E  Women's Building Reference Dwg: 6 of 6
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Corridor H201
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Drinking Fountains
Barrier Type:	Operation - Replacement
Code References:	2010 ADAS 602.3
Performance Sta	andard: No Quantity: EACH As-built: 0
Barrier Description:	Operating mechanism involves more than 5 lbf to operate
Findings:	15 lbf needed to operate
Findings:	
Findings:	15 lbf needed to operate  Replace drinking fountain with accessible unit
Findings: Rec. Solution:	15 lbf needed to operate  Replace drinking fountain with accessible unit  2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 70F
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Corridor H201
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Drinking Fountains
Barrier Type:	Bubbler water flow
Code References:	2010 ADAS 602.6
Performance Sta	andard: No Quantity: JOB As-built : 0
Barrier Description:	Water flow from bubbler not min. 4" high
Findings:	2-1/2" high water flow from bubbler
Rec. Solution:	Adiust drinking fountain to provide min. 4" high water flow
Barrier Severity:	2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 70G  Women's Building Reference Dwg: 6 of 6
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Corridor H201
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	IN/A I Coordinate. IN/A
Barrier Area:	Drinking Fountains
Barrier Type:	Drinking Fountains  Toe Clearance
	Drinking Fountains
Barrier Type: Code	Drinking Fountains  Toe Clearance  2010 ADAS 306.2.3
Barrier Type: Code References:	Toe Clearance 2010 ADAS 306.2.3
Barrier Type: Code References: Performance Sta Barrier	Drinking Fountains  Toe Clearance  2010 ADAS 306.2.3  Indard: No Quantity: EACH As-built: 0
Barrier Type: Code References: Performance Sta Barrier Description:	Drinking Fountains  Toe Clearance  2010 ADAS 306.2.3  Indard: No Quantity: EACH As-built: 0  No toe clearance 9" high AFF and 17" deep from front edge
Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Drinking Fountains  Toe Clearance  2010 ADAS 306.2.3  Indard: No Quantity: EACH As-built: 0  No toe clearance 9" high AFF and 17" deep from front edge  14-1/2" deep toe clearance  Replace fountain with accessible unit
Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Drinking Fountains  Toe Clearance  2010 ADAS 306.2.3  Indard: No Quantity: EACH As-built: 0  No toe clearance 9" high AFF and 17" deep from front edge  14-1/2" deep toe clearance  Replace fountain with accessible unit  1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 70H
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Corridor H201
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Alarms
Barrier Type:	Fire Pull
Code References:	2010 ADAS 309.4
Performance Sta	ndard: No Quantity: EACH As-built: 1
Barrier Description:	Fire pull has no usable hardware
Findings:	Fire pull not fist operable
Rec. Solution:	Replace fire pull when remodeling
Barrier Severity:	4 Low Severity Cost Est \$3,500.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 70I
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Corridor H201
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Alarms
Barrier Type:	Fire Pull
Code References:	2010 ADAS 308.2.2
Performance Sta	ndard: No Quantity: EACH As-built : 0
Barrier Description:	Fire pulls not between 42" and 48" high
Findings:	54" high
Rec. Solution:	Replace fire pull when remodeling
Barrier Severity:	4 Low Severity Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 70J
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Corridor H201
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Corridors
Barrier Type:	Bench - Seat Height/Depth
Code References:	2010 ADAS 903.3
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Bench seat not 20" to 24" deep and height not 17" to 19" above ground
Findings:	12" high and 12-1/2" deep
Rec. Solution:	Provide min. one accessible bench in corridor
Barrier Severity:	3 Hindrance Cost Est \$1,100.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 70K
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Corridor H201
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Corridors
Barrier Type:	Horn/Strobe Device
Code References:	2010 ADAS 702.1
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	No horn or strobe in corridor where fire alarm exists in building
Findings:	No device provided
Rec. Solution:	Provide horn/strobe in common use area
Rec. Solution: Barrier Severity:	
	1 Necessary Cost Est \$5,500.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 71A
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Dean's Conference Room 210
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	Permanent Room/Space - Tactile Characters
Code References:	2010 ADAS 216.2
Performance Sta	ndard: No Quantity: EACH As-built: 1
Barrier Description:	At interior or exterior location, no tactile characters at sign identifying permanent rooms and spaces
Findings:	No tactile signage provided at door within public route
Rec. Solution:	Provide accessible sign
Barrier Severity:	1 Necessary Cost Est \$250.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 71B
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Dean's Conference Room 210
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Hardware - Operation
Code References:	2010 ADAS 404.2.7
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Hardware not operable with a closed fist
Findings:	Hardware not operable with a closed fist
Rec. Solution:	Provide new hardware
Barrier Severity:	1 Necessary Cost Est \$300.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: South de	-



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 71C
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Dean's Conference Room 210
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Vision Lights - Existing
Code References:	2010 ADAS 404.2.11
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	View panels in or adjacent to doors or gates not max. 43" above floor or ground
Findings:	View panel located higher than 43" above the floor
Rec. Solution:	Replace door/gate or vision panel
Barrier Severity:	3 Hindrance Cost Est \$2,250.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: South d	oor 48" high
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 71D
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Dean's Conference Room 210
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Clear Width
Code References:	2010 ADAS 404.2.3
Performance Sta	andard: No Quantity: EACH As-built : 0
Barrier Description:	Door, sliding/folding door or gate clear width is not min. 32"
Findings:	29" clear width
Rec. Solution:	Provide ISA directional sign leading to other entry door
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	Priority.  2 implementation Phase.   implementation Date.



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 71E
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Dean's Conference Room 210
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Actuator or Control - Height
Code References:	2010 ADAS 305.3
Performance Sta	indard: No Quantity: EACH As-built : 1
Barrier Description:	Control or mechanism not at max. 48" high for side reach
Findings:	Light switches 53" - 54-1/2" high
Rec. Solution:	Relocate controls or mechanisms to max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: 7 switch	nes
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 71F
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Dean's Conference Room 210
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Electrical Outlets - Hi/Low Reach
Code References:	2010 ADAS 308.2.2
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Use of outlet involves low reach of less than 15" above floor or more than 48" high
Findings:	10" high
Rec. Solution:	Relocate outlet to area at min. 15" or max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 71G
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Dean's Conference Room 210
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Shelves or Cabinets
Code References:	2010 ADAS 305.3
Performance Sta	indard: No Quantity: JOB As-built : 2
Barrier Description:	Shelf or cabinet not mounted max. 48" above floor or ground
Findings:	Shelf or cabinets not accessible
Rec. Solution:	Provide additional shelf at accessible height or provide assistance
Barrier Severity:	3 Hindrance Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 71H
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Dean's Conference Room 210
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Counters and Tables
Barrier Type:	Table - Knee Clearance
Code References:	2010 ADAS 305.3
Performance Sta	indard: No Quantity: EACH As-built : 1
Barrier Description:	Knee clearance not min. 27" high, 19" deep or 30" wide
Findings:	26-1/4" high and 14" deep knee clearance
Rec. Solution:	Provide min. 1 accessible table
Barrier Severity:	3 Hindrance Cost Est \$450.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: 11 table	•



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 711
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Dean's Conference Room 210
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Actuator or Control - Height
Code References:	2010 ADAS 305.3
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Control or mechanism not at max. 48" high for side reach
Findings:	Telephone 54" high
Rec. Solution:	Relocate control or mechanism to max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 71J
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Dean's Conference Room 210
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Clear Floor Space
Barrier Type:	Passageway - Min. 36"
Code References:	2010 ADAS 403.5.1
Performance Sta	ndard: No Quantity: LF As-built : 1
Barrier Description:	Circulation route not min. 36" wide between elements
Findings:	No accesssible route to podium
Rec. Solution:	Demolish existing and construct new passageway
Barrier Severity:	Cost Fet   64.05.00   Facility Functions   D. Lii   Ctature   D.
	1 Necessary Cost Est \$125.00 Facility Function: Public Status: Open
implementation	Priority: 2 Implementation Phase: Implementation Date:



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 71K
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Dean's Conference Room 210
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Counters and Tables
Barrier Type:	Podium - Surface Height
Code References:	2010 ADAS 902.3
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Surface height exceeds 34" high
Findings:	39-1/2" surface height
Rec. Solution:	At least 1 podium or ensure that 5% of all podiums are accessible
Barrier Severity:	3 Hindrance Cost Est \$1,275.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 71L
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Diag Harrier	Women's Building Reference Dwg. 16 01 6
Location:	Floor 2 - Dean's Conference Room 210
_	An An
Location:	Floor 2 - Dean's Conference Room 210
Location: X Coordinate:	Floor 2 - Dean's Conference Room 210  N/A Y Coordinate: N/A  Clear Floor Space  Accessible Route - Stored Elements
Location: X Coordinate: Barrier Area:	Floor 2 - Dean's Conference Room 210  N/A Y Coordinate: N/A  Clear Floor Space
Location: X Coordinate: Barrier Area: Barrier Type: Code	Floor 2 - Dean's Conference Room 210  N/A  Y Coordinate: N/A  Clear Floor Space  Accessible Route - Stored Elements  2010 ADAS 305.3
Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Floor 2 - Dean's Conference Room 210  N/A  Y Coordinate: N/A  Clear Floor Space  Accessible Route - Stored Elements  2010 ADAS 305.3
Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Floor 2 - Dean's Conference Room 210  N/A  Y Coordinate: N/A  Clear Floor Space  Accessible Route - Stored Elements  2010 ADAS 305.3  andard: No Quantity: JOB As-built: 0
Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Floor 2 - Dean's Conference Room 210  N/A  Y Coordinate: N/A  Clear Floor Space  Accessible Route - Stored Elements  2010 ADAS 305.3  andard: No Quantity: JOB As-built: 0  Clear floor space does not adjoin an accessible route or another space
Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Floor 2 - Dean's Conference Room 210  N/A  Y Coordinate: N/A  Clear Floor Space  Accessible Route - Stored Elements  2010 ADAS 305.3  andard: No Quantity: JOB As-built: 0  Clear floor space does not adjoin an accessible route or another space  Chair and wall block clear floor space at podium  Relocate items to provide connection to accessible route
Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Floor 2 - Dean's Conference Room 210  N/A  Y Coordinate: N/A  Clear Floor Space  Accessible Route - Stored Elements  2010 ADAS 305.3  Andard: No Quantity: JOB As-built: 0  Clear floor space does not adjoin an accessible route or another space  Chair and wall block clear floor space at podium  Relocate items to provide connection to accessible route  1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 71M
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Dean's Conference Room 210
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Alarms
Barrier Type:	Horn/Strobe - Common Use Area
Code References:	2010 ADAS 702.1
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	No horn/strobes in common use areas
Findings:	No device provided
Rec. Solution:	Provide strobe in common use area
Barrier Severity:	1 Necessary Cost Est \$5,500.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 72A
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Dean's Activity Room 210A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	Permanent Room/Space - Tactile Characters
Code References:	2010 ADAS 216.2
Performance Sta	andard: No Quantity: EACH As-built: 1
i ci ioi mance 3ta	To Saile I
Barrier Description:	At interior or exterior location, no tactile characters at sign identifying permanent rooms and spaces
Barrier	At interior or exterior location, no tactile characters at sign identifying permanent rooms and
Barrier Description:	At interior or exterior location, no tactile characters at sign identifying permanent rooms and spaces
Barrier Description: Findings:	At interior or exterior location, no tactile characters at sign identifying permanent rooms and spaces  No tactile signage provided at door within public route  Provide accessible sign
Barrier Description: Findings: Rec. Solution:	At interior or exterior location, no tactile characters at sign identifying permanent rooms and spaces  No tactile signage provided at door within public route  Provide accessible sign  1 Necessary Cost Est \$250.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 72B
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Dean's Activity Room 210A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Hardware - Operation
Code References:	2010 ADAS 404.2.7
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Hardware not operable with a closed fist
Findings:	Hardware not operable with a closed fist
Rec. Solution:	Provide new hardware
Barrier Severity:	1 Necessary Cost Est \$300.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 72C
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Dean's Activity Room 210A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Vision Lights - Existing
Code	2010 ADAS 404.2.11
References:	
References: Performance Sta	andard: No Quantity: EACH As-built: 1
	ndard: No Quantity: EACH As-built: 1  View panels in or adjacent to doors or gates not max. 43" above floor or ground
Performance Sta Barrier	
Performance Sta Barrier Description:	View panels in or adjacent to doors or gates not max. 43" above floor or ground
Performance Sta Barrier Description: Findings:	View panels in or adjacent to doors or gates not max. 43" above floor or ground  View panel located higher than 43" above the floor  Replace door/gate or vision panel
Performance Sta Barrier Description: Findings: Rec. Solution:	View panels in or adjacent to doors or gates not max. 43" above floor or ground  View panel located higher than 43" above the floor  Replace door/gate or vision panel  3 Hindrance Cost Est \$2,250.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 72D
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Dean's Activity Room 210A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Clear Width
Code References:	2010 ADAS 404.2.3
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Door, sliding/folding door or gate clear width is not min. 32"
Findings:	29" clear width
Rec. Solution:	Replace door or gate and frame
Barrier Severity:	1 Necessary Cost Est \$2,250.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 72E
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Dean's Activity Room 210A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Front App/pull 18" SEC - Relocate Door
Code References:	2010 ADAS Figure 404.2.4.1
Performance Sta	ndard: No Quantity: EACH As-built : 0
Barrier Description:	Door/Gate at pull side with min. 60" lacks min. 18" strike edge clearance at pull side
Findings:	8-1/2" strike edge clearance
Rec. Solution:	Move furniture to provide access
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 72F
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Dean's Activity Room 210A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Counters and Tables
Barrier Type:	Counter - Surface Height
Code References:	2010 ADAS 902.3
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	No section at least 3 feet long between 28" and 34" provided at existing counter
Findings:	35-1/2" high
Rec. Solution:	Provide min. 3 ft long section of counter at max. 34" high
Barrier Severity:	3 Hindrance Cost Est \$875.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 72G
Field Date: Bldg Name:	2/24/2014   Report Date   2/27/2014   Barrier #:
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Bldg Name: Location:	Women's Building Reference Dwg: 6 of 6  Floor 2 - Dean's Activity Room 210A
Bldg Name: Location: X Coordinate:	Women's Building Reference Dwg: 6 of 6  Floor 2 - Dean's Activity Room 210A  N/A Y Coordinate: N/A
Bldg Name: Location: X Coordinate: Barrier Area:	Women's Building Reference Dwg: 6 of 6  Floor 2 - Dean's Activity Room 210A  N/A Y Coordinate: N/A  Counters and Tables
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code	Women's Building Reference Dwg: 6 of 6  Floor 2 - Dean's Activity Room 210A  N/A Y Coordinate: N/A  Counters and Tables  Counter - Knee Clearance  2010 ADAS 305.3
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Women's Building Reference Dwg: 6 of 6  Floor 2 - Dean's Activity Room 210A  N/A Y Coordinate: N/A  Counters and Tables  Counter - Knee Clearance  2010 ADAS 305.3
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Women's Building Reference Dwg: 6 of 6  Floor 2 - Dean's Activity Room 210A  N/A Y Coordinate: N/A  Counters and Tables  Counter - Knee Clearance  2010 ADAS 305.3  ndard: No Quantity: EACH As-built: 0
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Women's Building Reference Dwg: 6 of 6  Floor 2 - Dean's Activity Room 210A  N/A Y Coordinate: N/A  Counters and Tables  Counter - Knee Clearance  2010 ADAS 305.3  ndard: No Quantity: EACH As-built: 0  Knee clearance not min. 27" high, 19" deep or 30" wide
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Women's Building Reference Dwg: 6 of 6  Floor 2 - Dean's Activity Room 210A  N/A Y Coordinate: N/A  Counters and Tables  Counter - Knee Clearance  2010 ADAS 305.3  ndard: No Quantity: EACH As-built: 0  Knee clearance not min. 27" high, 19" deep or 30" wide  No knee clearance
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Women's Building  Reference Dwg: 6 of 6  Floor 2 - Dean's Activity Room 210A  N/A  Y Coordinate: N/A  Counters and Tables  Counter - Knee Clearance  2010 ADAS 305.3  ndard: No Quantity: EACH As-built: 0  Knee clearance not min. 27" high, 19" deep or 30" wide  No knee clearance  Replace counter. Flip-up counters. adiacent tables and similar devices not permitted  3 Hindrance  Cost Est \$0.00  Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 72H
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Dean's Activity Room 210A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Electrical Outlets - Side Reach Obstructed (10"-24")
Code References:	2010 ADAS 305.3
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Outlet located over an 10" to 24" obstruction max. 34" high located above 46"
Findings:	45-1/2" high and 25" deep over an obstruction 35-1/2"high
Rec. Solution:	Relocate control or mechanism to max. 46" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 72I
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Dean's Activity Room 210A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Sink - Rim or Countertop
Code References:	2010 ADAS 606.3
Performance Sta	andard: No Quantity: LF As-built: 3
Barrier Description:	Sink rim or surface not max. 34" high
Findings:	35-1/2" high
Rec. Solution:	Reposition existing sink or provide additional sink for use in area
Barrier Severity:	1 Necessary Cost Est \$1,110.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 72J
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Dean's Activity Room 210A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Sink - Depth
Code References:	Performance Standard
Performance Sta	andard: Yes Quantity: EACH As-built : 0
Barrier Description:	Sink depth exceeds 6-1/2" deep
Findings:	7-1/2" deep
Rec. Solution:	Replace sink
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 72K
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Dean's Activity Room 210A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Sink - Knee Clearance
Code References:	2010 ADAS 606.2 & 306
Performance Sta	andard: No Quantity: EACH As-built : 0
Barrier Description:	Knee clearance of at least 27" high, 30" wide and 8" deep not provided underneath sink
Description.	,
Findings:	No knee clearance
·	No knee clearance  Replace cabinet and remount sink
Findings:	Replace cabinet and remount sink
Findings: Rec. Solution:	Replace cabinet and remount sink  1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 72L
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Dean's Activity Room 210A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Shelves or Cabinets
Code References:	2010 ADAS 305.3
Performance Sta	andard: No Quantity: JOB As-built : 1
Barrier Description:	Shelf or cabinet not mounted max. 48" above floor or ground
Findings:	Shelf or cabinet not accessible
Rec. Solution:	Provide additional shelf at accessible height or provide assistance
Barrier Severity:	3 Hindrance Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: 53" high	1
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 72M
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Dean's Activity Room 210A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Clear Floor Space
Barrier Type:	Protruding Object
Code References:	2010 ADAS 307
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Protruding object in in circulation path protrudes more than 4" between 27" and 80" high
Findings:	Stored items on refrigerator protrudes more than 4" and higher than 27"
Findings: Rec. Solution:	Stored items on refrigerator protrudes more than 4" and higher than 27"  Remove object or provide detectable warning (wing walls)
J	Remove object or provide detectable warning (wing walls)
Rec. Solution:	Remove object or provide detectable warning (wing walls)  1 Necessary Cost Est \$550.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 72N
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Dean's Activity Room 210A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Turning Space
Barrier Type:	Circular Turning Space - Min. 60"
Code References:	2010 ADAS 304.3.1
Performance Sta	andard: No Quantity: SF As-built : 60
Barrier Description:	Circular turning space not minimum of 60" in diameter (including toe/knee space)
Findings:	60" turning circle not provided
Rec. Solution:	Remodel to provide access
Barrier Severity:	2 Recommended Cost Est \$4,500.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 720
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Dean's Activity Room 210A
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Alarms
Barrier Type:	Horn/Strobe
Code References:	2010 ADAS 702.1
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	No horn/strobes in common use areas
Findings:	No device provided
Rec. Solution:	Provide strobes in common use area
Rec. Solution: Barrier Severity:	
	1 Necessary Cost Est \$5,500.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 73A
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Vestibule V207
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	Permanent Room/Space - Tactile Characters
Code References:	2010 ADAS 216.2
Performance Sta	andard: No Quantity: EACH As-built : 2
Barrier Description:	No tactile characters at sign identifying permanent rooms and spaces with visual signs
Findings:	No tactile signage provided at doors within public route
Rec. Solution:	Provide accessible signs
Barrier Severity:	1 Necessary Cost Est \$500.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes: Rooms 2	207A and 207B
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 73B
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Vestibule V207
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Threshold - Height exceeding 1/2"
Code References:	2010 ADAS 404.2.5
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Door/Gate threshold exceeds 1/2" in height
Findings:	1" high
Rec. Solution:	Provide new door threshold
Barrier Severity:	1 Necessary Cost Est \$275.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 74A
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Grad Student Office 206
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	Permanent Room/Space - Tactile Characters
Code References:	2010 ADAS 216.2
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	At interior or exterior location, no tactile characters at sign identifying permanent rooms and spaces
Findings:	No tactile signage provided at door within public route
Rec. Solution:	Provide accessible sign
Barrier Severity:	1 Necessary Cost Est \$250.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 74B
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Grad Student Office 206
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Hardware - Operation
Code References:	2010 ADAS 404.2.7
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Hardware not operable with a closed fist
Findings:	Hardware not operable with a closed fist
Rec. Solution:	Provide new hardware
Barrier Severity:	1 Necessary Cost Est \$300.00 Facility Function: Public Status: Open
Implementation	
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 74C
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Grad Student Office 206
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Vision Lights - Existing
Code References:	2010 ADAS 404.2.11
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	View panels in or adjacent to doors or gates not max. 43" above floor or ground
Findings:	View panel located higher than 43" above the floor
Rec. Solution:	Replace door/gate or vision panel
Barrier Severity:	3 Hindrance Cost Est \$2,250.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: 56-1/2"	high
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 74D
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Grad Student Office 206
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Electrical Switches - Height
Code References:	2010 ADAS 308.2.1
Performance Sta	indard: No Quantity: EACH As-built : 1
Barrier Description:	Light switch control box top edge not at max. 48" high
Findings:	52-1/4" high
Rec. Solution:	Relocate switch box top edge to max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 74E
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Grad Student Office 206
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Electrical Outlets - Hi/Low Reach
Code References:	2010 ADAS 308.2.2
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Use of outlet involves low reach of less than 15" above floor or more than 48" high
Findings:	11-1/2" high
Rec. Solution:	Relocate outlets to area at min. 15" or max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: 3 outlets	s 11-1/2" / 2 Outlets 63" and 1 power strip at 1" high
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 74F
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Grad Student Office 206
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Chalkboard/Whiteboard - Area of Use
Code References:	Performance Standard & 2010 ADAS 904.3.3
Performance Sta	ndard: Yes Quantity: EACH As-built : 2
Barrier Description:	Bottom edge of writing surface not max. 38" high
Findings:	Lower edge of writing surfaces 45" high from floor
Rec. Solution:	Remount whiteboards/chalkboards or provide alternate for use by short people
Barrier Severity:	3 Hindrance Cost Est \$2,400.00 Facility Function: Public Status: Open
Implementation	
Notes: Board in	class and board on door



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 74G
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Grad Student Office 206
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Counters and Tables
Barrier Type:	Table - Pedestal Base
Code References:	2010 ADAS 306.2.2 and 306.2.3
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Knee clearance not min. 27" high, 19" deep or 30" wide
Findings:	Pedestal base blocks knee clearance
Rec. Solution:	Provide min. 1 accessible table. Avoid pedestal base tables.
Barrier Severity:	2 Recommended Cost Est \$450.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 74H
Field Date: Bldg Name:	2/24/2014   Report Date   2/27/2014   Barrier #:   74H
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Bldg Name: Location:	Women's Building Reference Dwg: 6 of 6 Floor 2 - Grad Student Office 206
Bldg Name: Location: X Coordinate:	Women's Building Reference Dwg: 6 of 6  Floor 2 - Grad Student Office 206  N/A Y Coordinate: N/A
Bldg Name: Location: X Coordinate: Barrier Area:	Women's Building Reference Dwg: 6 of 6  Floor 2 - Grad Student Office 206  N/A Y Coordinate: N/A  Alarms
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code	Women's Building Reference Dwg: 6 of 6  Floor 2 - Grad Student Office 206  N/A Y Coordinate: N/A  Alarms  Horn/Strobe  2010 ADAS 702.1
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Women's Building Reference Dwg: 6 of 6  Floor 2 - Grad Student Office 206  N/A Y Coordinate: N/A  Alarms  Horn/Strobe  2010 ADAS 702.1
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Women's Building Reference Dwg: 6 of 6  Floor 2 - Grad Student Office 206  N/A Y Coordinate: N/A  Alarms  Horn/Strobe  2010 ADAS 702.1  andard: No Quantity: EACH As-built: 1
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Women's Building Reference Dwg: 6 of 6  Floor 2 - Grad Student Office 206  N/A Y Coordinate: N/A  Alarms  Horn/Strobe  2010 ADAS 702.1  Indard: No Quantity: EACH As-built: 1  No horn/strobes in common use areas
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Women's Building Reference Dwg: 6 of 6  Floor 2 - Grad Student Office 206  N/A Y Coordinate: N/A  Alarms  Horn/Strobe  2010 ADAS 702.1  Indard: No Quantity: EACH As-built: 1  No horn/strobes in common use areas  No device provided  Provide strobes in common use area
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Women's Building Reference Dwg: 6 of 6 Floor 2 - Grad Student Office 206 N/A Y Coordinate: N/A Alarms Horn/Strobe 2010 ADAS 702.1  Indard: No Quantity: EACH As-built: 1 No horn/strobes in common use areas  No device provided  Provide strobes in common use area  I Necessary Cost Est \$5,500.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 75A
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Stairway S202
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	Permanent Room/Space - Tactile Characters
Code References:	2010 ADAS 216.2
Performance Sta	indard: No Quantity: EACH As-built : 1
Barrier Description:	At interior or exterior location, no tactile characters at sign identifying permanent rooms and spaces
Findings:	No tactile signage provided at door within public route
Rec. Solution:	Provide accessible sign
Barrier Severity:	1 Necessary Cost Est \$250.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 75B
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Stairway S202
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Type:	Door Closer - Interior Adjustment
Code References:	2010 ADAS 404.2.9
Performance Sta	indard: No Quantity: EACH As-built : 1
Barrier Description:	Door opening force exceeds 5 lbf
Findings:	13 lbf
Rec. Solution:	Replace or adjust existing closer
Barrier Severity:	1 Necessary Cost Est \$450.00 Facility Function: Public Status: Open
Implementation	
	Priority: 3 Implementation Phase: Implementation Date:



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 75C
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Stairway S202
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Type:	Door Closer - Interior Sweep ADA
Code References:	2010 ADAS 404.2.8.1
Performance Sta	ndard: No Quantity: EACH As-built : 0
Barrier Description:	Door closer lacks min. 5 second sweep period
Findings:	4 second sweep
Rec. Solution:	Replace or adjust existing closer
Barrier Severity:	2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 75D
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Stairway S202
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Type:	Door Hardware - Operation
Code References:	2010 ADAS 404.2.7
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Hardware not operable with a closed fist
Findings:	Hardware not operable with a closed fist
Rec. Solution:	Replace hardware
Barrier Severity:	1 Necessary Cost Est \$300.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 75E
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Stairway S202
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Vision Lights - Existing
Code References:	2010 ADAS 404.2.11
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	View panels in or adjacent to doors or gates not max. 43" above floor or ground
Findings:	View panel located higher than 43" above the floor
Rec. Solution:	Replace door/gate or vision panel
Barrier Severity:	3 Hindrance Cost Est \$2,250.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes: 56-1/2"	high
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 75F
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Stairway S202
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Type:	Sign - Exit Door
Code References:	Performance Standard
Performance Sta	ndard: Yes Quantity: EACH As-built : 1
Barrier Description:	Door leading directly into an exit stairway lacks tactile exit sign
Findings:	Door to exit stair with low level illuminated sign lacks tactile exit sign
Rec. Solution:	Provide sign stating "EXIT STAIR DOWN (or UP)" at latch side of door
Barrier Severity:	2 Recommended Cost Est \$250.00 Facility Function: Public Status: Open
Implementation	
	Priority: 3 Implementation Phase: Implementation Date:



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 75G
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Stairway S202
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Type:	Sign - Encl Stairway Level
Code References:	ICC A117.1
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Tactile stairway signage not provided to indicate floor level
Findings:	No sign indicating floor level
Rec. Solution:	Provide sign
Barrier Severity:	2 Recommended Cost Est \$250.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 75H
Field Date: Bldg Name:	2/24/2014   Report Date   2/27/2014   Barrier #:   75H
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Bldg Name: Location:	Women's Building Reference Dwg: 6 of 6 Floor 2 - Stairway S202
Bldg Name: Location: X Coordinate:	Women's Building Reference Dwg: 6 of 6  Floor 2 - Stairway S202  N/A Y Coordinate: N/A  Controls and Mechanisms  Electrical Switches - Height
Bldg Name: Location: X Coordinate: Barrier Area:	Women's Building Reference Dwg: 6 of 6  Floor 2 - Stairway S202  N/A Y Coordinate: N/A  Controls and Mechanisms
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code	Women's Building Reference Dwg: 6 of 6  Floor 2 - Stairway S202  N/A Y Coordinate: N/A  Controls and Mechanisms  Electrical Switches - Height  2010 ADAS 308.2.1
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Women's Building Reference Dwg: 6 of 6  Floor 2 - Stairway S202  N/A Y Coordinate: N/A  Controls and Mechanisms  Electrical Switches - Height  2010 ADAS 308.2.1
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Women's Building Reference Dwg: 6 of 6  Floor 2 - Stairway S202  N/A Y Coordinate: N/A  Controls and Mechanisms  Electrical Switches - Height  2010 ADAS 308.2.1  Indard: No Quantity: EACH As-built: 1
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Women's Building Reference Dwg: 6 of 6  Floor 2 - Stairway S202  N/A  Y Coordinate: N/A  Controls and Mechanisms  Electrical Switches - Height  2010 ADAS 308.2.1  Indard: No Quantity: EACH As-built: 1  Light switch control box top edge not at max. 48" high
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Women's Building  Reference Dwg: 6 of 6  Floor 2 - Stairway S202  N/A  Y Coordinate: N/A  Controls and Mechanisms  Electrical Switches - Height  2010 ADAS 308.2.1  Indard: No Quantity: EACH As-built: 1  Light switch control box top edge not at max. 48" high  Relocate switch box top edge to max. 48" high
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Women's Building Reference Dwg: 6 of 6  Floor 2 - Stairway S202  N/A Y Coordinate: N/A  Controls and Mechanisms  Electrical Switches - Height  2010 ADAS 308.2.1  Indard: No Quantity: EACH As-built: 1  Light switch control box top edge not at max. 48" high  Relocate switch box top edge to max. 48" high  Relocate switch box top edge to max. 48" high  Relocate switch box top edge to max. 48" high  Relocate switch box top edge to max. 48" high  Relocate switch box top edge to max. 48" high



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 75I
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Stairway S202
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Type:	Handrail Grip
Code References:	2010 ADAS 505.10.2
Performance Sta	andard: No Quantity: LF As-built : 24
Barrier Description:	Handrail grip is not continuous
Findings:	Handrail grip is not continuous
Rec. Solution:	Provide handrails at both sides of stairway
Barrier Severity:	2 Recommended Cost Est \$5,400.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes: Inner ha	andrail
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 75J
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Stairway S202
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Type:	Handrail Extension - Bottom
Code References:	2010 ADAS 505.10.1
Performance Sta	andard: No Quantity: LF As-built : 0
Barrier Description:	Bottom handrail extension not level for min. 12"
Findings:	No extension provided
Rec. Solution:	Provide handrails at both sides of stairway
Barrier Severity:	2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	, , , , , , , , , , , , , , , , , , , ,
implementation	Priority: 3 Implementation Phase: Implementation Date:



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 75K
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Stairway S202
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Type:	Handrail Extension - Top Length
Code References:	2010 ADAS 505.10.2
Performance Sta	andard: No Quantity: LF As-built : 0
Barrier Description:	Top Handrail extension does not extend for one tread width or min. 12"
Findings:	Top handrail extension not parallel to ground surface
Rec. Solution:	Provide handrails at both sides of stairway
Barrier Severity:	2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes: Neither	side has the 12"
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 75L
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Stairway S202
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Stairways
Barrier Type:	Contrasting Color - ADA
Code References:	2010 ADAS Advisory 504.4
Performance Sta	indard: Yes Quantity: LF or TR As-built : 1
Barrier Description:	No contrasting color on each tread of exterior stairway
Findings:	Treads lack contrasting color defined as 70% contrast
Rec. Solution:	Recommended: Consider providing contrasting color on each tread
Barrier Severity:	2 Recommended Cost Est \$35.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 75M
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Stairway S202
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Alarms
Barrier Type:	Horn/Strobe
Code References:	2010 ADAS 702.1
Performance Sta	indard: No Quantity: EACH As-built : 1
Barrier Description:	No horn/strobes in common use areas
Findings:	No device provided
Rec. Solution:	Provide strobes in common use area
Barrier Severity:	1 Necessary Cost Est \$5,500.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 76A
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Corridor H202
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Corridors
Barrier Type:	Sign - Lobby Info Sign
Code References:	Performance Standard
Performance Sta	ndard: Yes Quantity: EACH As-built: 1
Barrier Description:	No lobby informational sign with location of accessible elements
Findings:	Accessible sign not provided
Rec. Solution:	Provide lobby informational sign
Barrier Severity:	1 Necessary Cost Est \$250.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 76B
Bldg Name:	Women's Building Reference Dwg: 5 of 6
Location:	Floor 2 - Corridor H202
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	Evacuation Plan
Code References:	Performance Standard
Performance Sta	andard: Yes Quantity: EACH As-built : 1
Barrier Description:	No evacuation plan provided
Findings:	Accessible sign not provided
Rec. Solution:	Provide evacuation sign usable by the visually impaired
Barrier Severity:	2 Recommended Cost Est \$250.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 76C
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Corridor H202
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Corridors
Barrier Type:	Protruding Object 03/03/2014 14-36
Code References:	2010 ADAS 307
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Protruding object in in circulation path protrudes more than 4" between 27" and 80" high
Findings:	Encased fire extinguisher protrudes 7" at 29" high
Rec. Solution:	Remove object or provide detectable warning (wing walls)
Rec. Solution: Barrier Severity:	
	1 Necessary Cost Est \$550.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 77
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Elevator E201
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Elevators
Barrier Type:	Doorjamb marking - Height
Code References:	2010 ADAS 407.2.3.1
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Elevator landing door jamb signage not located 60" on center on both jamb panels
Findings:	61-1/4" high
Rec. Solution:	Replace door iamb signage
Barrier Severity:	2 Recommended Cost Est \$250.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: Hall call	button at 42" high
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 78A
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Classroom 205
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	Location - Wall Space Lacking
Code References:	2010 ADAS 703.4.2
Performance Sta	ndard: No Quantity: EACH As-built : 2
Barrier Description:	No wall space provided at latch side of door for signge mounting
Findings:	Sign on hinge side of door
Rec. Solution:	Relocate signs to nearest adiacent wall
Barrier Severity:	1 Necessary Cost Est \$300.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes: Braille s	igns mounted at the wrong side of door



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 78B
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Classroom 205
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage 205
Barrier Type:	Braille - Location Below Characters
Code References:	2010 ADAS 703.2.3.2
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Braille on sign not located directly below tactile characters
Findings:	Accessible sign not provided
Rec. Solution:	Provide accessible sign
Barrier Severity:	1 Necessary Cost Est \$250.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes: Braille s	ign mounted to the right below raised letters
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 78C
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Classroom 205
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage 205
Barrier Type:	Braille - Distance from Characters
Code References:	2010 ADAS 703.3
Performance Sta	andard: No Quantity: EACH As-built: 0
Barrier Description:	Braille not 3/8" and max. 1/2" directly below the tactile characters
Findings:	Braille less than 3/8" below raised letters
Rec. Solution:	Provide accessible sign
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes: Less tha	nn 3/8" below raised letters



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 78D
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Classroom 205
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Hardware - Operation
Code References:	2010 ADAS 404.2.7
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Hardware not operable with a closed fist
Findings:	Hardware not operable with a closed fist
Rec. Solution:	Provide new hardware
Barrier Severity:	1 Necessary Cost Est \$300.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: Doors to	room 204
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 78E
Field Date: Bldg Name:	2/24/2014 Report Date 2/27/2014 Barrier #: 78E  Women's Building Reference Dwg: 6 of 6
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Bldg Name: Location:	Women's Building Reference Dwg: 6 of 6 Floor 2 - Classroom 205
Bldg Name: Location: X Coordinate:	Women's Building Reference Dwg: 6 of 6  Floor 2 - Classroom 205  N/A Y Coordinate: N/A
Bldg Name: Location: X Coordinate: Barrier Area:	Women's Building Reference Dwg: 6 of 6  Floor 2 - Classroom 205  N/A Y Coordinate: N/A  Doors or Gates
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code	Women's Building Reference Dwg: 6 of 6  Floor 2 - Classroom 205  N/A Y Coordinate: N/A  Doors or Gates  Vision Lights - New Construction  2010 ADAS 404.2.11
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Women's Building Reference Dwg: 6 of 6  Floor 2 - Classroom 205  N/A Y Coordinate: N/A  Doors or Gates  Vision Lights - New Construction  2010 ADAS 404.2.11
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Women's Building Reference Dwg: 6 of 6  Floor 2 - Classroom 205  N/A Y Coordinate: N/A  Doors or Gates  Vision Lights - New Construction  2010 ADAS 404.2.11  ndard: No Quantity: EACH As-built: 1
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Women's Building  Reference Dwg: 6 of 6  Floor 2 - Classroom 205  N/A  Y Coordinate: N/A  Doors or Gates  Vision Lights - New Construction  2010 ADAS 404.2.11  ndard: No Quantity: EACH As-built: 1  View panels in or adjacent to doors or gates not max. 43" above floor or ground
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Women's Building  Reference Dwg: 6 of 6  Floor 2 - Classroom 205  N/A  Y Coordinate: N/A  Doors or Gates  Vision Lights - New Construction  2010 ADAS 404.2.11  view panels in or adjacent to doors or gates not max. 43" above floor or ground  View panel located higher than 43" above the floor  Replace door/gate or vision panel
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Women's Building  Reference Dwg: 6 of 6  Floor 2 - Classroom 205  N/A  Y Coordinate: N/A  Doors or Gates  Vision Lights - New Construction  2010 ADAS 404.2.11  View panels in or adjacent to doors or gates not max. 43" above floor or ground  View panel located higher than 43" above the floor  Replace door/gate or vision panel  2 Recommended Cost Est \$2,250.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 78F
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Classroom 205
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Door 10" Bottom Surface - Door Stop
Code References:	2010 ADAS 404.2.10
Performance Sta	indard: No Quantity: EACH As-built : 1
Barrier Description:	Door stop interrupts min. 10" smooth bottom surface
Findings:	Door stop at bottom of door not accessible
Rec. Solution:	Remove door stop or any other element within bottom 10" of door
Barrier Severity:	1 Necessary Cost Est \$75.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: Door to	corridor
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 78G
Dida Nama:	
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Women's Building   Reference Dwg:   6 of 6   Floor 2 - Classroom 205   Floor 2 - Classroom 205
Location:	Floor 2 - Classroom 205
Location: X Coordinate:	Floor 2 - Classroom 205  N/A  Y Coordinate: N/A
Location: X Coordinate: Barrier Area:	Floor 2 - Classroom 205  N/A Y Coordinate: N/A  Doors or Gates
Location: X Coordinate: Barrier Area: Barrier Type: Code	Floor 2 - Classroom 205  N/A  Y Coordinate: N/A  Doors or Gates  Front App/pull 18" SEC - Blocked  2010 ADAS Figure 404.2.4.1
Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Floor 2 - Classroom 205  N/A  Y Coordinate: N/A  Doors or Gates  Front App/pull 18" SEC - Blocked  2010 ADAS Figure 404.2.4.1
Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Floor 2 - Classroom 205  N/A  Y Coordinate: N/A  Doors or Gates  Front App/pull 18" SEC - Blocked  2010 ADAS Figure 404.2.4.1  andard: No Quantity: ADMINI As-built: 1
Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Floor 2 - Classroom 205  N/A  Y Coordinate: N/A  Doors or Gates  Front App/pull 18" SEC - Blocked  2010 ADAS Figure 404.2.4.1  andard: No  Quantity: ADMINI  As-built: Door/Gate at pull side with min. 60" lacks min. 18" strike edge clearance at pull side
Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Floor 2 - Classroom 205  N/A  Y Coordinate: N/A  Doors or Gates  Front App/pull 18" SEC - Blocked  2010 ADAS Figure 404.2.4.1  andard: No Quantity: ADMINI As-built: 1  Door/Gate at pull side with min. 60" lacks min. 18" strike edge clearance at pull side  Trash blocks strike edge clearance at entry door  Remove stored item
Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Floor 2 - Classroom 205  N/A  Y Coordinate: N/A  Doors or Gates  Front App/pull 18" SEC - Blocked  2010 ADAS Figure 404.2.4.1  andard: No Quantity: ADMINI As-built: 1  Door/Gate at pull side with min. 60" lacks min. 18" strike edge clearance at pull side  Trash blocks strike edge clearance at entry door  Remove stored item  1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 78H
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Classroom 205
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Front App/pull 60" - Blocked
Code References:	2010 ADAS Figure 404.2.4.1
Performance Sta	ndard: No Quantity: ADMINI As-built : 1
Barrier Description:	Door/Gate at with min. 18" at pull side lacks min. 60" perpendicular to door
Findings:	Door to room 204 blocked by table
Rec. Solution:	Remove stored item
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 78I
Field Date: Bldg Name:	2/24/2014   Report Date   2/27/2014   Barrier #:   78    Women's Building   Reference Dwg:   6 of 6
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Bldg Name: Location:	Women's Building Reference Dwg: 6 of 6 Floor 2 - Classroom 205
Bldg Name: Location: X Coordinate:	Women's Building Reference Dwg: 6 of 6  Floor 2 - Classroom 205  N/A Y Coordinate: N/A
Bldg Name: Location: X Coordinate: Barrier Area:	Women's Building Reference Dwg: 6 of 6  Floor 2 - Classroom 205  N/A Y Coordinate: N/A  Doors or Gates
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code	Women's Building Reference Dwg: 6 of 6  Floor 2 - Classroom 205  N/A Y Coordinate: N/A  Doors or Gates  Front App/push 48"  2010 ADAS Figure 404.2.4.1
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Women's Building Reference Dwg: 6 of 6  Floor 2 - Classroom 205  N/A Y Coordinate: N/A  Doors or Gates  Front App/push 48"  2010 ADAS Figure 404.2.4.1
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Women's Building Reference Dwg: 6 of 6  Floor 2 - Classroom 205  N/A Y Coordinate: N/A  Doors or Gates  Front App/push 48"  2010 ADAS Figure 404.2.4.1  Indard: No Quantity: ADMINI As-built: 1
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	Women's Building Reference Dwg: 6 of 6  Floor 2 - Classroom 205  N/A Y Coordinate: N/A  Doors or Gates  Front App/push 48"  2010 ADAS Figure 404.2.4.1  Indard: No Quantity: ADMINI As-built: 1  Door/Gate at push side with min. 18" lacks min. 48" perpendicular to door
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Women's Building Reference Dwg: 6 of 6 Floor 2 - Classroom 205 N/A Y Coordinate: N/A  Doors or Gates Front App/push 48"  2010 ADAS Figure 404.2.4.1  mdard: No Quantity: ADMINI As-built: 1  Door/Gate at push side with min. 18" lacks min. 48" perpendicular to door  Door to room 204 blocked by stored items  Remove stored item
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Women's Building  Reference Dwg: 6 of 6  Floor 2 - Classroom 205  N/A  Y Coordinate: N/A  Doors or Gates  Front App/push 48"  2010 ADAS Figure 404.2.4.1  Indard: No Quantity: ADMINI As-built: 1  Door/Gate at push side with min. 18" lacks min. 48" perpendicular to door  Door to room 204 blocked by stored items  Remove stored item  I Necessary  Cost Est \$0.00  Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 78J
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Classroom 205
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Electrical Switches - High Unobstructed
Code References:	2010 ADAS 308.2.1
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Light switch control box top edge not at max. 48" high
Findings:	49" high
Rec. Solution:	Relocate switch box top edge to max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 78K
Field Date: Bldg Name:	2/24/2014Report Date2/27/2014Barrier #:78KWomen's BuildingReference Dwg:6 of 6
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Bldg Name: Location:	Women's Building Reference Dwg: 6 of 6 Floor 2 - Classroom 205
Bldg Name: Location: X Coordinate:	Women's Building Reference Dwg: 6 of 6  Floor 2 - Classroom 205  N/A Y Coordinate: N/A
Bldg Name: Location: X Coordinate: Barrier Area:	Women's Building Reference Dwg: 6 of 6  Floor 2 - Classroom 205  N/A Y Coordinate: N/A  Classrooms
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code	Women's Building Reference Dwg: 6 of 6  Floor 2 - Classroom 205  N/A Y Coordinate: N/A  Classrooms  Clear Floor Space - Stored Elements  2010 ADAS 305.3
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References:	Women's Building Reference Dwg: 6 of 6  Floor 2 - Classroom 205  N/A Y Coordinate: N/A  Classrooms  Clear Floor Space - Stored Elements  2010 ADAS 305.3
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	Women's Building Reference Dwg: 6 of 6  Floor 2 - Classroom 205  N/A Y Coordinate: N/A  Classrooms  Clear Floor Space - Stored Elements  2010 ADAS 305.3  Indard: No Quantity: JOB As-built: 1
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance State Barrier Description:	Women's Building Reference Dwg: 6 of 6  Floor 2 - Classroom 205  N/A Y Coordinate: N/A  Classrooms  Clear Floor Space - Stored Elements  2010 ADAS 305.3  Indard: No Quantity: JOB As-built: 1  Clear floor space for wheelchair not provided at control or mechanism
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	Women's Building  Reference Dwg: 6 of 6  Floor 2 - Classroom 205  N/A  Y Coordinate: N/A  Classrooms  Clear Floor Space - Stored Elements  2010 ADAS 305.3  Indard: No Quantity: JOB As-built: 1  Clear floor space for wheelchair not provided at control or mechanism  Trash bin blocks electrical switch and pencil sharpener clear floor space  Move stored items
Bldg Name: Location: X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	Women's Building Reference Dwg: 6 of 6 Floor 2 - Classroom 205 N/A Y Coordinate: N/A  Classrooms Clear Floor Space - Stored Elements 2010 ADAS 305.3  Indard: No Quantity: JOB As-built: 1  Clear floor space for wheelchair not provided at control or mechanism  Trash bin blocks electrical switch and pencil sharpener clear floor space  Move stored items  3 Hindrance Cost Est \$0.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 78L
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Classroom 205
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Actuator/Control - Forward Reach High Unobstructed
Code References:	2010 ADAS 305.3
Performance Sta	ndard: No Quantity: EACH As-built: 1
Barrier Description:	Control or mechanism not at min. 15" or max. 48" high
Findings:	Emergency phone 49-1/2" high on center
Rec. Solution:	Relocate control or mechanism to min. 15" or max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 78M
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Classroom 205
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Projector Screen Pull
Code References:	2010 ADAS 305.3
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Screen pull not at max. 48" high for side reach
Findings:	Projector screen pull 70-1/2" high
Rec. Solution:	Relocate to max. 48" high or provide extension
Barrier Severity:	3 Hindrance Cost Est \$75.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 78N
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Classroom 205
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Desk - Knee Clearance
Code References:	2010 ADAS 902
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Knee clearance of at least 27" high, 30" wide and 8" deep not provided underneath desk
Findings:	16" deep knee clearance
Rec. Solution:	Reposition desk to provide knee clearance
Barrier Severity:	1 Necessary Cost Est \$875.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: Instructo	or desk / Surface height is adjustable
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 780
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Classroom 205
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Counters and Tables
Barrier Type:	Counter - Knee Clearance
Code References:	2010 ADAS 305.3
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Knee clearance not min. 27" high, 19" deep or 30" wide
Findings:	14" deep knee clearance at shelf under podium
Rec. Solution:	Provide min. 1 accessible podium
Barrier Severity:	3 Hindrance Cost Est \$875.00 Facility Function: Public Status: Open
Implementation	
Notes:	Priority: 2 Implementation Phase: Implementation Date:



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 78P
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Classroom 205
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Actuator/Control - Side Reach High Unobstructed
Code References:	2010 ADAS 305.3
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Control or mechanism not at min. 15" or max. 48" high
Findings:	Phone mounted under podium at 9" high
Rec. Solution:	Relocate control or mechanism to min. 15" or max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: Instruct	or counter
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 78Q
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Classroom 205
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Door Hardware - Privacy Latch
Code References:	2010 ADAS 404.2.7
Performance Sta	andard: No Quantity: EACH As-built: 2
Barrier Description:	Privacy latch provided involves tight grasping, pinching or twisting
Findings:	Hardware not operable with a closed fist
Rec. Solution:	Replace door latch
Barrier Severity:	1 Necessary Cost Est \$600.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: Doors to	o balcony



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 78R
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Classroom 205
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Clear Width
Code References:	2010 ADAS 404.2.3
Performance Sta	ndard: No Quantity: EACH As-built : 2
Barrier Description:	Clear width passage through door, sliding/folding door or gate is not min. 32"
Findings:	26-1/2" clear width for doors to balcony
Rec. Solution:	Replace doors or gates and frame
Barrier Severity:	1 Necessary Cost Est \$4,500.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 78S
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Classroom 205
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Door 10" Bottom Surface - Kickplate
Code References:	2010 ADAS 404.2.10
Performance Sta	ndard: No Quantity: EACH As-built : 2
Barrier Description:	Decay (Cata la alcamaia, 40) and eath an international habitant and a
•	Door/Gate lacks min. 10" smooth uninterrupted bottom surface
Findings:	8-1/2" high for doors to balcony
Findings: Rec. Solution:	
-	8-1/2" high for doors to balcony  Provide kick plates at push side of door
Rec. Solution:	8-1/2" high for doors to balcony  Provide kick plates at push side of door  1 Necessary Cost Est \$450.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 78T
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Classroom 205
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Threshold - Height exceeding 1/2"
Code References:	2010 ADAS 404.2.5
Performance Sta	indard: No Quantity: EACH As-built : 2
Barrier Description:	Door/Gate threshold exceeds 1/2" in height
Findings:	1" high
Rec. Solution:	Provide new door thresholds
Barrier Severity:	1 Necessary Cost Est \$550.00 Facility Function: Public Status: Open
Implementation	Priority: 1 Implementation Phase: Implementation Date:
Notes: 2 sets of	f balcony doors / lip at balcony doors
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 78U
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Classroom 205
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Desk - Ratio
Code References:	2010 ADAS 902
Performance Sta	andard: No Quantity: EACH As-built: 1
Barrier Description:	At least 1 desk or 5% of all desks not accessible
Findings:	Min. 3 accessible desks not provided
Rec. Solution:	Provide min. 1 additional accessible desk
Rec. Solution: Barrier Severity:	
	3 Hindrance Cost Est \$875.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 78V
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Classroom 205
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Desk - Integration
Code References:	2010 ADAS 307.2
Performance Sta	andard: No Quantity: JOB As-built : 1
Barrier Description:	Desk not integrated into assembly seating
Findings:	Desk identified as accessible is not integrated into typical seating
Rec. Solution:	Move desk to integrated setting
Barrier Severity:	2 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 78W
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Classroom 205
Location: X Coordinate:	Floor 2 - Classroom 205  N/A  Y Coordinate: N/A
X Coordinate:	N/A Y Coordinate: N/A
X Coordinate: Barrier Area:	N/A Y Coordinate: N/A Alarms
X Coordinate: Barrier Area: Barrier Type: Code	N/A Y Coordinate: N/A  Alarms  Horn/Strobe - Common Use Area  2010 ADAS 702.1
X Coordinate: Barrier Area: Barrier Type: Code References:	N/A Y Coordinate: N/A  Alarms  Horn/Strobe - Common Use Area  2010 ADAS 702.1
X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta	N/A  Alarms  Horn/Strobe - Common Use Area  2010 ADAS 702.1  andard: No Quantity: EACH As-built: 1
X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description:	N/A  Alarms  Horn/Strobe - Common Use Area  2010 ADAS 702.1  andard: No Quantity: EACH As-built: 1  No horn/strobes in common use areas
X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings:	N/A  Alarms  Horn/Strobe - Common Use Area  2010 ADAS 702.1  andard: No Quantity: EACH As-built: 1  No horn/strobes in common use areas  No device provided  Provide strobe in common use area
X Coordinate: Barrier Area: Barrier Type: Code References: Performance Sta Barrier Description: Findings: Rec. Solution:	N/A  Alarms  Horn/Strobe - Common Use Area  2010 ADAS 702.1  andard: No Quantity: EACH As-built: 1  No horn/strobes in common use areas  No device provided  Provide strobe in common use area  1 Necessary Cost Est \$5,500.00 Facility Function: Public Status: Open



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 79A
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Skylight Activity Room 204
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Signage
Barrier Type:	Permanent Room/Space - Tactile Characters
Code References:	2010 ADAS 216.2
Performance Sta	ndard: No Quantity: EACH As-built : 2
Barrier Description:	No tactile characters at sign identifying permanent rooms and spaces with visual signs
Findings:	No tactile signage provided at doors within public route
Rec. Solution:	Provide accessible signs
Barrier Severity:	1 Necessary Cost Est \$500.00 Facility Function: Public Status: Open
Implementation	Priority: 3 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 79B
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Skylight Activity Room 204
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Hardware - Operation
Code References:	2010 ADAS 404.2.7
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Hardware not operable with a closed fist
Findings:	Hardware not operable with a closed fist
Rec. Solution:	Provide new hardware
Barrier Severity:	1 Necessary Cost Est \$300.00 Facility Function: Public Status: Open
Implementation	
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 79C
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Skylight Activity Room 204
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Classrooms
Barrier Type:	Door Hardware - Privacy Latch
Code References:	2010 ADAS 404.2.7
Performance Sta	andard: No Quantity: EACH As-built: 1
Barrier Description:	Privacy latch provided involves tight grasping, pinching or twisting
Findings:	Hardware not operable with a closed fist
Rec. Solution:	Replace door latch
Barrier Severity:	1 Necessary Cost Est \$300.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 79D
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Skylight Activity Room 204
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Vision Lights - New Construction
Code References:	2010 ADAS 404.2.11
Performance Sta	indard: No Quantity: EACH As-built : 2
Barrier Description:	View panels in or adjacent to doors or gates not max. 43" above floor or ground
Findings:	View panels located higher than 43" above the floor
Rec. Solution:	Replace doors/gates or vision panels
Barrier Severity:	2 Recommended Cost Est \$4,500.00 Facility Function: Public Status: Open
Implementation	
•	Priority: 2 Implementation Phase: Implementation Date:



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 79E
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Skylight Activity Room 204
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Electrical Switches - Height
Code References:	2010 ADAS 308.2
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Light switch control box top edge not at max. 48" high
Findings:	49" high
Rec. Solution:	Relocate switch box top edge to max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 79F
Bldg Name:	Women's Building   Reference Dwg:   6 of 6
Location:	Floor 2 - Skylight Activity Room 204
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Clear Floor Space
Barrier Type:	Protruding Object
Code References:	2010 ADAS 307
Performance Sta	andard: No Quantity: EACH As-built : 1
Barrier Description:	Protruding object in circulation path protrudes more than 4" between 27" and 80" high
Findings:	Shelf protrudes 6-3/4" at 37" high
Rec. Solution:	Remove object or provide detectable warning for the visually impaired
Barrier Severity:	1 Necessary Cost Est \$550.00 Facility Function: Public Status: Open
Implementation	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 79G
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Skylight Activity Room 204
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	First Aid Kit - Opening Mechanism
Code References:	2010 ADAS 305.3
Performance Sta	ndard: No Quantity: EACH As-built : 2
Barrier Description:	Opening mechanism on first aid kit not usable with a closed fist
Findings:	Mechanisms not fist operable
Rec. Solution:	Replace operating controls
Barrier Severity:	1 Necessary Cost Est \$550.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 79H
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Skylight Activity Room 204
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	First Aid Kit - High Reach Range
Code References:	2010 ADAS 305.3
Performance Sta	andard: No Quantity: EACH As-built : 0
Barrier Description:	Opening mechanism on first aid kit not at max. 48" high for side reach
Findings:	54-1/4" - 63-1/4" high
Rec. Solution:	Relocate control or mechanism to max. 48" high
Barrier Severity:	1 Necessary Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 79
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Skylight Activity Room 204
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Coat Hook - Height
Code References:	2010 ADAS 308.2
Performance Sta	andard: No Quantity: EACH As-built : 0
Barrier Description:	Clothing hooks not max. 48" high AFF
Findings:	Mattress pad hooks 64" - 65" high
Rec. Solution:	Provide additional hooks or provide assistance
Barrier Severity:	2 Recommended Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: Mattres	s pad hooks 10 hooks
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 79J
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Skylight Activity Room 204
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Coat Hook - Height
Code References:	2010 ADAS 308.2
Performance Sta	andard: No Quantity: EACH As-built: 1
Barrier Description:	Clothing hooks not max. 48" high AFF
Findings:	63-1/4" high
Rec. Solution:	Provide additional hook
Barrier Severity:	
	2 Recommended Cost Est \$125.00 Facility Function: Public Status: Open
Implementation	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 79K
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Skylight Activity Room 204
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Clear Floor Space
Code References:	2010 ADAS 305.3
Performance Sta	ndard: No Quantity: SF As-built: 0
Barrier Description:	Clear floor space for wheelchair not provided at control or mechanism
Findings:	Radiator and stored items block clear floor space at coat hooks
Rec. Solution:	Remodel area to provide wheelchair space at control or mechanism
Barrier Severity:	3 Hindrance Cost Est \$0.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 79L
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Skylight Activity Room 204
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Actuator/Control - Fist Operable
Code References:	2010 ADAS 305.3
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Control or mechanism not usable with a closed fist
Findings:	Fan controls not fist operable
Rec. Solution:	Replace operating controls
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: 2 of 2	



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 79M
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Skylight Activity Room 204
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Controls and Mechanisms
Barrier Type:	Actuator/Control - Hi/low Reach
Code References:	2010 ADAS 308.2.2
Performance Sta	ndard: No Quantity: EACH As-built : 1
Barrier Description:	Use of control involves low reach of less than 15" above floor or more than 48" high
Findings:	Paper towel dispenser 60" high
Rec. Solution:	Relocate to area at min. 15" or max. 48" high
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes:	
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 79N
Bldg Name:	Women's Building Reference Dwg: 6 of 6
Location:	Floor 2 - Skylight Activity Room 204
X Coordinate:	N/A Y Coordinate: N/A
Barrier Area:	Doors or Gates
Barrier Type:	Door 10" Bottom Surface - Kickplate
Code References:	2010 ADAS 404.2.10
Performance Sta	ndard: No Quantity: EACH As-built : 2
Barrier Description:	Door/Gate lacks min. 10" smooth uninterrupted bottom surface
Findings:	8-1/2" high for doors to balcony
Rec. Solution:	Provide min. 10" high kick plates at push side of door
Barrier Severity:	1 Necessary Cost Est \$450.00 Facility Function: Public Status: Open
Implementation	Priority: 2 Implementation Phase: Implementation Date:
Notes: 2 sets of	f balcony doors



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 790				
Bldg Name:	Women's Building Reference Dwg: 6 of 6				
Location:	Floor 2 - Skylight Activity Room 204				
X Coordinate:	N/A Y Coordinate: N/A				
Barrier Area:	Doors or Gates				
Barrier Type:	Clear Width				
Code References:	2010 ADAS 404.2.3				
Performance Sta	ndard: No Quantity: EACH As-built : 2				
Barrier Description:	Clear width passage through door, sliding/folding door or gate is not min. 32"				
Findings:	26-1/2" clear width for doors to balcony				
Rec. Solution:	Replace doors or gates and frame				
Barrier Severity:	1 Necessary Cost Est \$4,500.00 Facility Function: Public Status: Open				
Implementation	Priority: 2 Implementation Phase: Implementation Date:				
Notes: Clear w	idth is ok if both sides of doors are open - 2 sets of balcony doors				
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 79P				
Bldg Name:	Women's Building Reference Dwg: 6 of 6				
Location:	Floor 2 - Skylight Activity Room 204				
X Coordinate:	N/A Y Coordinate: N/A				
Barrier Area:	Doors or Gates				
Barrier Type:	Threshold - Height exceeding 1/2"				
Code References:	2010 ADAS 404.2.5				
Performance Sta	indard: No Quantity: EACH As-built : 2				
Barrier Description:	Door/Gate threshold exceeds 1/2" in height				
Findings:	1" high				
Rec. Solution:	Provide new door thresholds				
Barrier Severity:	1 Necessary Cost Est \$550.00 Facility Function: Public Status: Open				
Implementation	Priority: 1 Implementation Phase: Implementation Date:				
Notes: 2 sets o					



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 79Q				
Bldg Name:	Women's Building Reference Dwg: 6 of 6				
Location:	Floor 2 - Skylight Activity Room 204				
X Coordinate:	N/A Y Coordinate: N/A				
Barrier Area:	Controls and Mechanisms				
Barrier Type:	Shelves or Cabinets				
Code References:	2010 ADAS 305.3				
Performance Sta	andard: No Quantity: JOB As-built : 1				
Barrier Description:	Shelf or cabinet not mounted max. 48" above floor or ground				
Findings:	Shelf or cabinet not accessible				
Rec. Solution:	Provide additional shelf at accessible height or provide assistance				
Barrier Severity:	3 Hindrance Cost Est \$0.00 Facility Function: Public Status: Open				
Implementation	Priority: 2 Implementation Phase: Implementation Date:				
Notes: 6 shelvii	ng units				
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 79R				
Bldg Name:	Women's Building Reference Dwg: 6 of 6				
Location:	Floor 2 - Skylight Activity Room 204				
X Coordinate:	N/A Y Coordinate: N/A				
Barrier Area:	Controls and Mechanisms				
Barrier Type:	Coat Hook - Height				
Code References:	2010 ADAS 308.2				
Performance Sta	andard: No Quantity: EACH As-built : 1				
Barrier Description:	Clothing hooks not max. 48" high AFF				
Findings:	Coat hooks inside shelves 63-1/2" high				
Rec. Solution:	Provide additional hook				
Darriar Cavarity					
Barrier Severity:	2 Recommended Cost Est \$125.00 Facility Function: Public Status: Open				
Implementation					



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 79S				
Bldg Name:	Women's Building Reference Dwg: 6 of 6				
Location:	Floor 2 - Skylight Activity Room 204				
X Coordinate:	N/A Y Coordinate: N/A				
Barrier Area:	Controls and Mechanisms				
Barrier Type:	Electrical Outlets - Hi/Low Reach				
Code References:	2010 ADAS 308.2.2				
Performance Sta	ndard: No Quantity: EACH As-built : 1				
Barrier Description:	Use of outlet involves low reach of less than 15" above floor or more than 48" high				
Findings:	12-1/2" high				
Rec. Solution:	Relocate outlet to area at min. 15" or max. 48" high				
Barrier Severity:	3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open				
Implementation	Priority: 2 Implementation Phase: Implementation Date:				
Notes:					
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 79T				
Bldg Name:	Women's Building Reference Dwg: 6 of 6				
Location:	Floor 2 - Skylight Activity Room 204				
X Coordinate:	N/A Y Coordinate: N/A				
Barrier Area:	Alarms				
Barrier Type:	Horn/Strobe - Common Use Area				
Code References:	2010 ADAS 702.1				
Performance Sta	indard: No Quantity: EACH As-built : 1				
Barrier Description:	No horn/strobes in common use areas				
Findings:	No device provided				
Rec. Solution:	Provide strobe in common use area				
Barrier Severity:	cy: 1 Necessary Cost Est \$5,500.00 Facility Function: Public Status: Open				
Implementation	, , , , , , , , , , , , , , , , , , , ,				
Implementation	Priority: 1 Implementation Phase: Implementation Date:				



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 80A				
Bldg Name:	Women's Building Reference Dwg: 6 of 6				
Location:	Floor 2 - Corridor H203				
X Coordinate:	N/A Y Coordinate: N/A				
Barrier Area:	Corridors				
Barrier Type:	Sign - Permanent Room/Space				
Code References:	2010 ADAS 703.1				
Performance Sta	ndard: No Quantity: EACH As-built : 5				
Barrier Description:	No sign with raised characters and Braille at permanent room or space with visual sign				
Findings:	No tactile info on signs with visual information				
Rec. Solution:	Provide signs at latch side of entry door, where possible				
Barrier Severity:	1 Necessary Cost Est \$1,250.00 Facility Function: Public Status: Open				
Implementation	Priority: 3 Implementation Phase: Implementation Date:				
Notes: Rooms 2	203, 203A, 203B, 203C, 203D				
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 80B				
Bldg Name:	Women's Building Reference Dwg: 6 of 6				
Location:	Floor 2 - Corridor H203				
X Coordinate:	N/A Y Coordinate: N/A				
Barrier Area:	Corridors				
Barrier Type:	Door - Hardware - Operation				
Code References:	2010 ADAS 404.2.7				
Performance Sta	ndard: No Quantity: EACH As-built : 1				
Barrier Description:	Hardware not operable with a closed fist				
Findings:	Hardware not operable with a closed fist				
Rec. Solution:	Replace hardware				
Barrier Severity:	1 Necessary Cost Est \$300.00 Facility Function: Public Status: Open				
Implementation	Priority: 2 Implementation Phase: Implementation Date:				
Notes:					



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 80C				
Bldg Name:	Women's Building Reference Dwg: 6 of 6				
Location:	Floor 2 - Corridor H203				
X Coordinate:	N/A Y Coordinate: N/A				
Barrier Area:	Corridors				
Barrier Type:	Door Vision Lights - Existing				
Code References:	2010 ADAS 404.2.11				
Performance Sta	indard: No Quantity: EACH As-built : 1				
Barrier Description:	Doors or gates with view panels or side lights adjacent to doors not max. 43" high				
Findings:	Bottom edge of view panel in door or adjacent to door is not max. 43" high				
Rec. Solution:	Replace door or vision panel in door				
Barrier Severity:	3 Hindrance Cost Est \$2,250.00 Facility Function: Public Status: Open				
Implementation	Priority: 2 Implementation Phase: Implementation Date:				
Notes: 48-1/2"					
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 80D				
Bldg Name:	Women's Building Reference Dwg: 6 of 6				
Location:	Floor 2 - Corridor H203				
X Coordinate:	N/A Y Coordinate: N/A				
Barrier Area:	Doors or Gates				
Barrier Type:	Front App/pull 18" SEC - Relocate Door				
Code References:	2010 ADAS Figure 404.2.4.1				
Performance Sta	indard: No Quantity: EACH As-built : 1				
Barrier Description:	Door/Gate at pull side with min. 60" lacks min. 18" strike edge clearance at pull side				
Findings:	13-1/2" strike edge clearance				
Rec. Solution:	Relocate door or gate to provide maneuvering clearance				
Barrier Severity:					
Implementation					
Notes:					



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 80E				
Bldg Name:	Women's Building Reference Dwg: 6 of 6				
Location:	Floor 2 - Corridor H203				
X Coordinate:	N/A Y Coordinate: N/A				
Barrier Area:	Corridors				
Barrier Type:	Electrical Switches - Max. 48" High				
Code References:	2010 ADAS 308.2.1				
Performance Sta	ndard: No Quantity: EACH As-built : 1				
Barrier Description:	Light switch control box top edge not at max. 48" high				
Findings:	50-1/2" high				
Rec. Solution:	Relocate switch box top edge to max. 48" high				
Barrier Severity:	y: 3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open				
Implementation	Priority: 2 Implementation Phase: Implementation Date:				
Notes:					
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 80F				
Bldg Name:	Women's Building Reference Dwg: 6 of 6				
Location:	Floor 2 - Corridor H203				
X Coordinate:	N/A Y Coordinate: N/A				
Barrier Area:	Corridors				
Barrier Type:	Electrical Outlets 03/03/2014 16 19				
Code References:	2010 ADAS 308.2.2				
Performance Sta	ndard: No Quantity: EACH As-built : 1				
Barrier Description:	Use of outlet involves low reach of less than 15" above floor or more than 48" high				
Findings:	12" high				
Rec. Solution:	Relocate outlet to area at min. 15" or max. 48" high				
Barrier Severity:	verity: 3 Hindrance Cost Est \$750.00 Facility Function: Public Status: Open				
Implomentation					
implementation	Priority: 2 Implementation Phase: Implementation Date:				



Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 80G				
Bldg Name:	Women's Building Reference Dwg: 6 of 6				
Location:	Floor 2 - Corridor H203				
X Coordinate:	N/A Y Coordinate: N/A				
Barrier Area:	Turning Space				
Barrier Type:	Circular Turning Space - Min. 60"				
Code References:	2010 ADAS 304.3.1				
Performance Sta	ndard: No Quantity: SF As-built: 1				
Barrier Description:	Circular turning space not minimum of 60" in diameter (including toe/knee space)				
Findings:	47-1/2" turning space				
Rec. Solution:	Remodel to provide turning space at end of corrridor				
Barrier Severity:	2 Recommended Cost Est \$75.00 Facility Function: Public Status: Open				
Implementation	Priority: 2 Implementation Phase: Implementation Date:				
Notes:					
Field Date:	2/24/2014 Report Date 2/27/2014 Barrier #: 80H				
Bldg Name:	Women's Building Reference Dwg: 6 of 6				
Location:	Floor 2 - Corridor H203				
X Coordinate:	N/A Y Coordinate: N/A				
Barrier Area:	Corridors				
Barrier Type:	Horn/Strobe Device				
Code References:	2010 ADAS 702.1				
Performance Sta	ndard: No Quantity: EACH As-built : 1				
Barrier Description:	No horn or strobe in corridor where fire alarm exists in building				
Findings:	No device provided				
Rec. Solution:	Provide horn/strobe in common use area				
Barrier Severity:	1 Necessary Cost Est \$5,500.00 Facility Function: Public Status: Open				
Implementation					
Notes:					





# SUMMARY REPORT

Cost Estimate Total	\$1,546,735.00		
Cost Estimate - Priority 1:	\$400,350.00	% of Total Cost Estimate:	25.88%
Cost Estimate - Priority 2:	\$478,420.00	% of Total Cost Estimate:	30.93%
Cost Estimate - Priority 3:	\$667,965.00	% of Total Cost Estimate:	43.19%